

HVAC ADDITIONS TO CAFETERIA BUILDING

COMPTON COLLEGE

1111 E. ARTESIA BLVD., COMPTON, CA. 90221

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019



2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
next step
 DESIGN, INC
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 REG. # 09-38



DRAWING INDEX

T0.0	TITLE SHEET
E0.1	GENERAL NOTES, SYMBOLS LIST & DETAILS
E0.2	SINGLE LINE DIAGRAM & PANEL SCHEDULES
E1.0	SITE PLAN
E1.1	ELECTRICAL FLOOR PLAN
E2.1	FIRE ALARM FLOOR PLAN
E2.2	FIRE ALARM SUBMITTAL
M0.1	MECHANICAL GENERAL NOTES & LEGEND
M0.2	MECHANICAL SCHEDULES
M0.3	BUILDING 'Q' TITLE-24 COMPLIANCE
M0.4	BUILDING 'Q' TITLE-24 COMPLIANCE
M1.1	MECHANICAL FLOOR PLAN
M2.1	MECHANICAL DETAILS
P0.1	PLUMBING GENERAL NOTES & LEGEND
P1.1	PLUMBING FLOOR PLAN
P2.1	PLUMBING DETAILS
S-1	ROOF FRAMING PLAN
S-2	CONSTRUCTION DETAILS
S-3	CONSTRUCTION DETAILS
TOTAL	19 SHEETS

APPLICABLE CODES

2016 CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE
 CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 1

2016 CALIFORNIA BUILDING CODE (CBC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 2 (2015 INTERNATIONAL BUILDING CODE (IBC) VOLUMES 1-2 W/ 2016 CALIFORNIA AMENDMENTS)

2016 CALIFORNIA ELECTRICAL CODE (CEC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 3 (2014 NATIONAL ELECTRIC CODE (NEC) W/ 2016 CALIFORNIA AMENDMENTS)

2016 CALIFORNIA MECHANICAL CODE (CMC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 4 (2015 UNIFORM MECHANICAL CODE (CMC) W/ 2016 CALIFORNIA AMENDMENTS)

2016 CALIFORNIA PLUMBING CODE (CPC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 5 (2015 UNIFORM PLUMBING CODE (CPC) 2016 W/ CALIFORNIA AMENDMENTS)

2013 ASME A17.1(w/A17.1a/CSA B44a-08 ADDENDA) SAFETY CODE FOR ESCALATORS AND ELEVATORS

2016 CALIFORNIA FIRE CODE (CFC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 9 (2015 INTERNATIONAL FIRE CODE (IFC) W/ 2016 CALIFORNIA AMENDMENTS)

2016 CALIFORNIA REFERENCED STANDARDS CODE CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 12

AMERICANS WITH DISABILITIES ACT (ADA) ACCESSIBILITY GUIDELINES FOR BUILDINGS AND FACILITIES (ADAAG)

CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, CALIFORNIA STATE ACCESSIBILITY STANDARDS STATE FIRE MARSHAL REGULATIONS (AS AMENDED TO DATE) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 19, 2016 EDITION

2016 CALIFORNIA ENERGY CODE (CEC) (CCR) TITLE 24, PART 6

2016 CALIFORNIA GREEN BUILDING STANDARDS CODE (CCR) TITLE 24, PART 11

APPLICABLE NFPA STANDARDS

- NFPA 13 - AUTOMATIC SPRINKLER SYSTEMS, 2016 EDITION
- NFPA 14 - STANDPIPE SYSTEMS, 2013 EDITION
- NFPA 17 - DRY CHEMICAL SYSTEMS, 2013 EDITION
- NFPA 17a - WET CHEMICAL SYSTEMS, 2013 EDITION
- NFPA 24 - PRIVATE FIRE MAINS, 2016 EDITION
- NFPA 70E - STANDARD FOR ELECTRICAL SAFETY IN THE WORKPLACE, 2015 EDITION
- NFPA 72 - NATIONAL FIRE ALARM CODE WITH CALIFORNIA AMENDMENTS, 2016 EDITION SEE UL STD. 1971 FOR "VISUAL DEVICES"
- NFPA 80 - FIRE DOOR AND OTHER OPENING PROTECTIVES, 2016 EDITION
- NFPA 92 - STANDARD FOR SMOKE CONTROL SYSTEMS, 2015 EDITION
- NFPA 253 - CRITICAL RADIANT FLUX OF FLOOR COVERING SYSTEMS, 2015 EDITION
- NFPA 2001 - CLEAN AGENT FIRE EXTINGUISHING SYSTEMS, 2015 EDITION
- UL464 - AUDIBLE SIGNAL APPLIANCES, 2003 EDITION
- UL521 - HEAT DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS, 1999 EDITION

REFERENCE CODE SECTION FOR NFPA STANDARDS - 2016 CBC (SFM). SEE CHAPTER 35 FOR STATE OF CALIFORNIA AMENDMENTS TO NFPA STANDARDS

PROJECT TEAM

PROJECT ADDRESS
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

OWNER
 COMPTON COMMUNITY COLLEGE DISTRICT
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221
 (310) 900-1600 Ext. 2606
 lowens@compton.edu


ELECTRICAL ENGINEER
 R.F. HAWKINS CONSULTING
 2357 NAPLES AVENUE
 MENTONE, CA 92359
 (909) 522-4518
 design@rfhawkinsconsulting.com

MECHANICAL ENGINEER
 PAIS CONSULTING GROUP
 18 PINE HILL
 LADERA RANCH, CA 92694
 (949) 610-9675
 iliepais@gmail.com

STRUCTURAL ENGINEER
 NEXT STEP DESIGN
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 (949) 215-3339
 scott@NSD.biz

TYPE OF CONSTRUCTION

BUILDING "Q" TYPE B B OCCUPANCY NON FIRE SPRINKLERED

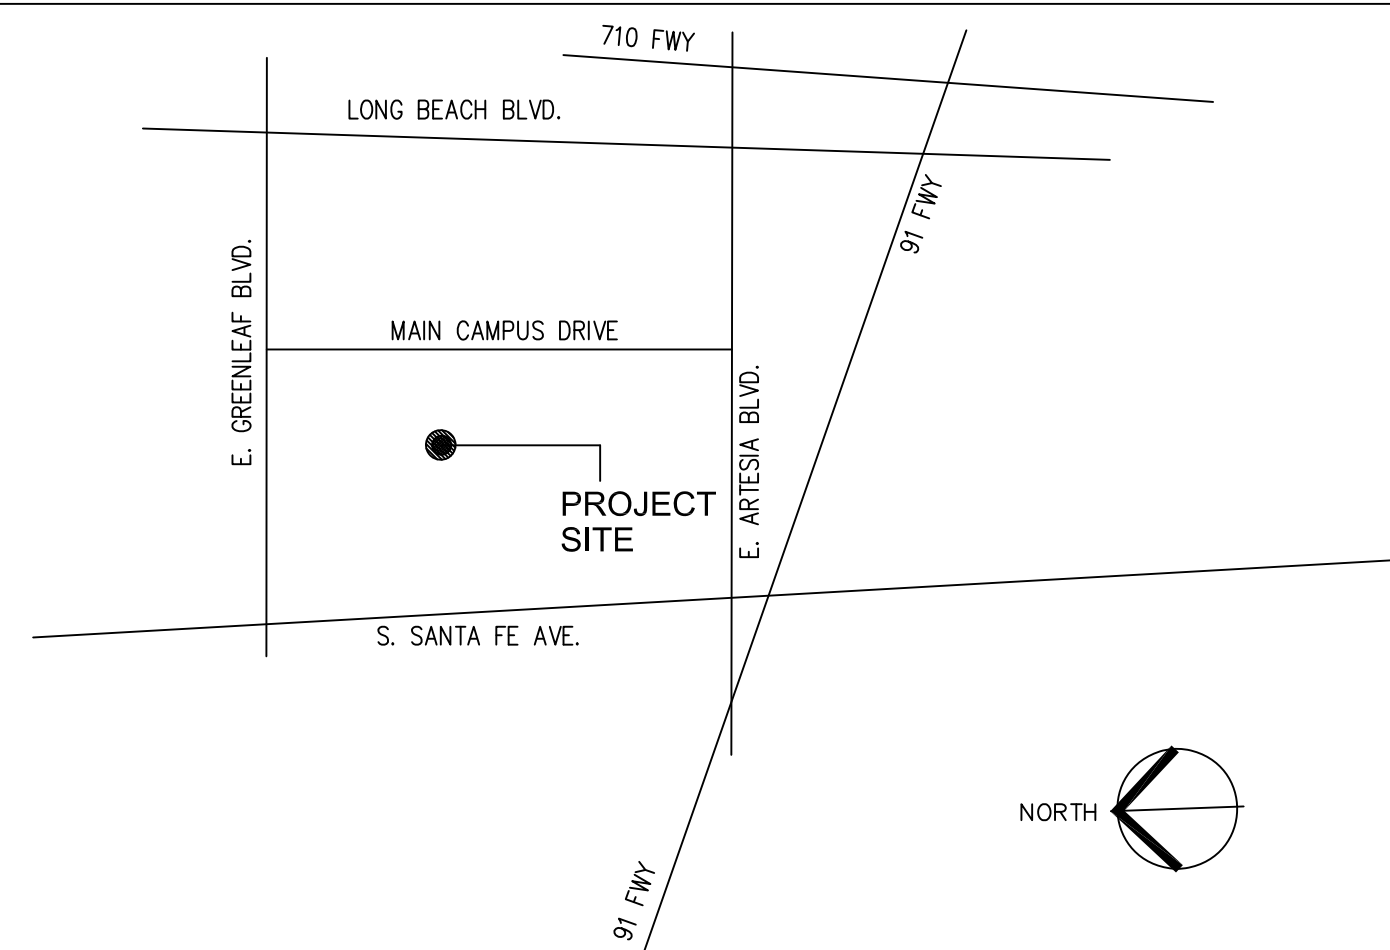

VICINITY MAP

SCOPE OF WORK

THE SCOPE OF THE WORK AS STATED BELOW IS FOR DSA PLAN REVIEW PURPOSES ONLY AND DOES NOT CONSTITUTE A DETAILED AND FULL EXPLANATION OF THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

SELECTIVE DEMOLITION OF EXISTING HVAC EQUIPMENT AND THE INSTALLATION OF NEW HVAC EQUIPMENT.

SELECTIVE DEMOLITION OF EXISTING ELECTRICAL RELATED TO THE HVAC EQUIPMENT AND INSTALLATION OF NEW DUCTS, CONDUIT, CABLING AS REQUIRED TO RESTORE OPERATION OF THE HVAC SYSTEM.

ANY REPAIRS OR NEW INSTALLATION AND PENETRATIONS TO ROOF SHALL BE PER SPECIFICATIONS AND ADHERE TO ALL REQUIREMENTS OF THE DISTRICT STANDARD ROOFING SYSTEM.

INSTALLATION OF NEW AUTOMATIC FIRE ALARM SYSTEM.

DSA APPROVAL OF THESE PLANS SHALL NOT BE CONSTRUED AS THE CERTIFICATION OF COMPLIANCE FOR THE FOLLOWING BUILDINGS AS REQUIRED BY THE FIELD ACT, EDUCATION CODE SECTION 17280-17316 AND SECTIONS 81130-81147. REFER TO E1.0 SITE PLAN.

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

△			
△			
△			
△			
NO	DATE	BY	DESCRIPTION

REVISIONS			
DRAWN:	JC	CHECKED:	RFH
DATE:	8/31/2018	SCALE:	AS NOTED
PROJECT NUMBER:	17-301		

TITLE SHEET

DRAWING NUMBER : **T0.0**



GENERAL NOTES:

1. VERIFY EXISTING SITE CONDITIONS, SERVICE REQUIREMENTS (ELECTRICAL, INTEGRATED COMMUNICATIONS AND FIRE ALARM) AND EXACT LOCATIONS OF SERVICE FACILITIES BEFORE SUBMITTING BID. SUBMITTAL OF BID INDICATES CONTRACTOR IS COGNIZANT OF ALL JOB SITE CONDITIONS, ACTUAL PHYSICAL LOCATIONS, AND WORK TO BE PERFORMED.
2. CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS, INSURANCE, EQUIPMENT, INSTALLATION, CONSTRUCTION TOOLS, TRANSPORTATION, ETC. FOR A COMPLETE AND PROPERLY OPERATING ELECTRICAL SYSTEM.
3. CONSTRUCTION TERMINOLOGY, AND THE STANDARDS AND ACCEPTABLE METHODS OF INSTALLATION REQUIRED BY THESE CONTRACT DOCUMENTS ARE BASED ON PUBLISHED STANDARDS OF THE CALIFORNIA ELECTRICAL CONTRACTORS ASSOCIATION, NATIONAL ELECTRICAL SAFETY CODE, AMERICAN NATIONAL STANDARDS INSTITUTE DOCUMENTS, NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION, UNDERWRITERS LABORATORIES AND THE CALIFORNIA ELECTRICAL CODE. SUBMITTAL OF BID INDICATES THE CONTRACTOR IS COGNIZANT OF THESE STANDARDS AND THE REQUIREMENTS NECESSARY TO PERFORM ALL THE WORK AS SET FORTH IN THESE CONTRACT DOCUMENTS.
4. ALL WORK THAT REQUIRES SERVICE INTERRUPTION TO ANY BUILDING ON THE CAMPUS SHALL BE COORDINATED WITH THE DISTRICT AT A MINIMUM OF (7) DAYS IN ADVANCE AND SHALL NOT OCCUR DURING SCHOOL HOURS. WORK FOR THIS PROJECT SHALL NOT BE PERFORMED DURING SCHOOL HOURS, INCLUDING AFTER HOURS PROGRAMS AND/OR EVENTS. INCLUDE ALL COSTS FOR SHIFT DIFFERENTIAL, WEEKEND, OVERTIME, OR HOLIDAYS, IN BASE BID FOR THIS PROJECT. C.C.D. WILL NOT BE RESPONSIBLE FOR ANY PREMIUM PAY FOR THIS PROJECT.
5. THESE PLANS ARE DIAGRAMMATIC ONLY, FOLLOW AS CLOSELY AS POSSIBLE AND REFER TO ARCHITECTURAL DRAWINGS FOR DETAILS. STRUCTURAL DETAILS, EXACT EQUIPMENT AND OUTLET LOCATIONS. ALTHOUGH NOT SHOWN, CONTRACTOR SHALL PROVIDE ALL J-BOXES, PULL BOXES, ELLS, OFFSETS ETC., FOR A COMPLETE CODE APPROVED INSTALLATION. FOOTAGE SHOWN ON ELECTRICAL SINGLE LINES AND RISER DIAGRAMS ARE FOR CALCULATION PURPOSES ONLY AND ARE NOT FOR BIDDING PURPOSES OR MATERIAL TAKEOFF. ALL LOCATIONS OF EVERY OUTLET SHALL BE VERIFIED PRIOR TO ROUGH-IN.
6. THE CONNECTION METHOD SHOWN IS FOR BIDDING PURPOSES. THIS CONTRACTOR SHALL COORDINATE AND PROVIDE, FROM ACTUAL BUILDING SHOP DRAWINGS, THE CONNECTION SHOWN ON THOSE DRAWINGS.
7. EACH CONDUCTOR OF EVERY SYSTEM SHALL BE PERMANENTLY TAGGED IN COMPLIANCE WITH OSHA.
8. ALL MATERIALS SHALL BE NEW, AND OF THE SAME MANUFACTURER FOR EACH CLASS OR GROUP OF EQUIPMENT. MATERIALS SHALL BE LISTED AND APPROVED BY UNDERWRITERS LABORATORIES FOR THE USE AND ENVIRONMENT, AND SHALL BEAR THE INSPECTION LABEL WHERE SUBJECT TO SUCH APPROVAL. MATERIALS SHALL MEET WITH THE APPROVAL OF THE DIVISION OF INDUSTRIAL SAFETY, AND ALL GOVERNING BODIES HAVING JURISDICTION. MATERIALS SHALL BE MANUFACTURED IN ACCORDANCE WITH APPLICABLE STANDARDS ESTABLISHED BY A.N.S.I., U.L., N.E.M.A. AND N.B.F.U. INSTALL PER MANUFACTURERS' RECOMMENDATIONS. ALL EXTERIOR EQUIPMENT SHALL BE WEATHERPROOF.
9. SUBSTITUTIONS OF SPECIFIED MATERIALS ARE IN ACCORDANCE WITH THE GENERAL CONDITIONS. APPROVAL OF EQUAL MATERIALS PRIOR TO BID ARE BY WRITTEN ADDENDUM ONLY OR AS STATED ON THE PLANS.
10. SUBMIT SHOP DRAWINGS FOR ALL MAJOR PIECES OF ELECTRICAL EQUIPMENT INCLUDING BUT NOT LIMITED TO: ELECTRICAL COMPONENTS.
11. CONTRACTOR SHALL PERFORM HIS WORK IN ACCORDANCE WITH ALL GOVERNING STATE, COUNTY, LOCAL CODES, O.S.H.A. AND THE 2016 CALIFORNIA ELECTRICAL CODE (CEC).
12. THE COMPLETE ELECTRICAL SYSTEM SHALL BE GROUNDED IN ACCORDANCE WITH THE 2016 CALIFORNIA ELECTRICAL CODE (C.E.C.) ART. #250, AND AS SHOWN ON THE DRAWINGS. AT THE REQUEST OF AND IN THE PRESENCE OF THE AUTHORIZED INSPECTOR, THE CONTRACTOR SHALL PROVIDE SYSTEM RESISTANCE READINGS.
13. PENETRATIONS TO FIRE-RATED MATERIALS SHALL BE RESTORED TO EQUAL RATING AS REQUIRED BY THE STATE FIRE MARSHAL.
14. CONDUCTORS SHALL BE CODE GRADE, 600 VOLT CLASS, COPPER, MARKED 24" ALONG ITS LENGTH SHOWING MANUFACTURER'S NAME, MAXIMUM ALLOWABLE VOLTAGE AND SIZE. CONDUCTORS SHALL BE TYPE "THWN" (WET) OR "THHN" (DRY), DELIVER THE WIRE TO THE SITE IN UNBROKEN PACKAGES.
15. CONDUIT SHOWN AS EXPOSED OR APPROVED FOR EXPOSED INSTALLATION SHALL BE INTERMEDIATE METALLIC CONDUIT (I.M.C.), OR RIGID GALVANIZED STEEL (RGS), SECURED WITH TWO HOLE MALLEABLE PIPE STRAPS AND SCREWS. ALL BOXES AND FITTINGS SHALL BE SUPPORTED AND SECURED IN COMPLIANCE WITH THE 2016 CALIFORNIA ELECTRICAL CODE (C.E.C.) ART. #370.
16. P.V.C. CONDUIT, WITH CODE SIZED GROUND, SHALL BE USED UNDERGROUND ONLY, IF APPROVED BY LOCAL CODE. INSTALL PER LOCAL CODE REQUIREMENTS. ALL CONDUIT SWEEPS AND RISERS SHALL BE I.M.C. OR RGS, WITH HALF-LAPPED TAPE COVERING OR FACTORY APPLIED PVC COATING. ROUTE UNDERGROUND CONDUITS AROUND PROPOSED BUILDING LOCATIONS.
17. ALL CONDUIT ONLY (C.O.) SHALL HAVE A 1/4" PULL WIRE OR ROPE.
18. USE ONLY COMPETENT AND SKILLED PERSONNEL AND PERFORM ALL WORK, INCLUDING AESTHETIC AS WELL AS ELECTRICAL AND MECHANICAL ASPECTS TO STANDARDS CONSISTENT WITH THE BEST PRACTICES OF THE TRADE.
19. UNLESS SPECIFICALLY SHOWN ON THESE PLANS NO STRUCTURAL MEMBER SHALL BE CUT, DRILLED NOR NOTCHED WITHOUT PRIOR WRITTEN AUTHORIZATION FROM THE STRUCTURAL ENGINEER AND THE DISTRICT STRUCTURAL ENGINEER FROM THE DIVISION OF THE STATE ARCHITECT.
20. THE SEISMIC ANCHORAGE OF MECHANICAL AND ELECTRICAL EQUIPMENT SHALL CONFORM TO C.C.R. TITLE 24, 2013 C.B.C. SECTION 1832A AND ASCE 7-10. ANCHORAGE DETAILS FOR ROOF/FLOOR MOUNTED EQUIPMENT SHALL BE SHOWN ON PLANS.
21. WHERE IT BECOMES NECESSARY TO DRILL INTO OR CUT THROUGH ANY EXISTING FLOORS, WALLS OR CEILINGS TO PERMIT THE INSTALLATION OF ANY WORK UNDER THIS CONTRACT, OR TO REPAIR ANY DEFECTS THAT MAY APPEAR TO THE EXPIRATION OF THE WARRANTY, SUCH CUTTING AND PATCHING SHALL BE PERFORMED BY TRADESMEN EXPERIENCED IN THE WORK REQUIRED. CONTRACTOR SHALL PAY FOR ALL COSTS REQUIRED FOR CUTTING OR REPAIRING. ALL FINISHES SHALL MATCH EXISTING OR NEW ADJACENT SURFACES. THIS WILL INCLUDE REPLACING SEAM TO SEAM OR COMPLETE SURFACE REPLACEMENT TO MATCH EXISTING OR NEW SURFACES.
22. ALL MECHANICAL, PLUMBING, AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE DSA APPROVED CONSTRUCTION DOCUMENTS, WHERE NO DETAIL IS INDICATED. THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRACED TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2016 CBC, SECTIONS 1616A.1.18 THRU 1616A.1.26 AND ASCE 7-10 CHAPTER 13, 26 AND 30.
 - A. ALL PERMANENT EQUIPMENT AND COMPONENTS.
 - B. TEMPORARY OR MOVABLE EQUIPMENT THAT IS PERMANENTLY ATTACHED (e.g. HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR WATER.
 - C. MOVABLE EQUIPMENT WHICH IS STATIONED IN ONE PLACE FOR MORE THAN 8 HOURS AND HEAVIER THAN 400 POUNDS ARE REQUIRED TO BE ANCHORED WITH TEMPORARY ATTACHMENTS.


THE ATTACHMENT OF THE FOLLOWING MECHANICAL AND ELECTRICAL EQUIPMENT SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE, BUT NEED NOT BE DETAILED ON THE PLANS. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING AND CONDUIT.

 - A. COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVE A CENTER OF MASS LOCATED 4 FEET OR LESS ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT.
 - B. COMPONENTS WEIGHING LESS THAN 20 POUNDS, OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.


FOR THOSE ELEMENTS THAT DO NOT REQUIRE DETAILS ON THE APPROVED DRAWINGS, THE INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE STRUCTURAL ENGINEER OF RECORD AND THE DSA DISTRICT STRUCTURAL ENGINEER. THE PROJECT INSPECTOR WILL VERIFY THAT ALL COMPONENTS AND EQUIPMENT HAVE BEEN ANCHORED IN ACCORDANCE WITH ABOVE REQUIREMENTS.

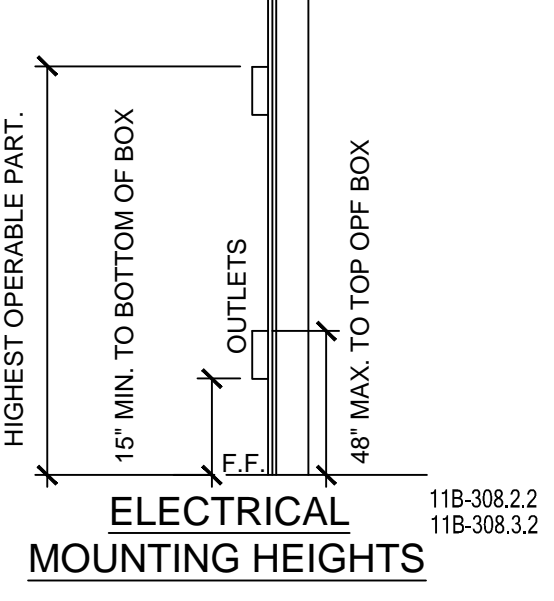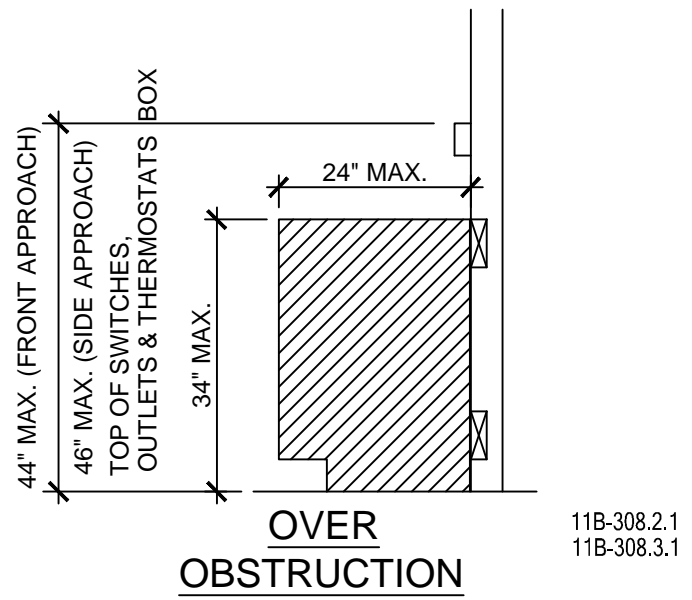

MTG. HT DET. SCALE: N.T.S.

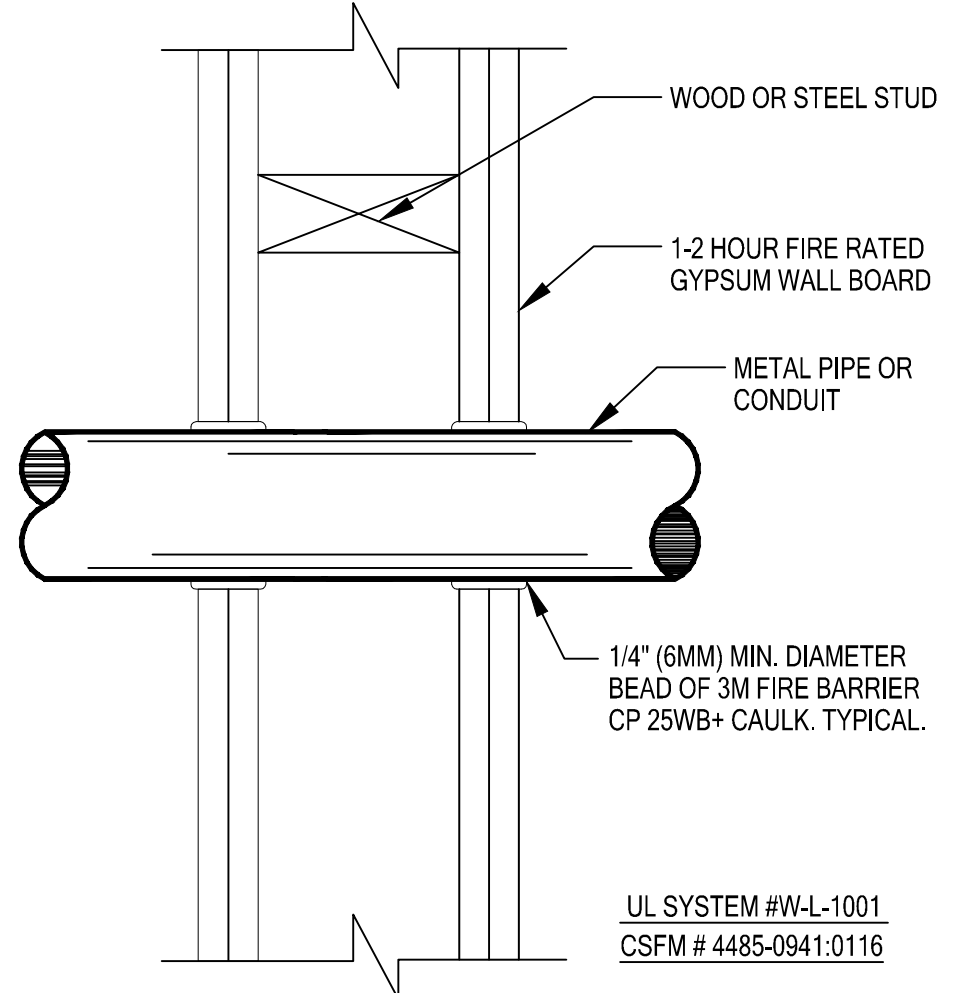

FIRESTOP DET. SCALE: N.T.S.

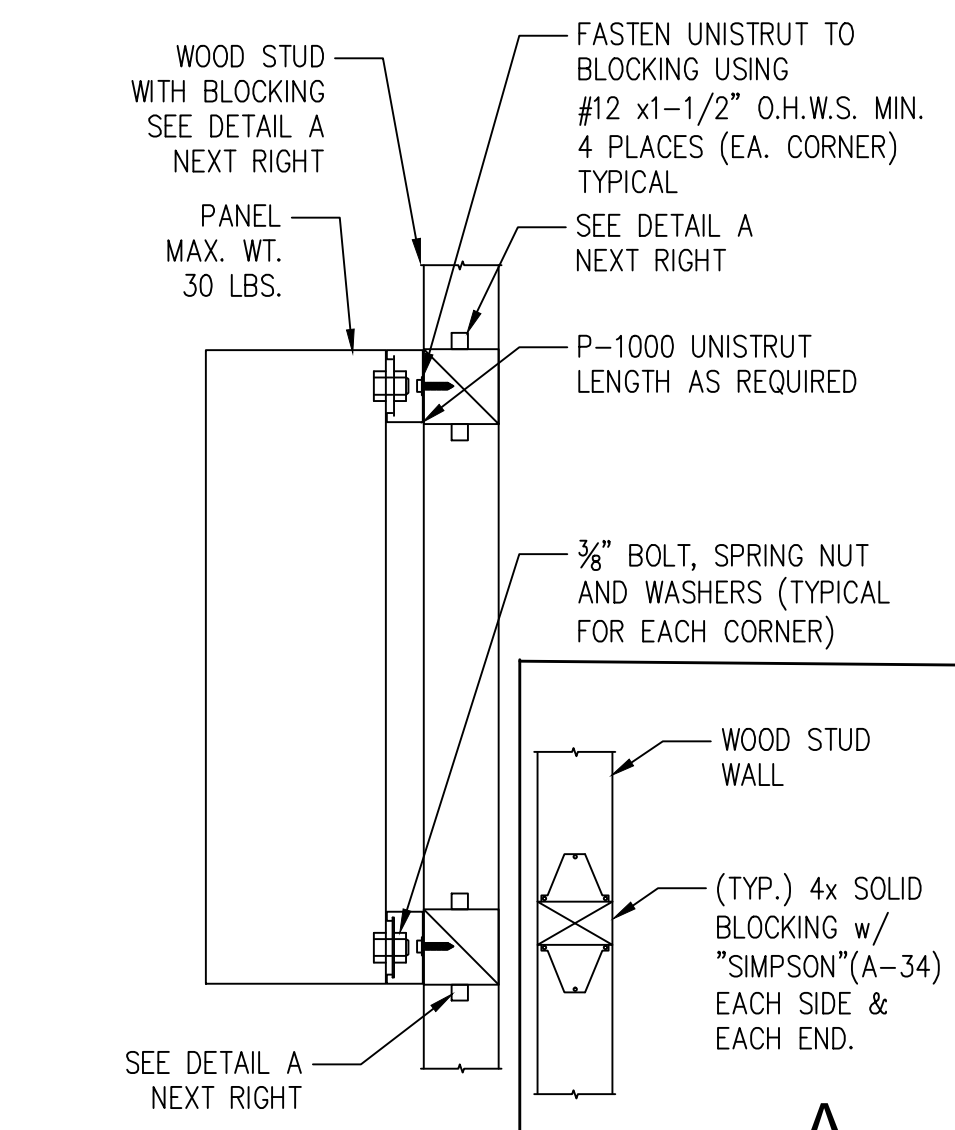

SURFACE PNL. MTG. SCALE: N.T.S.

ELECTRICAL SYMBOLS LIST:

- MAIN SWITCHBOARD REFER TO SINGLE LINE DIAGRAM.
- DISTRIBUTION PANEL REFER TO SINGLE LINE DIAGRAM.
- FLUSH MOUNTED ELECTRICAL PANELBOARD. REFER TO PANEL SCHEDULE.
- SURFACE MOUNTED ELECTRICAL PANELBOARD. REFER TO PANEL SCHEDULE.
- DUPLEX RECEPTACLE, WALL MOUNTED + 15" A.F.F. TO BOTTOM OF BOX OR AS NOTED.
- QUADPLEX RECEPTACLE, WALL MOUNTED + 15" A.F.F. TO BOTTOM OF BOX OR AS NOTED.
- FUSED DISCONNECT, SIZE AND NEMA RATING AS NOTED ON PLANS.
- PULLBOX, SIZED PER N.E.C. OR AS NOTED, CONCRETE WITH BOLT DOWN COVER.
- JUNCTION BOX, ACCESSIBLE AND MOUNTED FOR THE APPLICATION DENOTED ON PLANS.
- HOME RUN TO PANEL, LETTER DESIGNATES FLOOR, NUMBER INDICATES CIRCUITS.
- CONDUIT RUN CONCEALED, IN WALLS, FLOOR, OR ABOVE CEILING.
- CONDUIT RUN CONCEALED BELOW GRADE, 3/4" MINIMUM.
- CONDUIT RUN EXPOSED
- CONDUIT STUB OUT, CAP & MARK.
- BRANCH CIRCUIT WIRING, 2 #12 IN 1/2" CONDUIT (C) OR AS NOTED OR SYMBOLIZED
 - 1/2" C-3 #12
 - 3/4" C-4 #12
 - 3/4" C-5 #12
 - 3/4" C-6 #12
 - 3/4" C-7 #12
 - 3/4" C-8 #12
- SURFACE MOUNTED LOCKABLE TERMINAL CABINET W/ TERMINAL STRIPS AS REQUIRED.
- TELEPHONE TERMINAL BACKBOARD SIZED AS NOTED
- MECHANICAL EQUIPMENT CALLOUT. "AH" INDICATES UNIT TYPE AND "2" INDICATES UNIT NUMBER. REFER TO MECHANICAL DRAWINGS FOR EXACT LOCATION AND FULL RATING.
- DETAIL CALLOUT, "3" INDICATES DETAIL NUMBER "E0.1" INDICATES SHEET NUMBER.
- PLAN NOTE REFERENCE.
- REVISION REFERENCE.
- MOUNTING HEIGHT
- WEATHERPROOF, NEMA 3R
- FURNISH, INSTALLED AND CONNECTED, COMPLETE.
- GFCI
- EM
- C
- E/G
- I.C.S.
- ICD
- (E)
- (ER)
- (ERR)
- UG
- GEC
- C.E.C.
- U.O.N.

GENERAL DEMOLITION NOTES:

1. THE CONTRACTOR SHALL COORDINATE WITH THE OWNER, PRIOR TO REMOVAL OF EXISTING EQUIPMENT, PANELS, CONDUCTORS/CABLING AND TURN OVER REMOVED ITEMS THAT THE OWNER REQUESTS IN AS FOUND CONDITION. ITEMS ARE TO BE BOXED AND IDENTIFIED.
2. ALL EXISTING CONDUIT AS SHOWN ON PLANS WERE TAKEN FROM OWNERS RECORD DRAWINGS. THE CONTRACTOR IS RESPONSIBLE TO VERIFY EXISTING LOCATION AND ROUTING OF CONDUITS.
3. REMOVE EXISTING CABLING/CONDUCTORS FROM EXISTING FEEDER CONDUIT. CLEAN EXISTING UNDERGROUND CONDUIT AND MANDREL TO INSURE INTEGRITY, WITNESSED BY I.O.R. FOR FUTURE USE. SEAL ALL ENDS OF CONDUITS.
4. PROVIDE BLANK COVERS ON ALL EXISTING OUTLETS NOT BEING REUSED. MATCH EXISTING COVERS IN TYPE AND COLOR.
5. WHERE EXISTING EQUIPMENT, BOXES, CONDUIT ETC. IS REMOVED, REPAIR EXISTING SURFACES TO MATCH SURROUNDING AREA.

SERVICE INTERRUPTION NOTES:

1. THE CONTRACTOR SHALL PROVIDE CONTINUOUS ELECTRICAL SERVICE TO CAMPUS AS REQUIRED. PROVIDE ALL COSTS FOR BACK-UP POWER IN BID. CONTRACTOR WILL PROVIDE A SCHEDULE FOR ANY SERVICE INTERRUPTION AND NOTIFY THE DISTRICT (7) DAYS IN ADVANCE PRIOR TO SHUT-DOWN.
2. NON ESSENTIAL ELECTRICAL SERVICE MAY BE SCHEDULED FOR INTERRUPTION OF UN-OCCUPIED BUILDINGS WITH PRIOR APPROVAL OF DISTRICT.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 03-119661 INC. REVIEWED FOR
SS FLS ACS
DATE: 10/25/2019



2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rfhawkinsconsulting.com

CONSULTANT
next step
DESIGN, INC
26170 ENTERPRISE WAY SUITE 400
LAKE FOREST, CA 92630
PHONE: (949) 215-3339
FAX: (949) 215-9375
REG. 08 08-38



**HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221**

NO	DATE	BY	DESCRIPTION

REVISIONS			
DRAWN: JC	CHECKED: RFH		
DATE: 8/31/2018	SCALE: AS NOTED		
PROJECT NUMBER: 17-301			

**GENERAL NOTES,
SYMBOLS LIST
& DETAILS**



DRAWING NUMBER: **E0.1**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019



2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
next step
 DESIGN, INC.
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 909 49 09-28

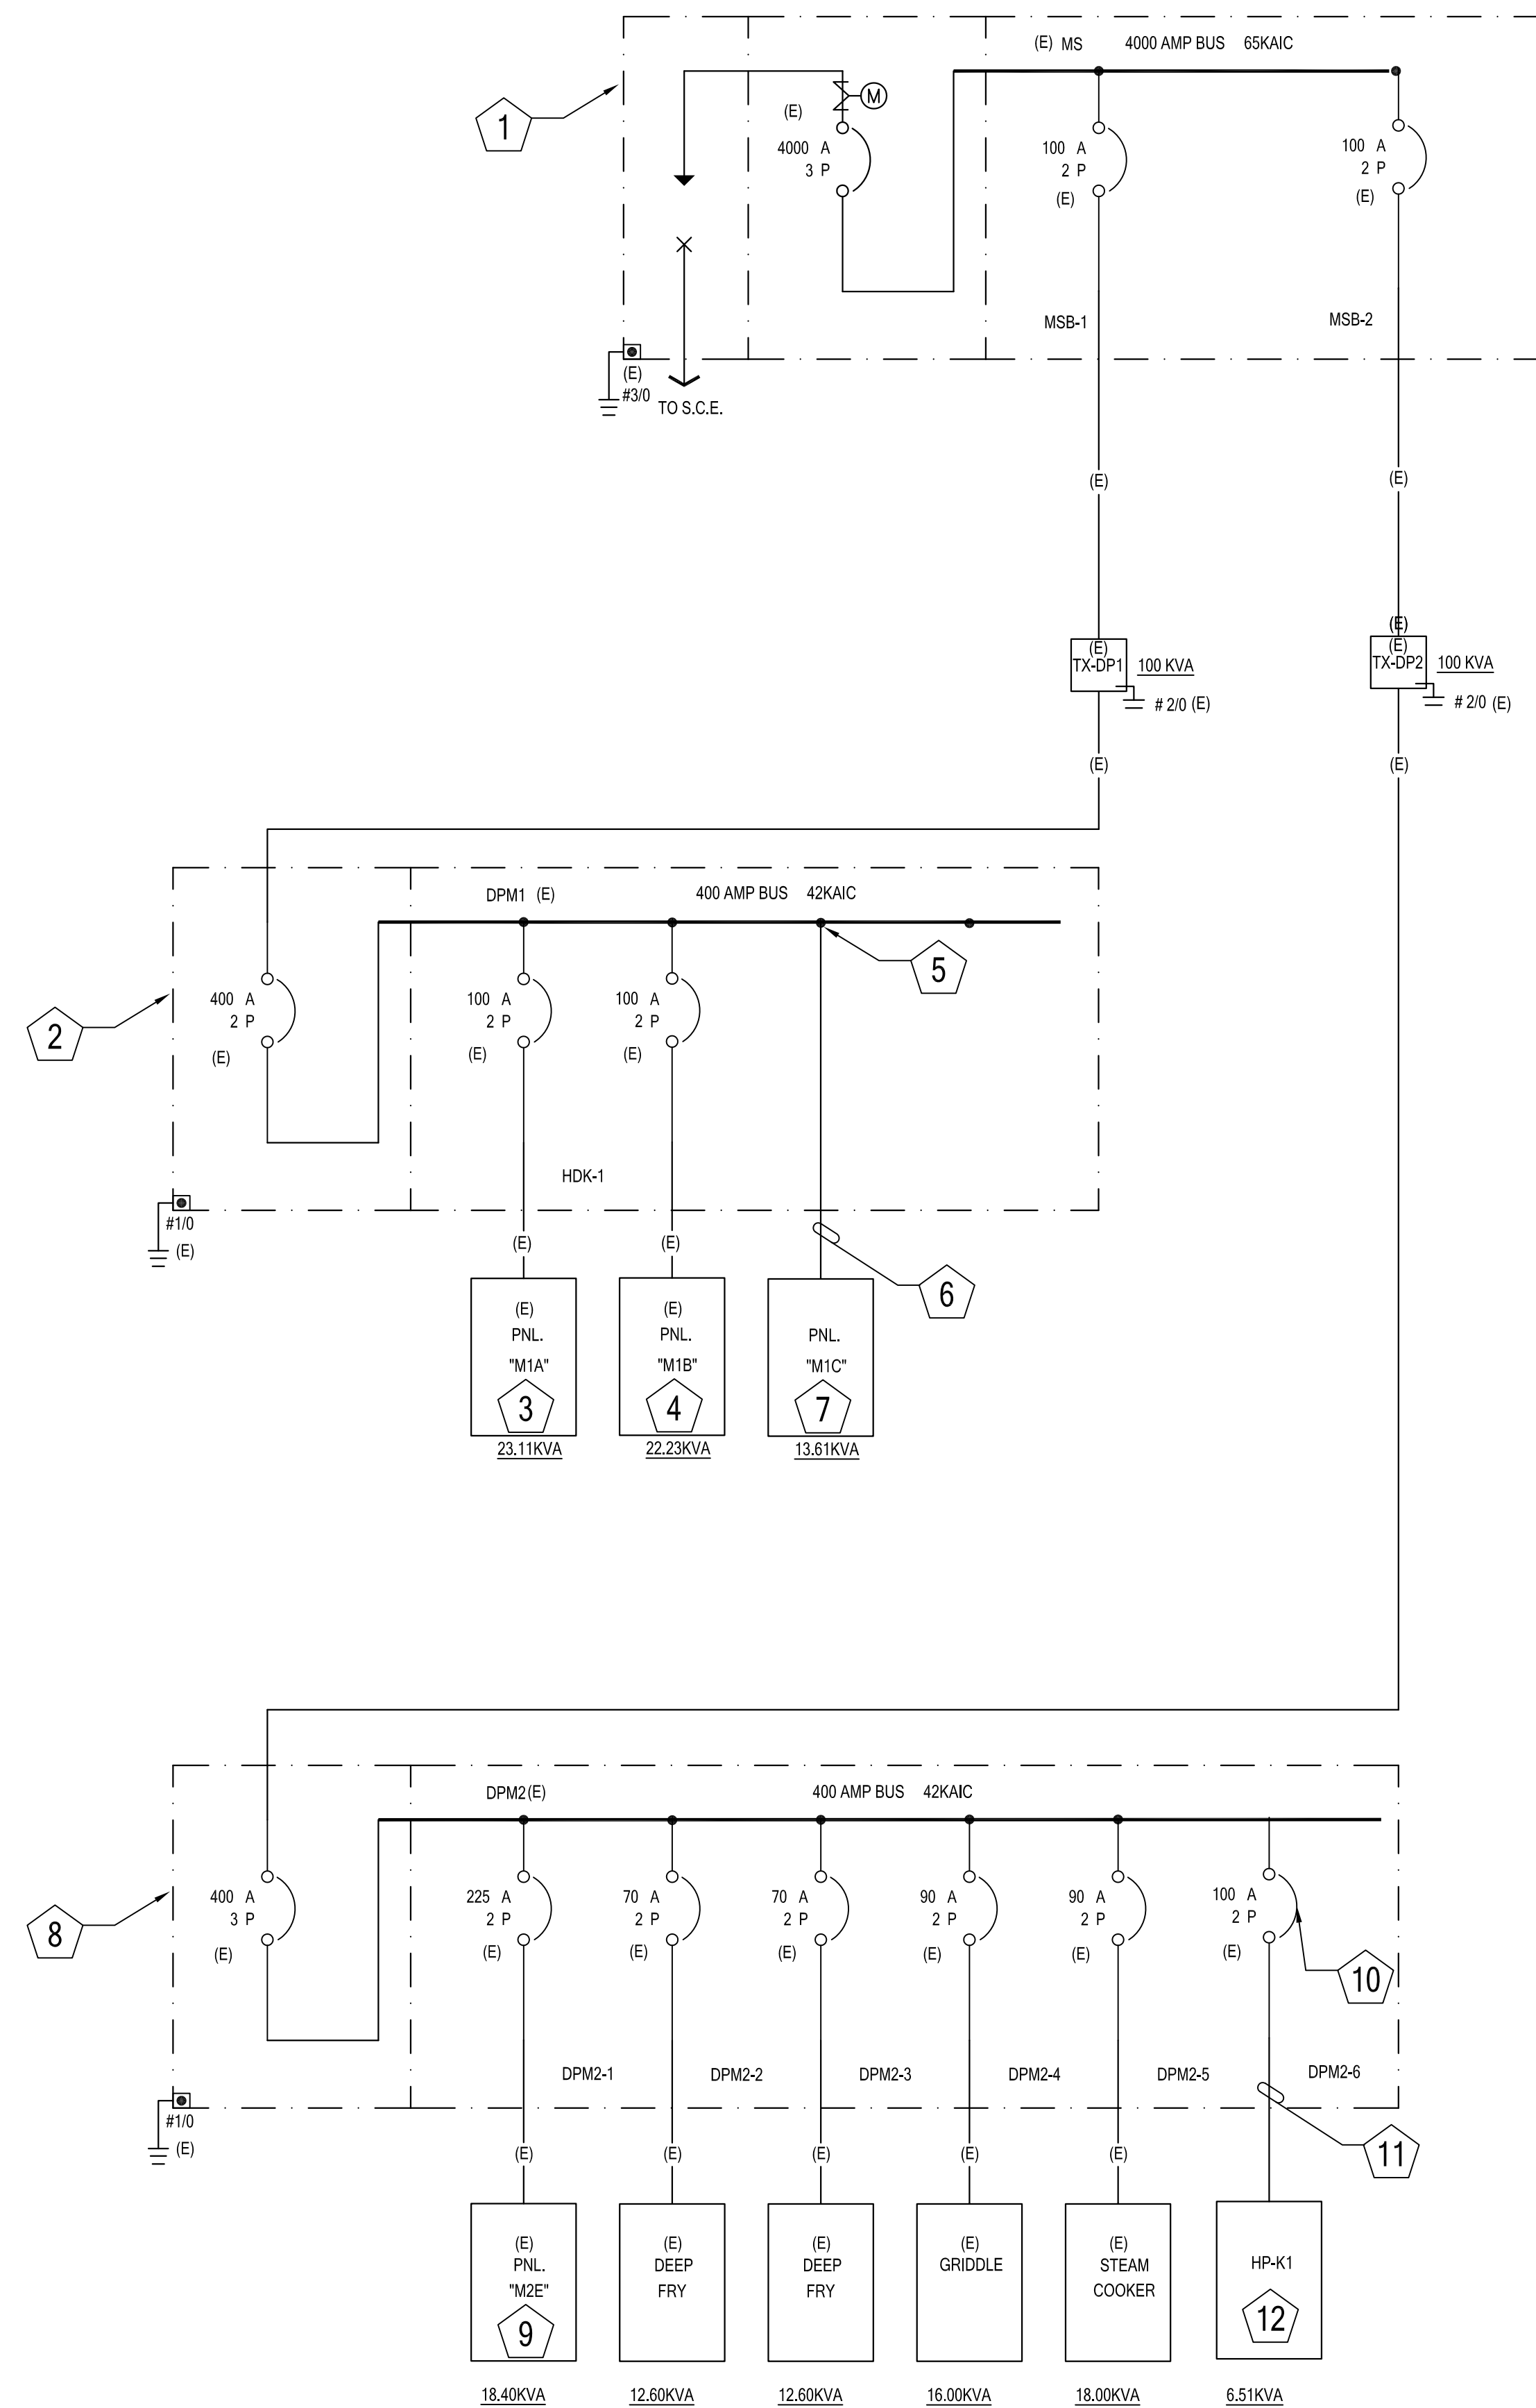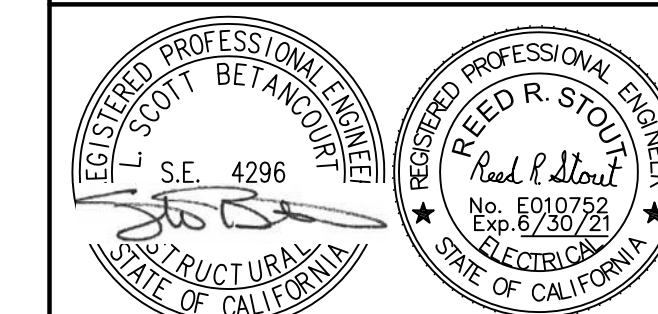

SINGLE LINE DIAGRAM NOTES:

- 1 EXISTING MAIN SWITCH BOARD "MS" NEMA 3R, 12 KV 3 PHASE 4 WIRE 4000 AMP 65000 AIC NEMA 3R.
- 2 EXISTING DISTRIBUTION PANELBOARD "DPM1" NEMA 1, 120/240 VOLT 1 PHASE 3 WIRE 400 AMP 42000 AIC NEMA 1.
- 3 EXISTING PANELBOARD "M1A", NEMA 1 SURFACE 120/240 VOLT 1 PHASE 3 WIRE 100 AMP 10000 AIC NEMA 1.
- 4 EXISTING PANELBOARD "M1B", NEMA 1 SURFACE 120/240 VOLT 1 PHASE 3 WIRE 100 AMP 10000 AIC NEMA 1.
- 5 TAP EXISTING BUSS FOR NEW PANEL "M1C", PROVIDE (3) # 1 & (1) #6 E/G.
- 6 1-1/2" C. w/ (3) #1 & (1) #6 E/G.
- 7 PANELBOARD "M1C", NEMA 1 SURFACE 120/240 VOLT 1 PHASE 3 WIRE 100 AMP 10000 AIC NEMA 1.
- 8 EXISTING DISTRIBUTION PANELBOARD "DPM2" NEMA 1, 120/240 VOLT 1 PHASE 3 WIRE 400 AMP 42000 AIC NEMA 1.
- 9 PANELBOARD "M2E", NEMA 1 SURFACE 120/240 VOLT 1 PHASE 3 WIRE 100 AMP 10000 AIC NEMA 1.
- 10 REMOVE EXISTING 100A 2/P BREAKER AND REPLACE WITH 50A 2/P BREAKER, MATCH NEW BREAKER IN MAKE, MODEL AND ALL CHARECTERISTICS.
- 11 3/4" C. w/ (2) #6 & (1) #10 E/G.
- 12 HVAC HP-K1. REFER TO E1.1 ROOF PLAN.

SCHEDULE FOR PANEL: "M1C"
 BUSSING AMPS: 100 VOLTAGE: 120/240 PHASE: 1Ø WIRE: 3W NEMA: 1
 MAINS: 100 MCB MOUNTING: SURFACE AIC RATING: 10,000

REMARKS: *PROVIDE LOCK-ON DEVICE.
 *PAINT BREAKER HANDLE "RED"

LOAD DESCRIPTION	V/A	AMP	PHASE	AMP	V/A	LOAD DESCRIPTION		
1 HP-K2	3253	50	A	20	600	FIRE ALARM CONTROL PANEL	2 *	
3 "	3253	2/P	B	20	600	FIRE ALARM POWER SUPPLY	4 *	
5 HP-K3	3253	50	A	*	A	SPACE	6	
7 "	3253	2/P	B	*	B	SPACE	8	
9 ROOF RECEPTACLE	600	20	A	*	A	SPACE	10	
11 SPACE	B	*	B	*	B	SPACE	12	
13 SPACE	A	*	A	*	A	SPACE	14	
15 SPACE	B	*	B	*	B	SPACE	16	
V/A SUB-TOTAL:		7106	6506		600	600	V/A SUB-TOTAL:	

VOLTAMPS: PHASE A: 7706 PHASE B: 7706 TOTAL CONNECTED VA: 15412
 (CONTINUOUS VA (15412) x 1.25 : 19265)+ (REMAINDER x 1.00) = TOTAL DEMAND VA: 19265 TL AMPS: 80.2

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

NO	DATE	BY	DESCRIPTION

REVISIONS
 DRAWN: JC CHECKED: RFH
 DATE: 8/31/2018 SCALE: AS NOTED
 PROJECT NUMBER: 17-301

SINGLE LINE DIAGRAM
 & PANEL SCHEDULE


DRAWING NUMBER : **E0.2**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
 RF Hawkins Consulting


2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
next step
 DESIGN, INC
 26170 ENTERPRISE WAY, SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 102.09 P. 08-208

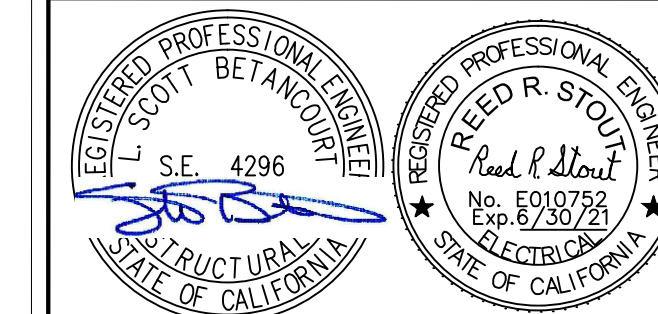

BUILDING A#'s

- BLDG. A A#9728
- BLDG. A A#17886
- BLDG. B A#9728
- BLDG. C A#2999
- BLDG. C A#9728
- BLDG. D A#9728
- BLDG. E A#2454
- BLDG. E A#9728
- BLDG. F A#9728
- BLDG. G A#9728
- BLDG. Q A#3139
- BLDG. R A#4703
- BLDG. U A#27842
- BLDG. W A#
- BLDG. X A#4713
- BLDG. X A#20290
- BLDG. Y A#16578
- BLDG. Y A#108986
- ALLIED HEALTH A#
- CENTRAL PLANT A#113210
- CHILD DEV. CTR. A#42100
- CHILD DEV. CTR. A#104777
- INFANT, TODDLER LEARNING RES. A#10517
- MS A#69120
- MIS A#69120
- SSC A#105117
- STADIUM A#32362

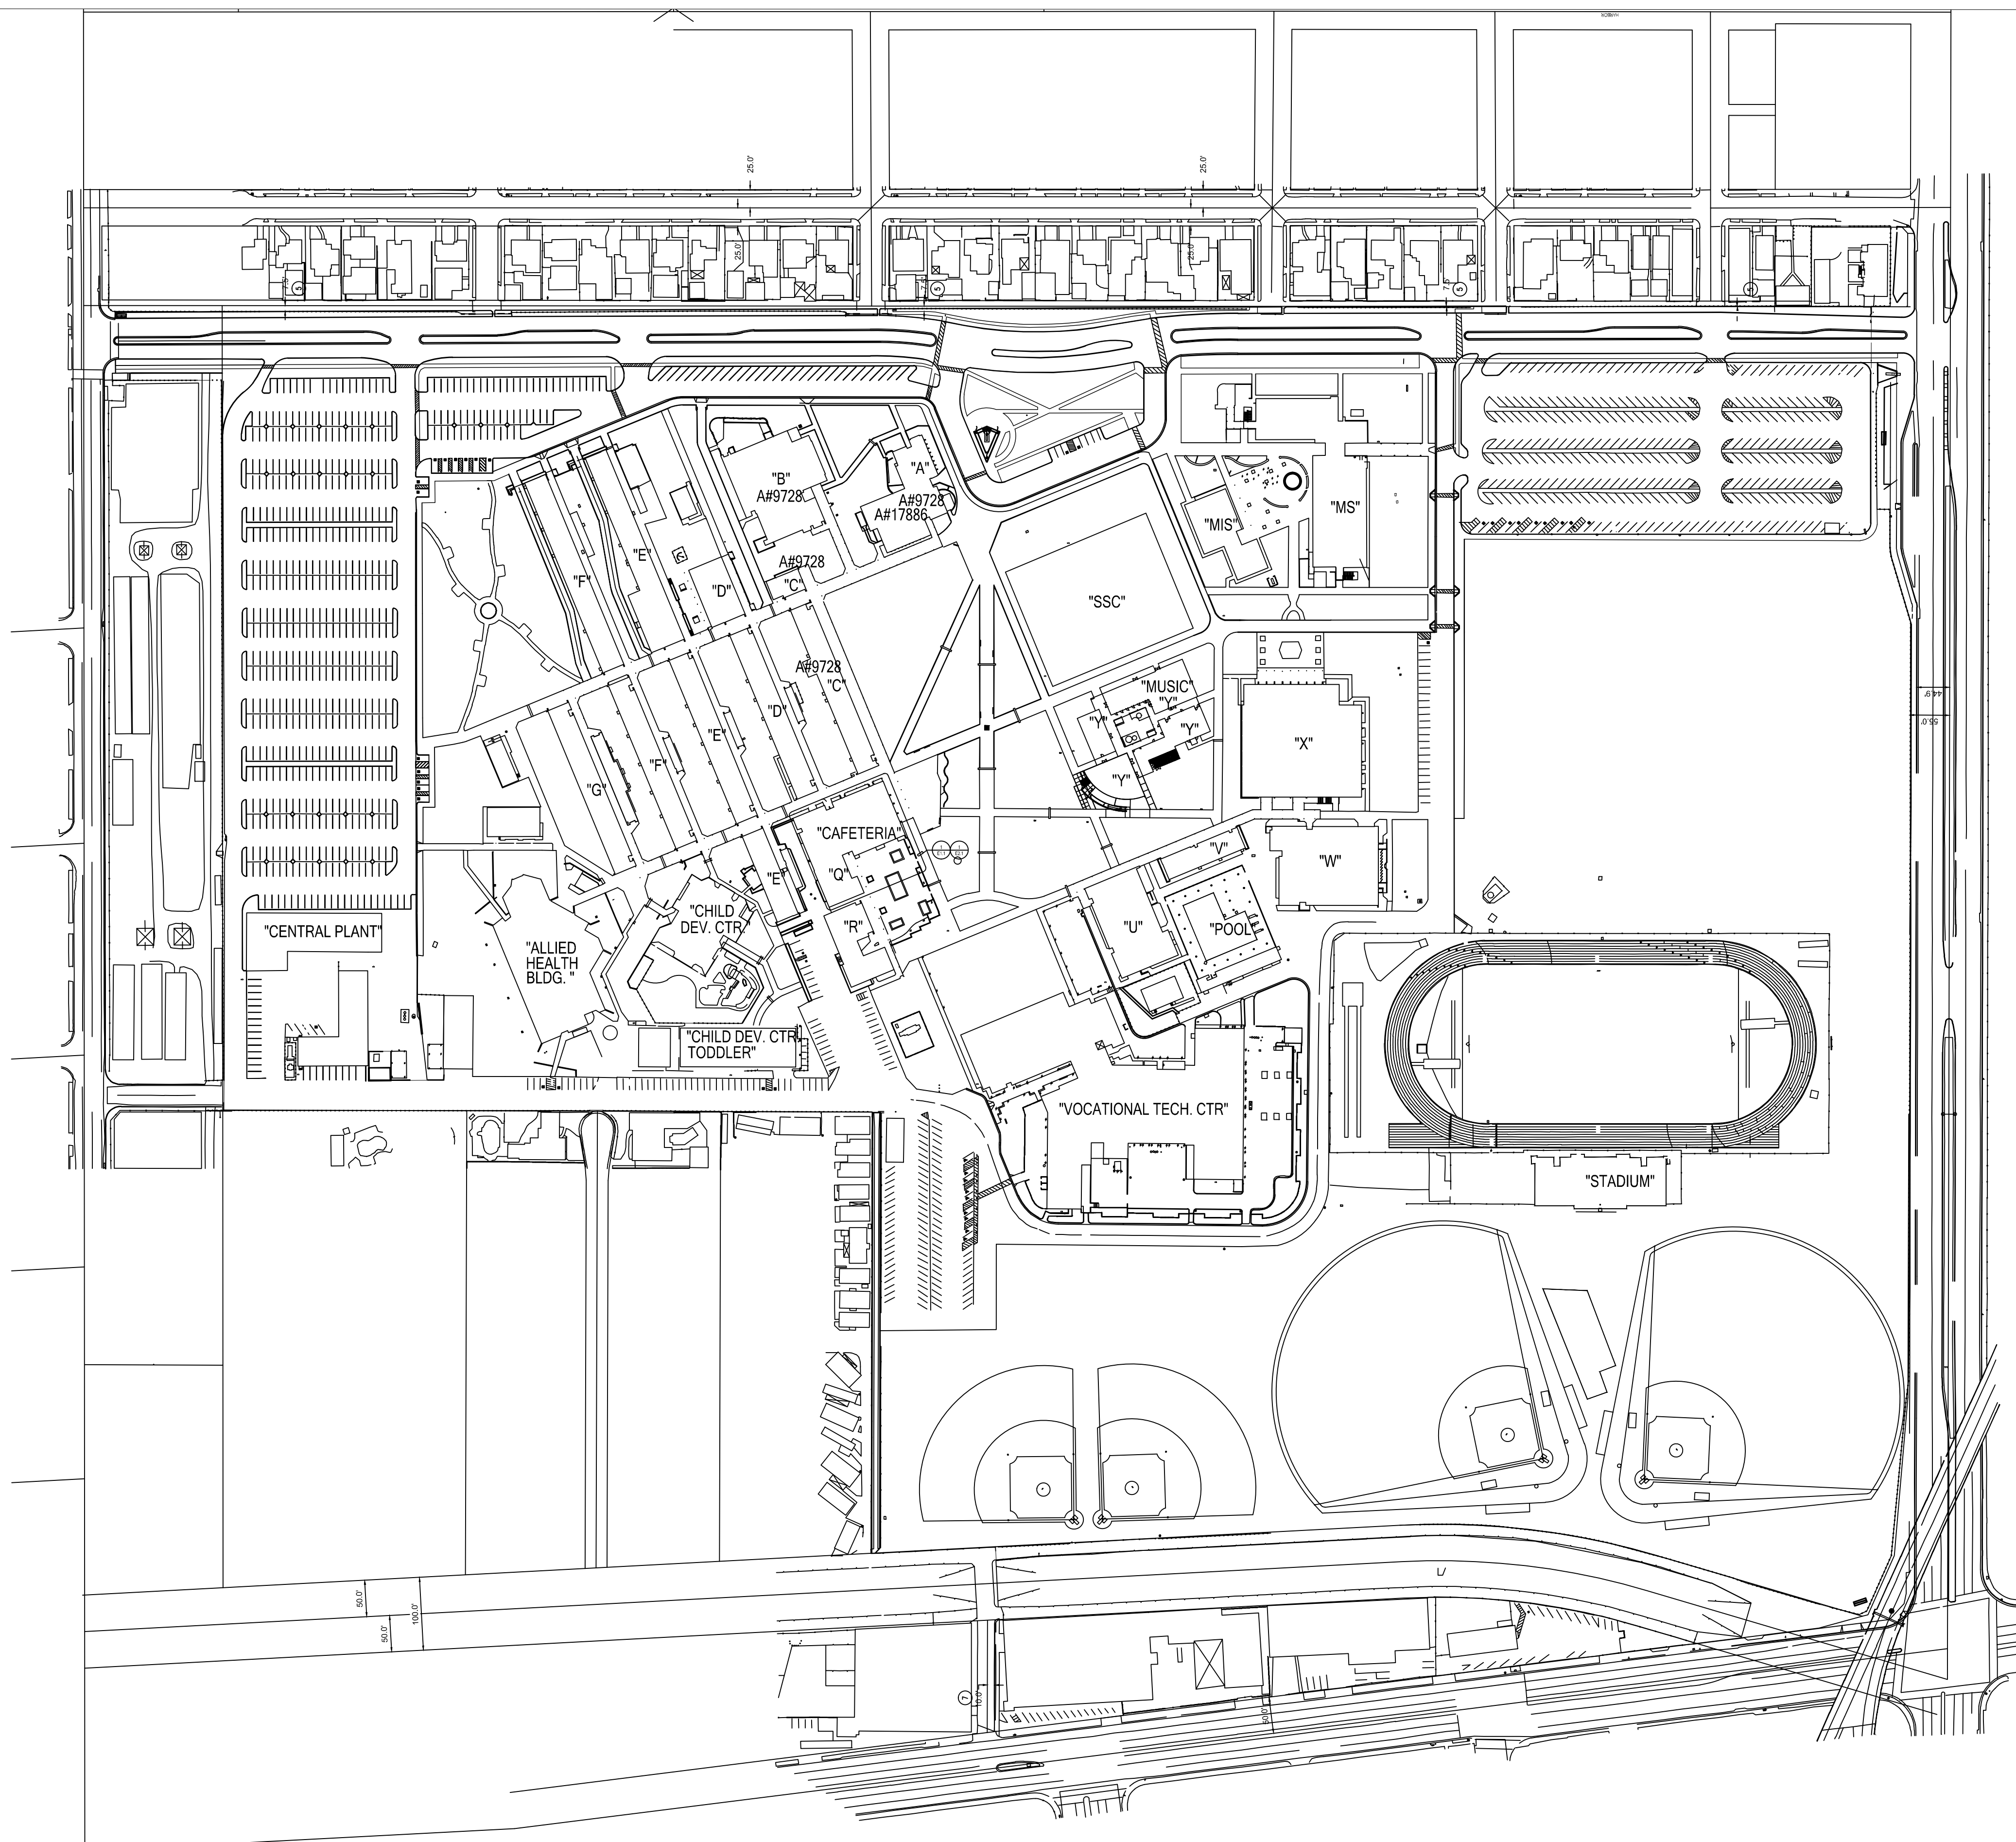

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

△			
△			
△			
△			
NO	DATE	BY	DESCRIPTION
REVISIONS			
DRAWN:	JC	CHECKED:	RFH
DATE:	8/31/2018	SCALE:	AS NOTED
PROJECT NUMBER:	17-301		

SITE PLAN



DRAWING NUMBER : **E1.0**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com


CONSULTANT
next step
DESIGN, INC
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 REG. 09 FEB 08-28

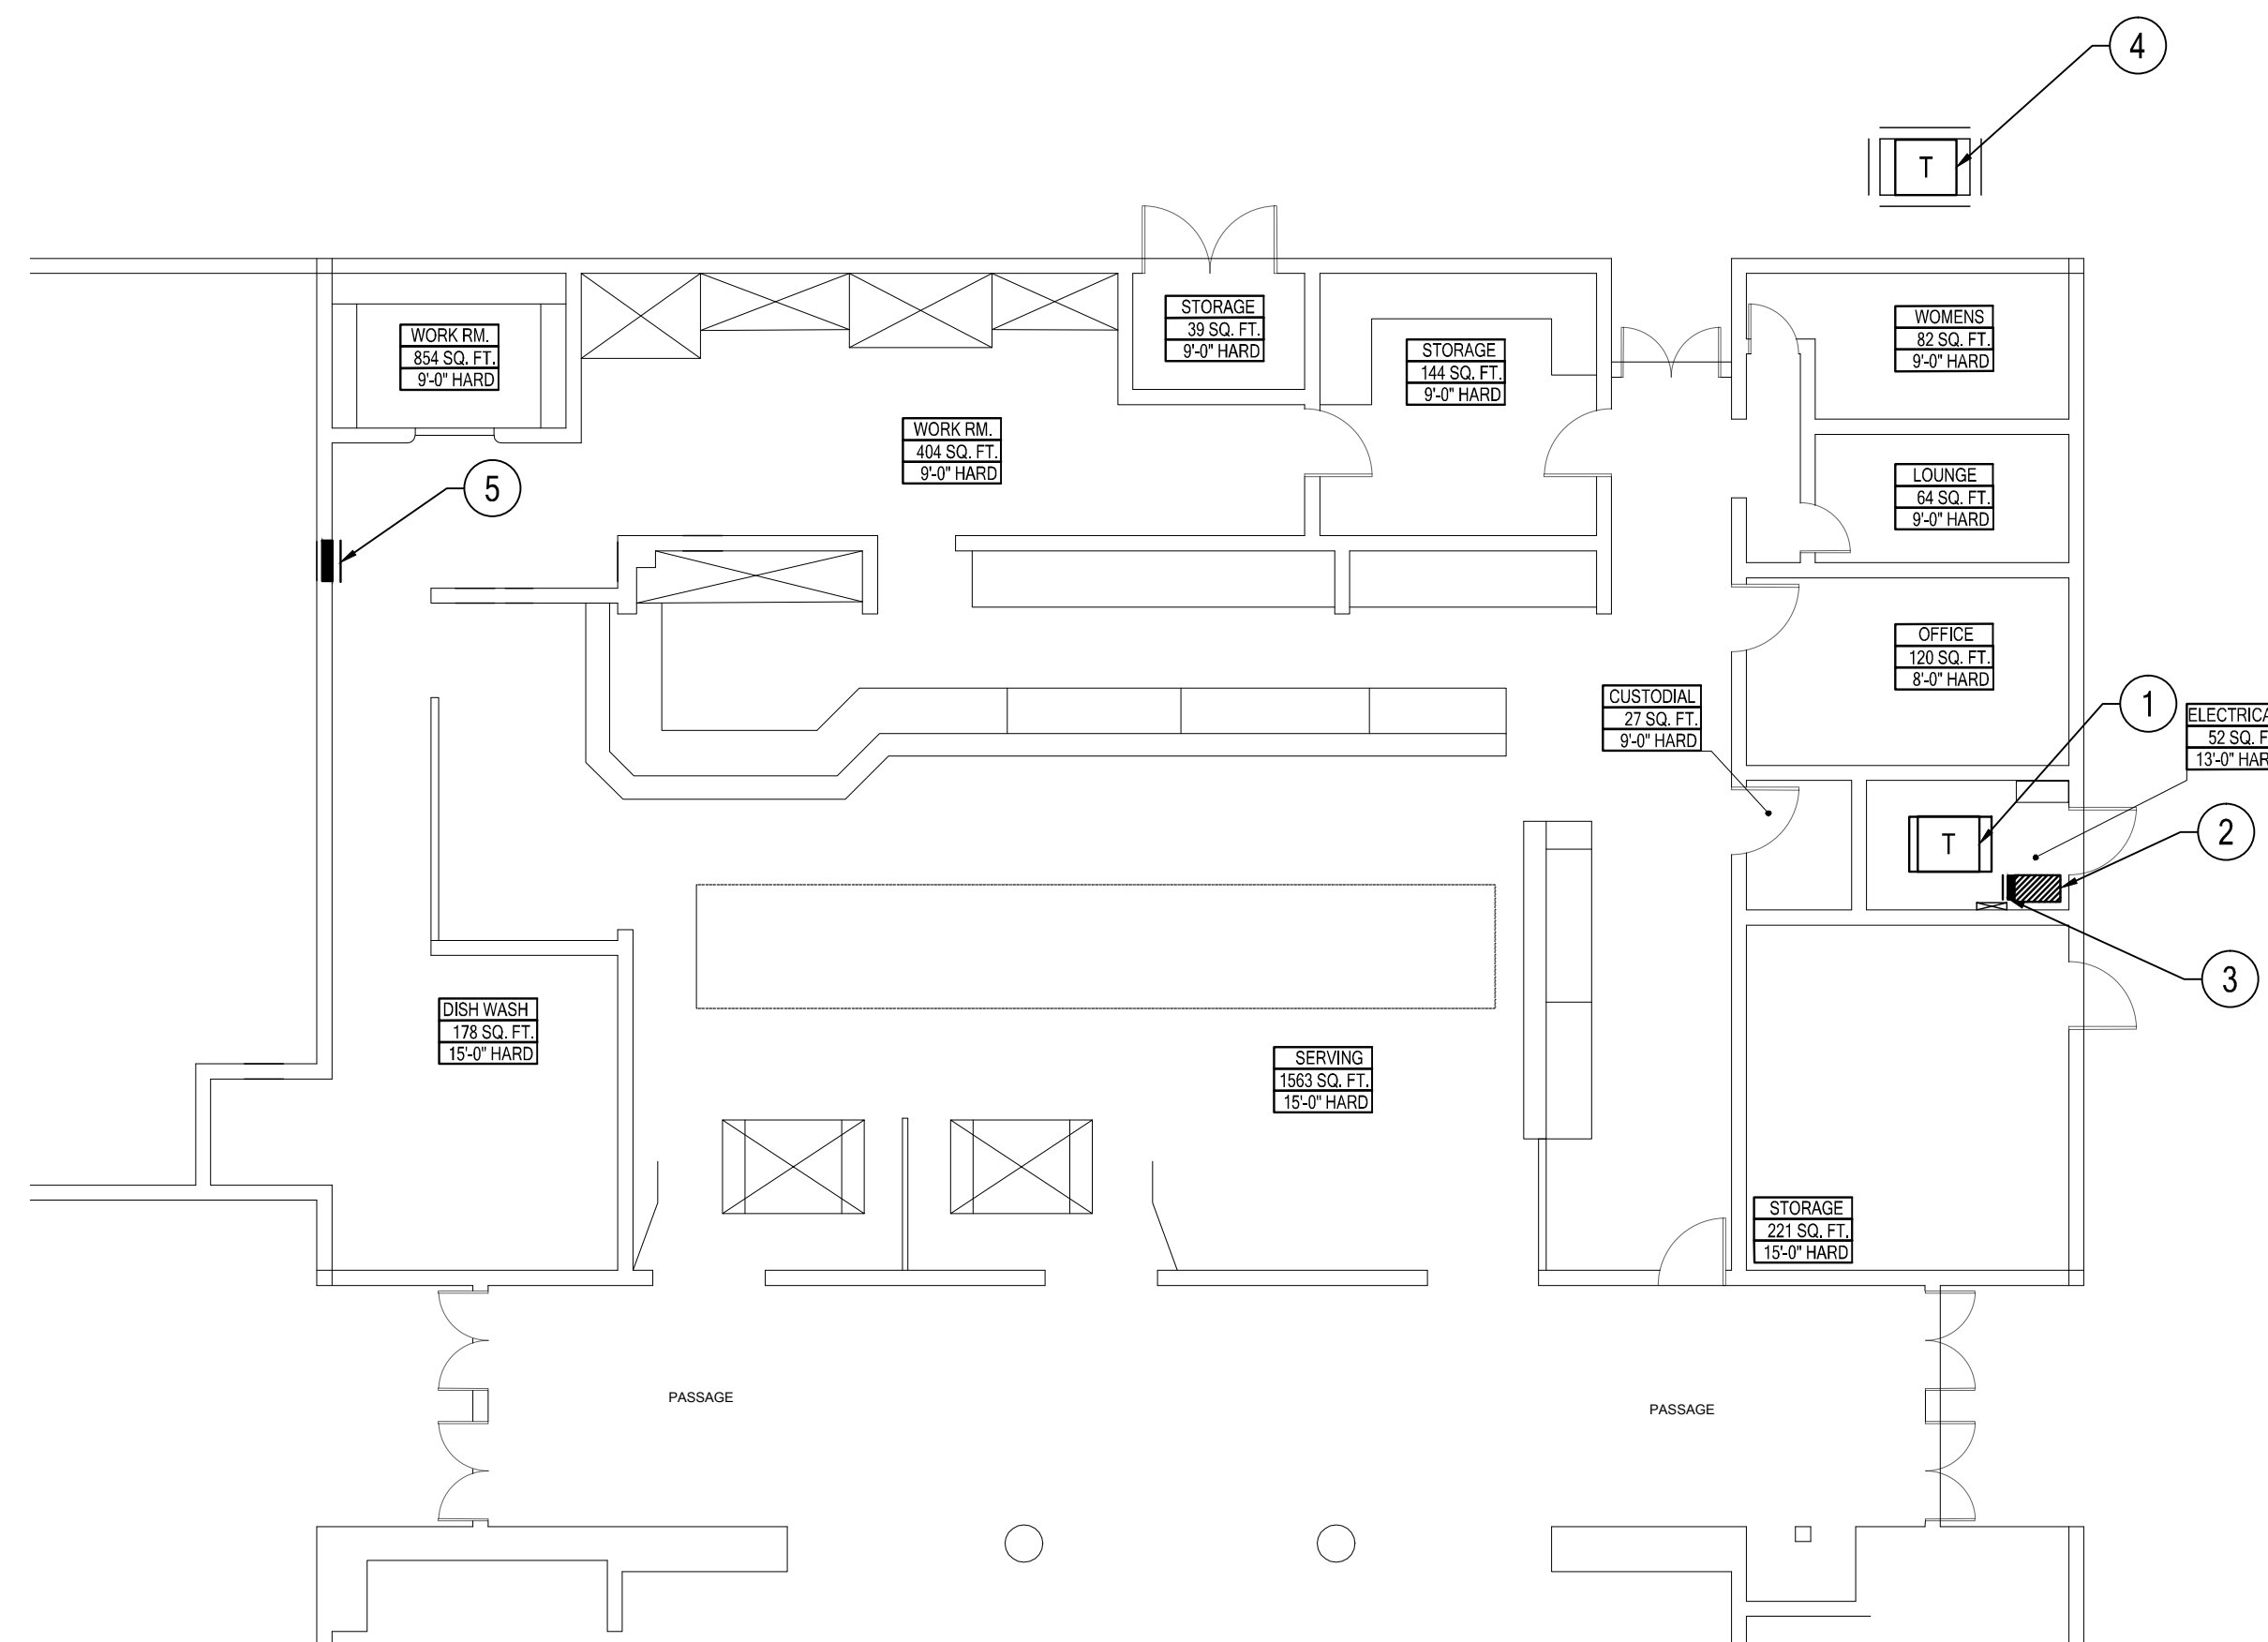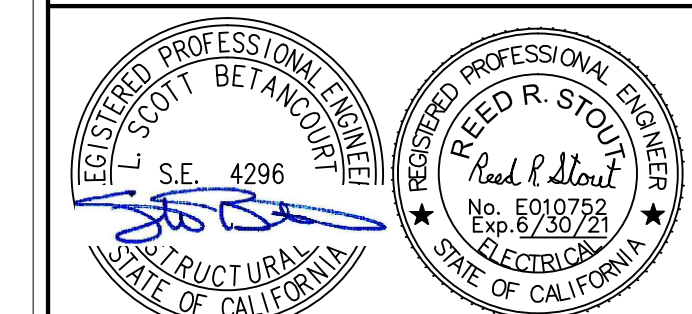

ELECTRICAL FLOOR PLAN NOTES:

- 1 EXISTING TRANSFORMER "TX-DP1" 12KV/240V 100KVA 1 PHASE 3 WIRE.
- 2 EXISTING DISTRIBUTION PANEL "DPM-1" 400A 120/240V 1 PHASE 3 WIRE.
- 3 PANEL "M1C" 100A 120/240V 1 PHASE 3 WIRE. REFER TO SINGLE LINE DIAGRAM.
- 4 EXISTING TRANSFORMER "TX-DP2" 12KV/240V 100KVA 1 PHASE 3 WIRE.
- 5 EXISTING DISTRIBUTION PANEL "DPM2" 400A 120/240V 1 PHASE 3 WIRE.


ELECTRICAL FLOOR PLAN BUILDING "CAFETERIA" 1/8"=1'-0"

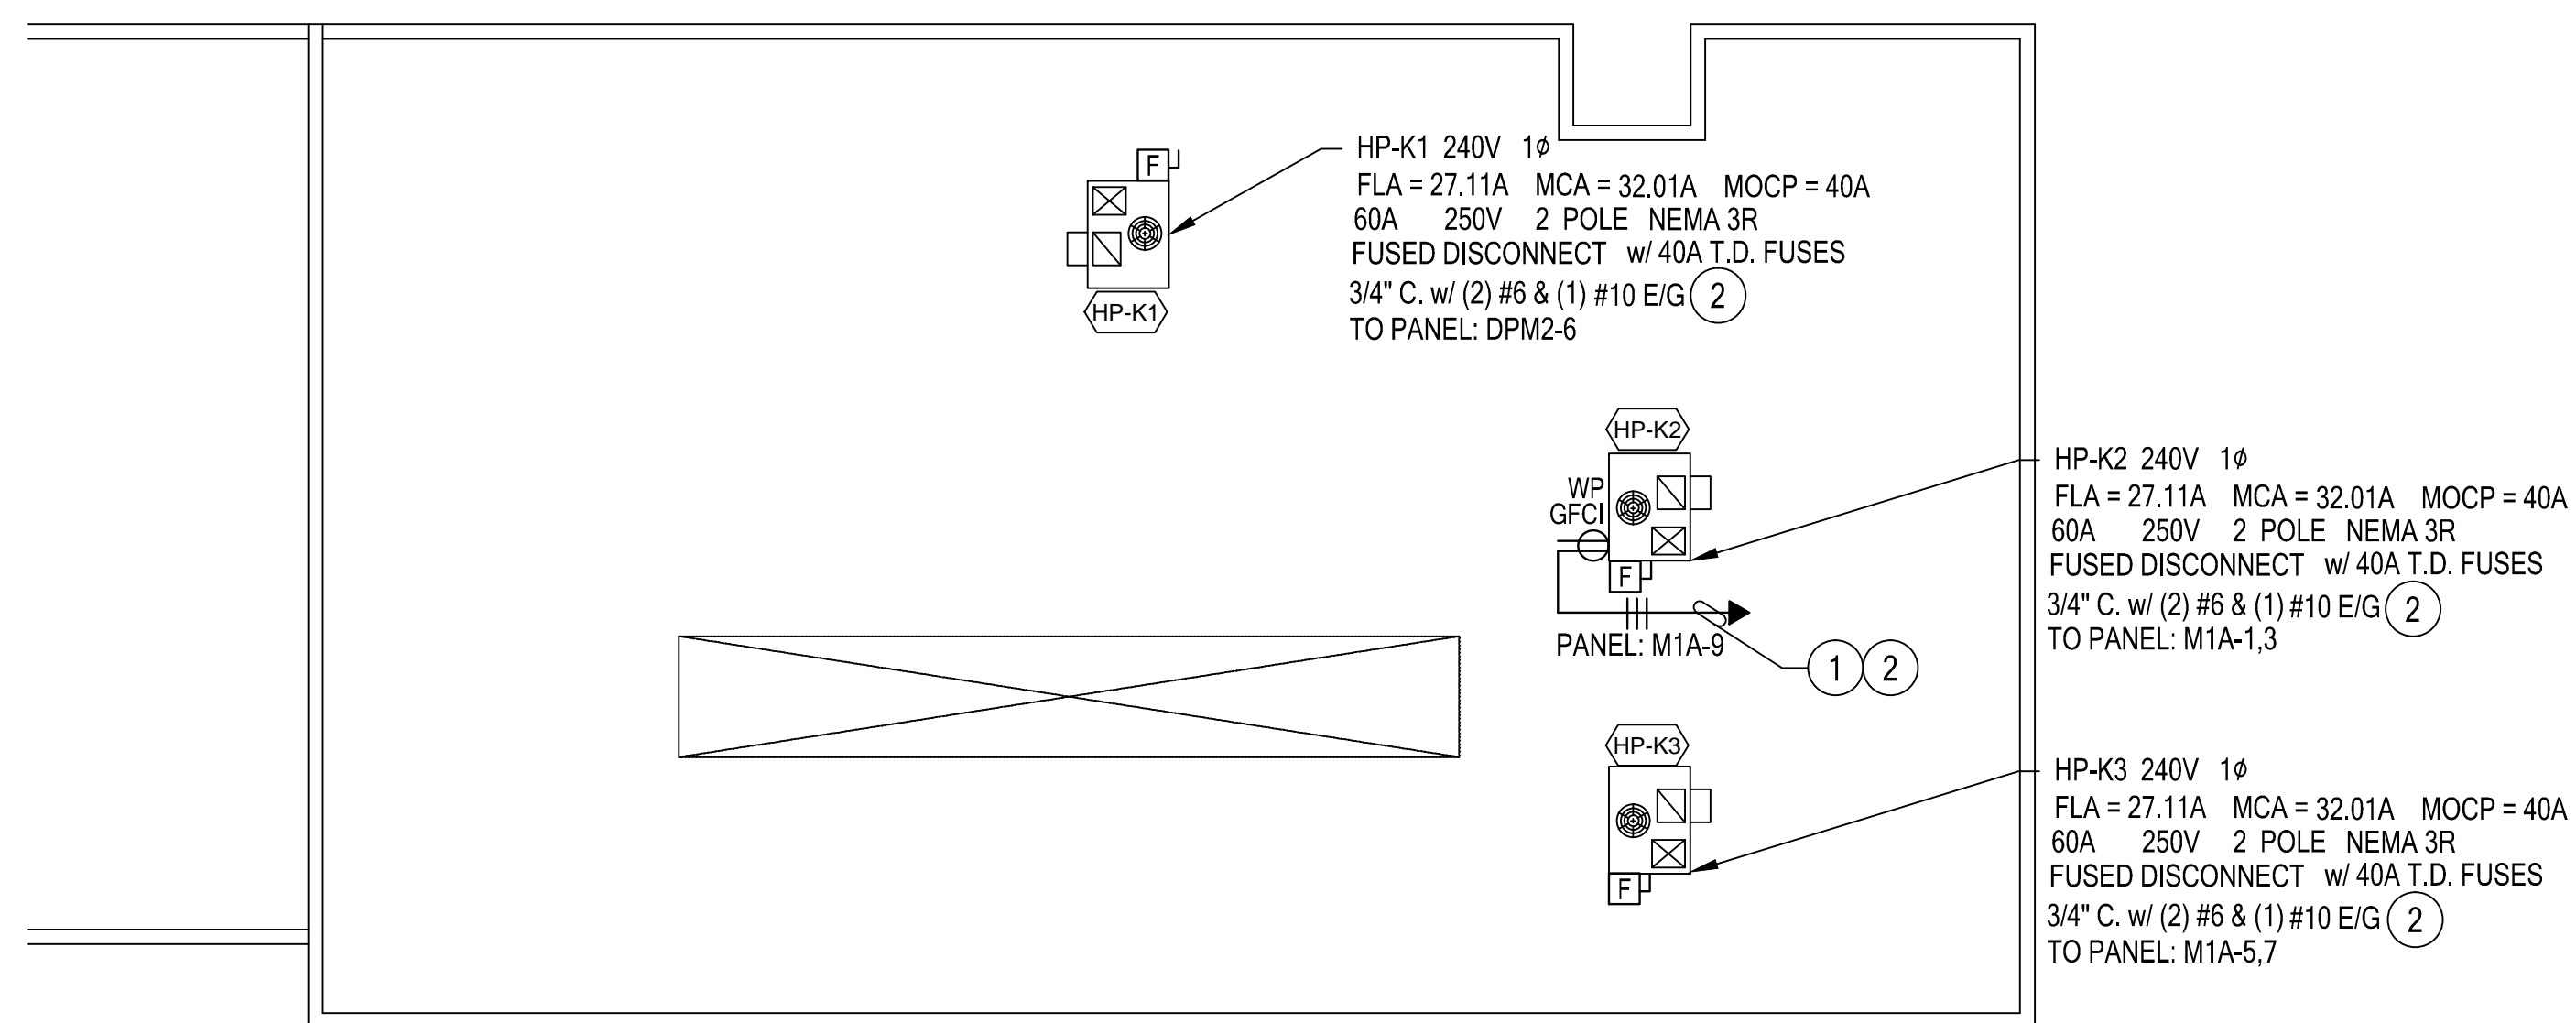

ELECTRICAL ROOF PLAN NOTES:

- 1 3/4" C. w/ (2) #12 & (1) #12 E/G TO PANEL M1A-9.
- 2 ROUTE CONDUIT DOWN THRU ATTIC TO PANELS. REFER TO FLOOR PLAN.

ELECTRICAL ROOF PLAN BUILDING "CAFETERIA" 1/8"=1'-0"

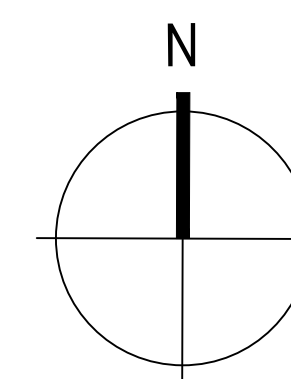

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

NO	DATE	BY	DESCRIPTION
REVISIONS			
DRAWN:	JC	CHECKED:	RFH
DATE:	8/31/2018	SCALE:	AS NOTED
PROJECT NUMBER:	17-301		


**ELECTRICAL
 FLOOR & ROOF
 PLANS**

DRAWING NUMBER : **E1.1**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

FIRE ALARM FLOOR PLAN NOTES:


- 1 FIRE ALARM CONTROL PANEL. REFER TO FIRE ALARM SUBMITTAL. PROVIDE 1/2c. w/ (2) #12 & (1) #12 E/G TO PANEL "M1C-2". PROVIDE LOCK-ON DEVICE AND PAINT BREAKER HANDLE RED.
- 2 FIRE ALARM CONTROL POWER SUPPLY. REFER TO FIRE ALARM SUBMITTAL. PROVIDE 1/2c. w/ (2) #12 & (1) #12 E/G TO PANEL "M1C-4". PROVIDE LOCK-ON DEVICE AND PAINT BREAKER HANDLE RED.
- 3 PANEL "M1C" 100A 120/240V 1 PHASE 3 WIRE. REFER TO SINGLE LINE DIAGRAM.
- 4 1/2" C. w/ (2) #14 TO HVAC UNIT ON ROOF FOR SHUTDOWN UPON FIRE ALARM ACTIVATION. REFER TO MECH. DRAWINGS.
- 5 EXISTING A/C UNIT FOR STUDENT LOUNGE.
- 6 FIRE ALARM ANNUNCIATOR PANEL. REFER TO FIRE ALARM SUBMITTAL. PROVIDE 3/4"C. w/ (1) 4/C #16 & (1) #12 SPEAKER CABLE TO FACP.

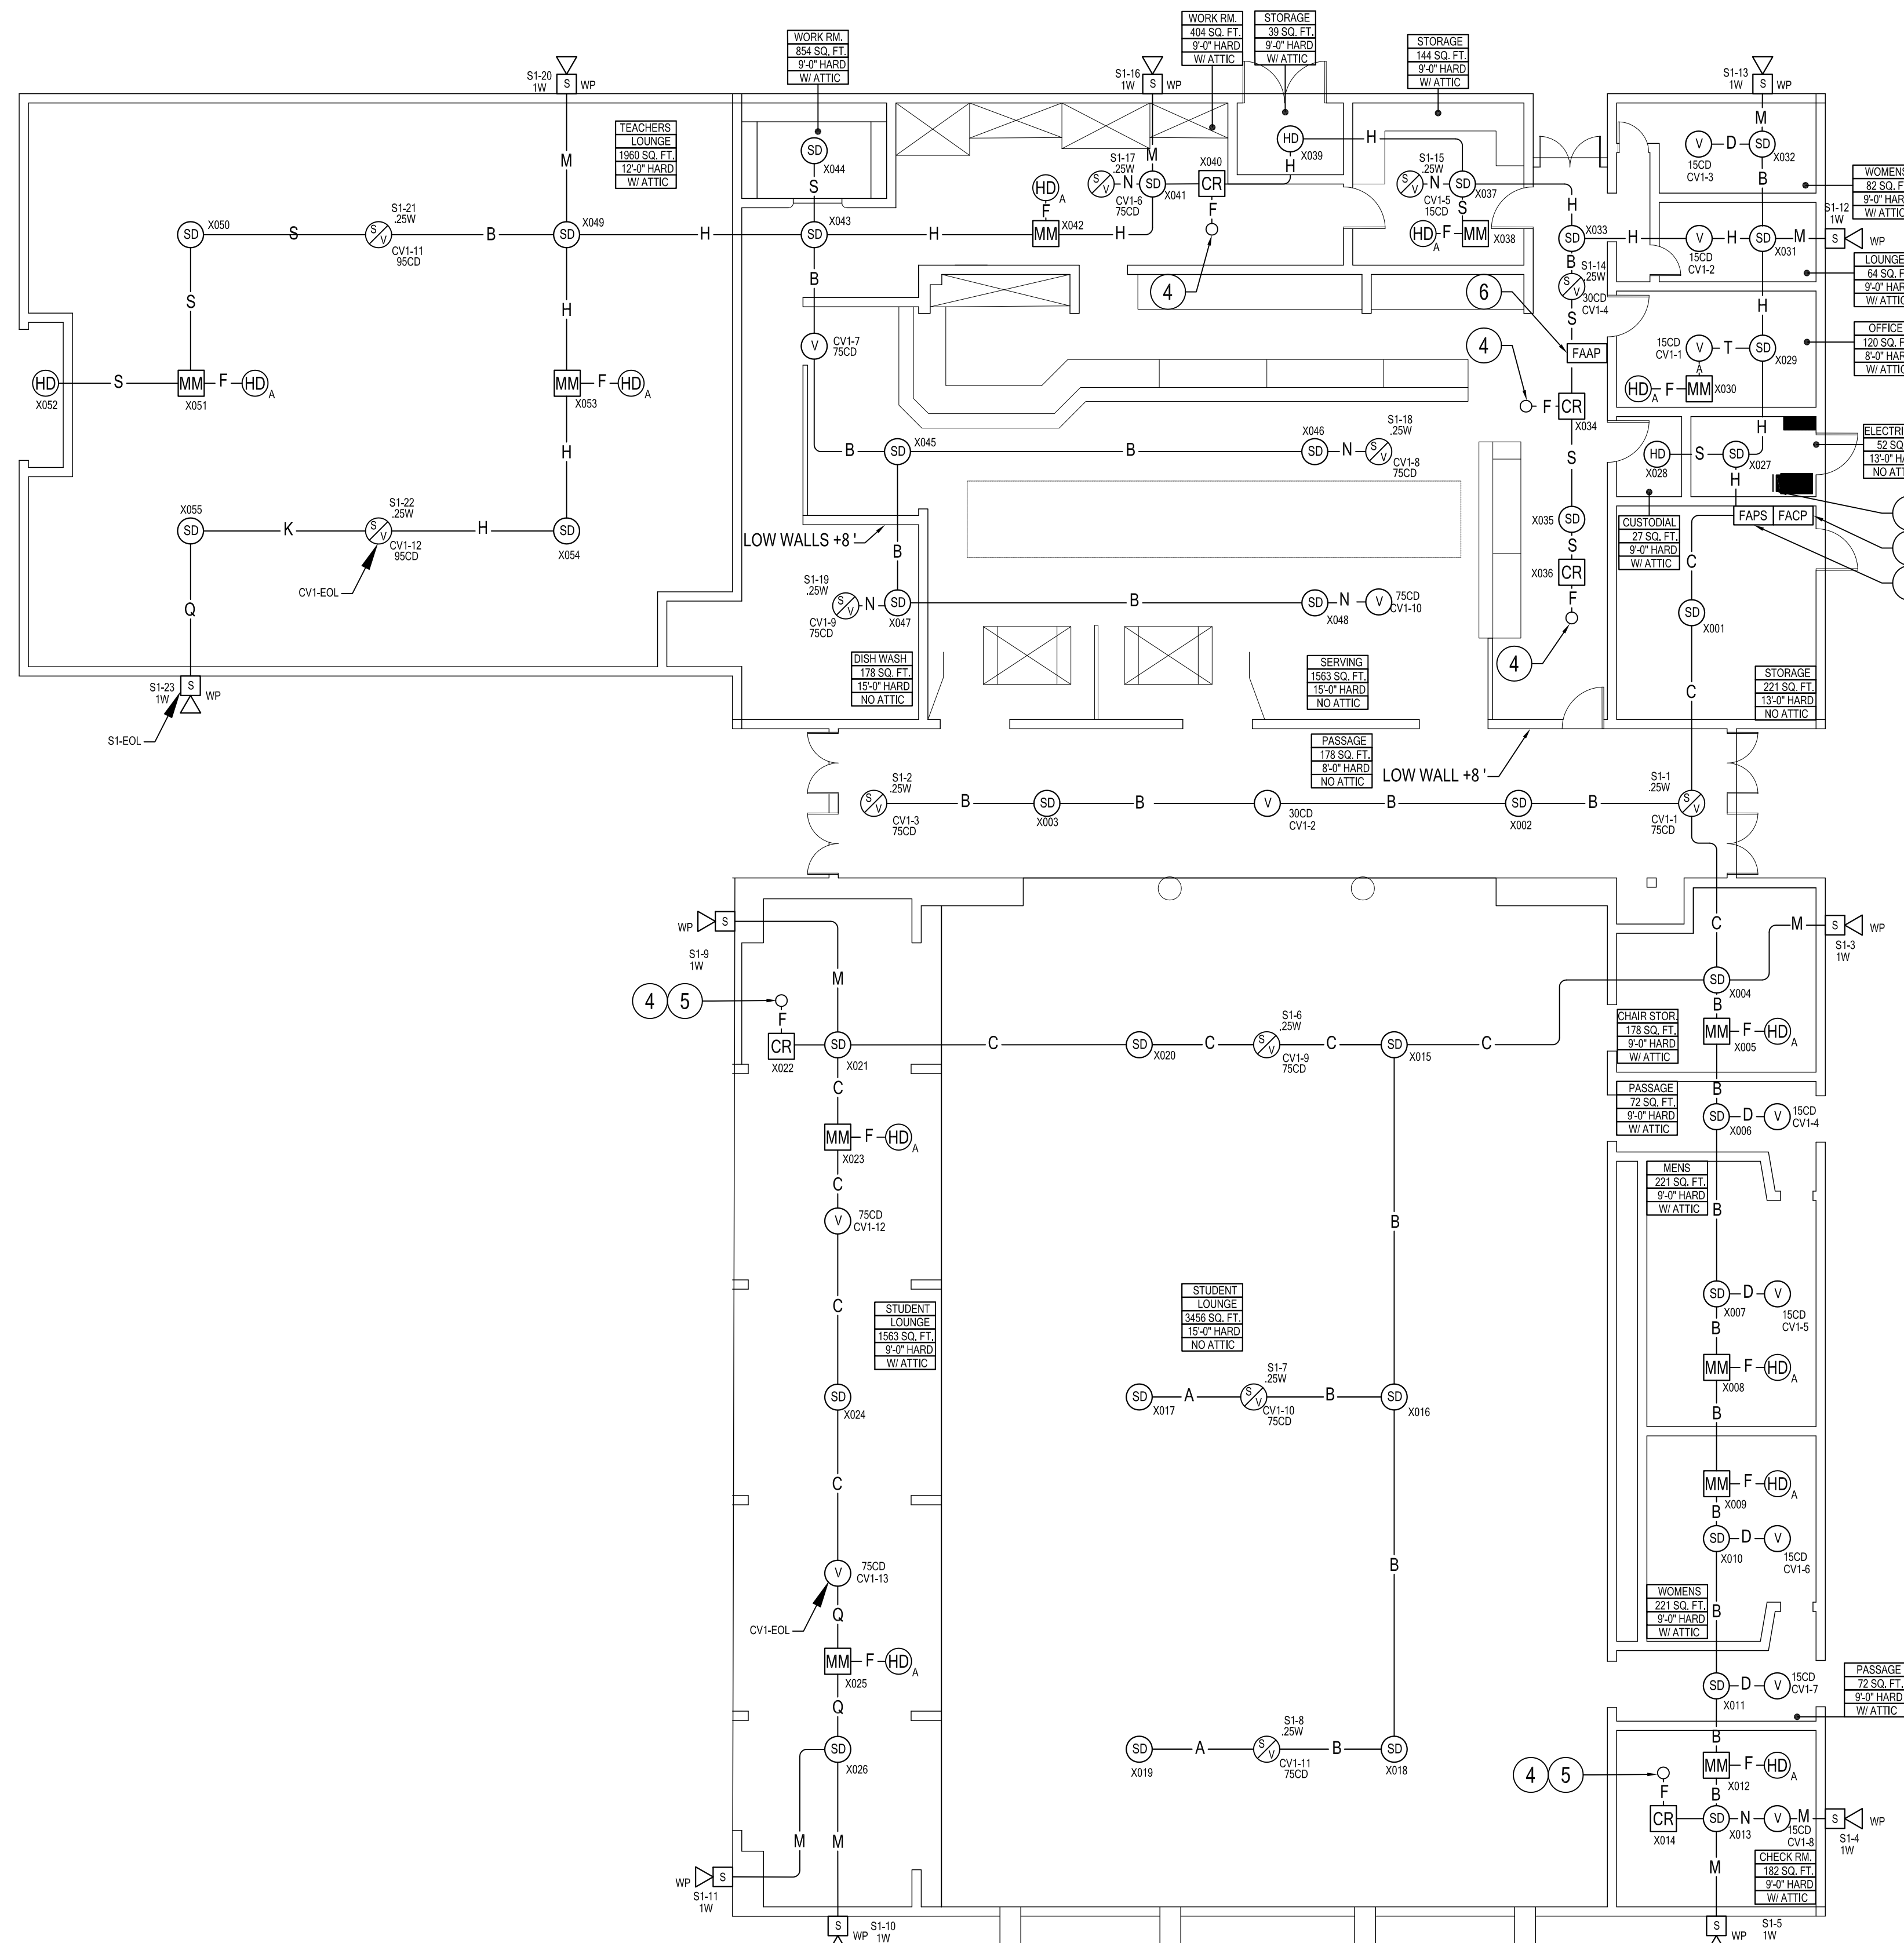

FIRE ALARM WIRING LEGEND

SYMBOL	(3/4" CONDUIT U.O.N.)
—A—	(1) #16 T.P.
—B—	(2) #16 T.P., (2) #16/2 S. & (4) #12
—C—	(2) #16 T.P., (2) #16/2 S. & (2) #12
—D—	(4) #12
—E—	(2) #12
—F—	(2) #14
—G—	(1) #16 T.P., (2) #14
—H—	(1) #16 T.P., (1) #16/2 S. & (2) #12
—J—	(1) #16 T.P. & (2) #12
—K—	(1) #16 T.P., (1) #16/2 S.
—L—	(1) #16 T.P., (4) #12
—M—	(2) #16/2 S.
—N—	(2) #16/2 S. & (4) #12
—P—	(2) #12/2 & (2) #12
—Q—	(2) #16/2 S. & (2) #16 T.P.
—R—	(1) #16/2 S.
—S—	(2) #16 T.P.
—T—	(2) #16 T.P. & (4) #12

FIRE ALARM FLOOR PLAN BUILDING "CAFETERIA" 1/8"=1'-0"

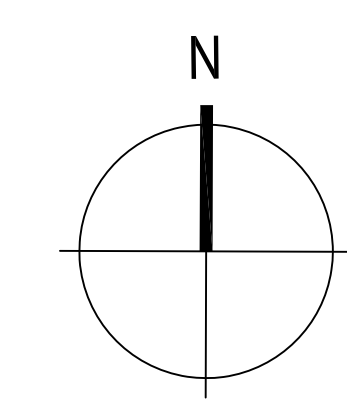

RFHC
 RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rhhawkinsconsulting.com

CONSULTANT
next step
 DESIGN, INC.

26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92650
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 905 09 # 09-28



**HVAC ADDITIONS TO
 CAFETERIA BLDG.**
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221




NO	DATE	BY	DESCRIPTION

REVISIONS

DRAWN: JC	CHECKED: RFH
DATE: 8/31/2018	SCALE: AS NOTED
PROJECT NUMBER: 17-301	

**FIRE ALARM
 FLOOR PLAN**

DRAWING NUMBER : **E2.1**

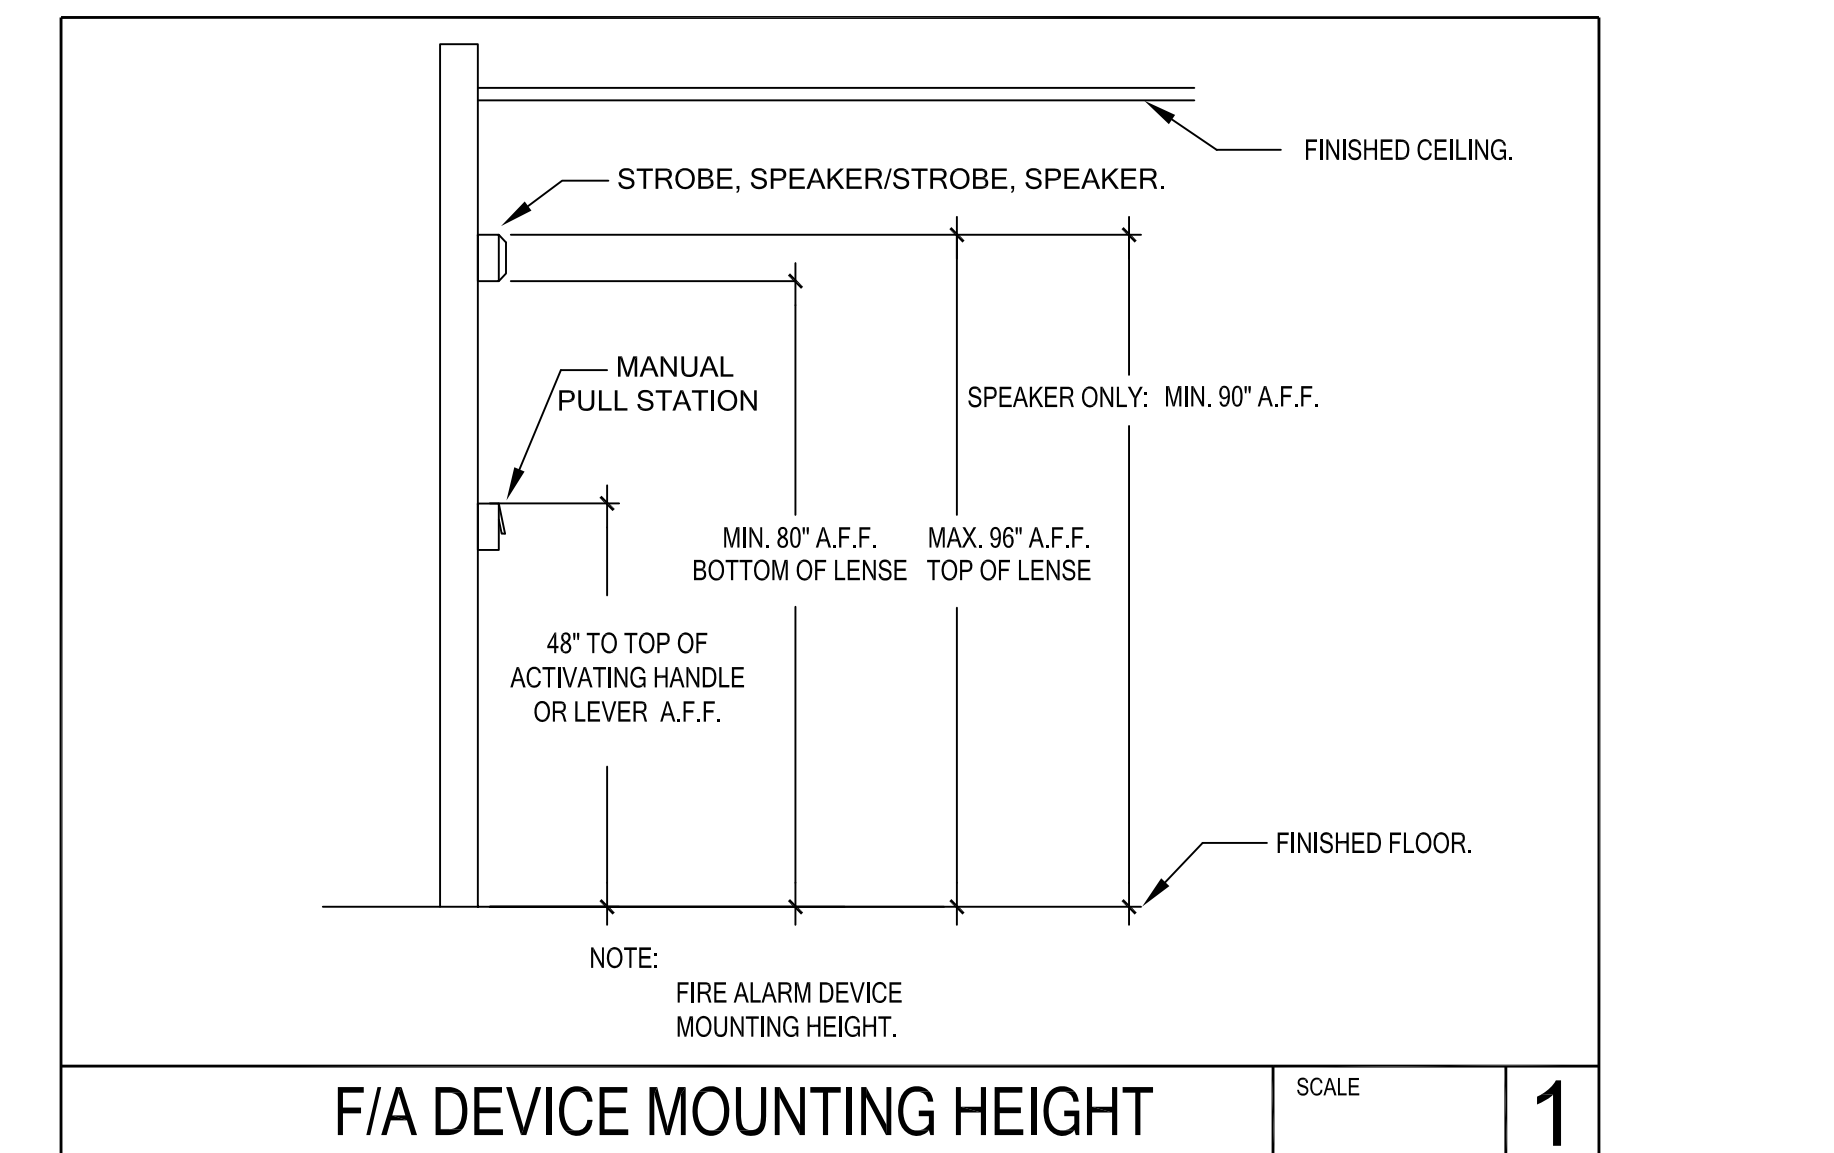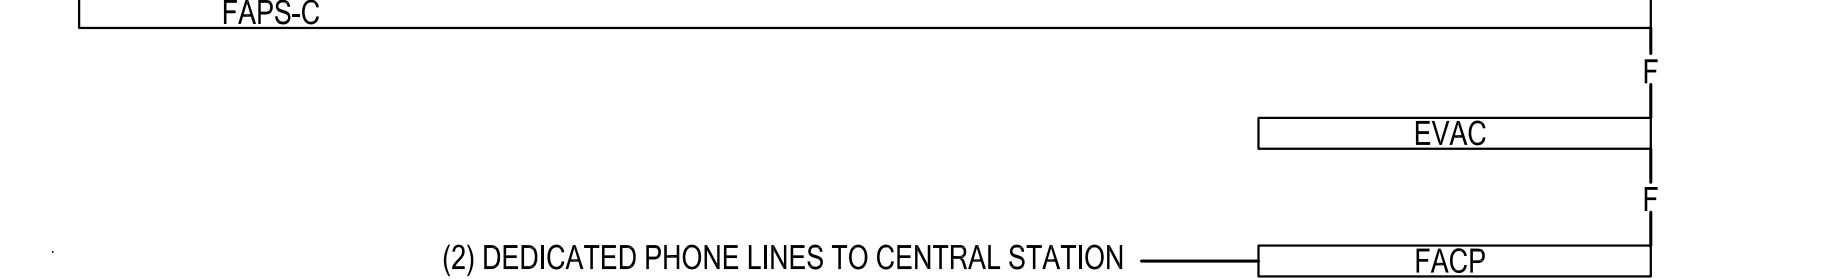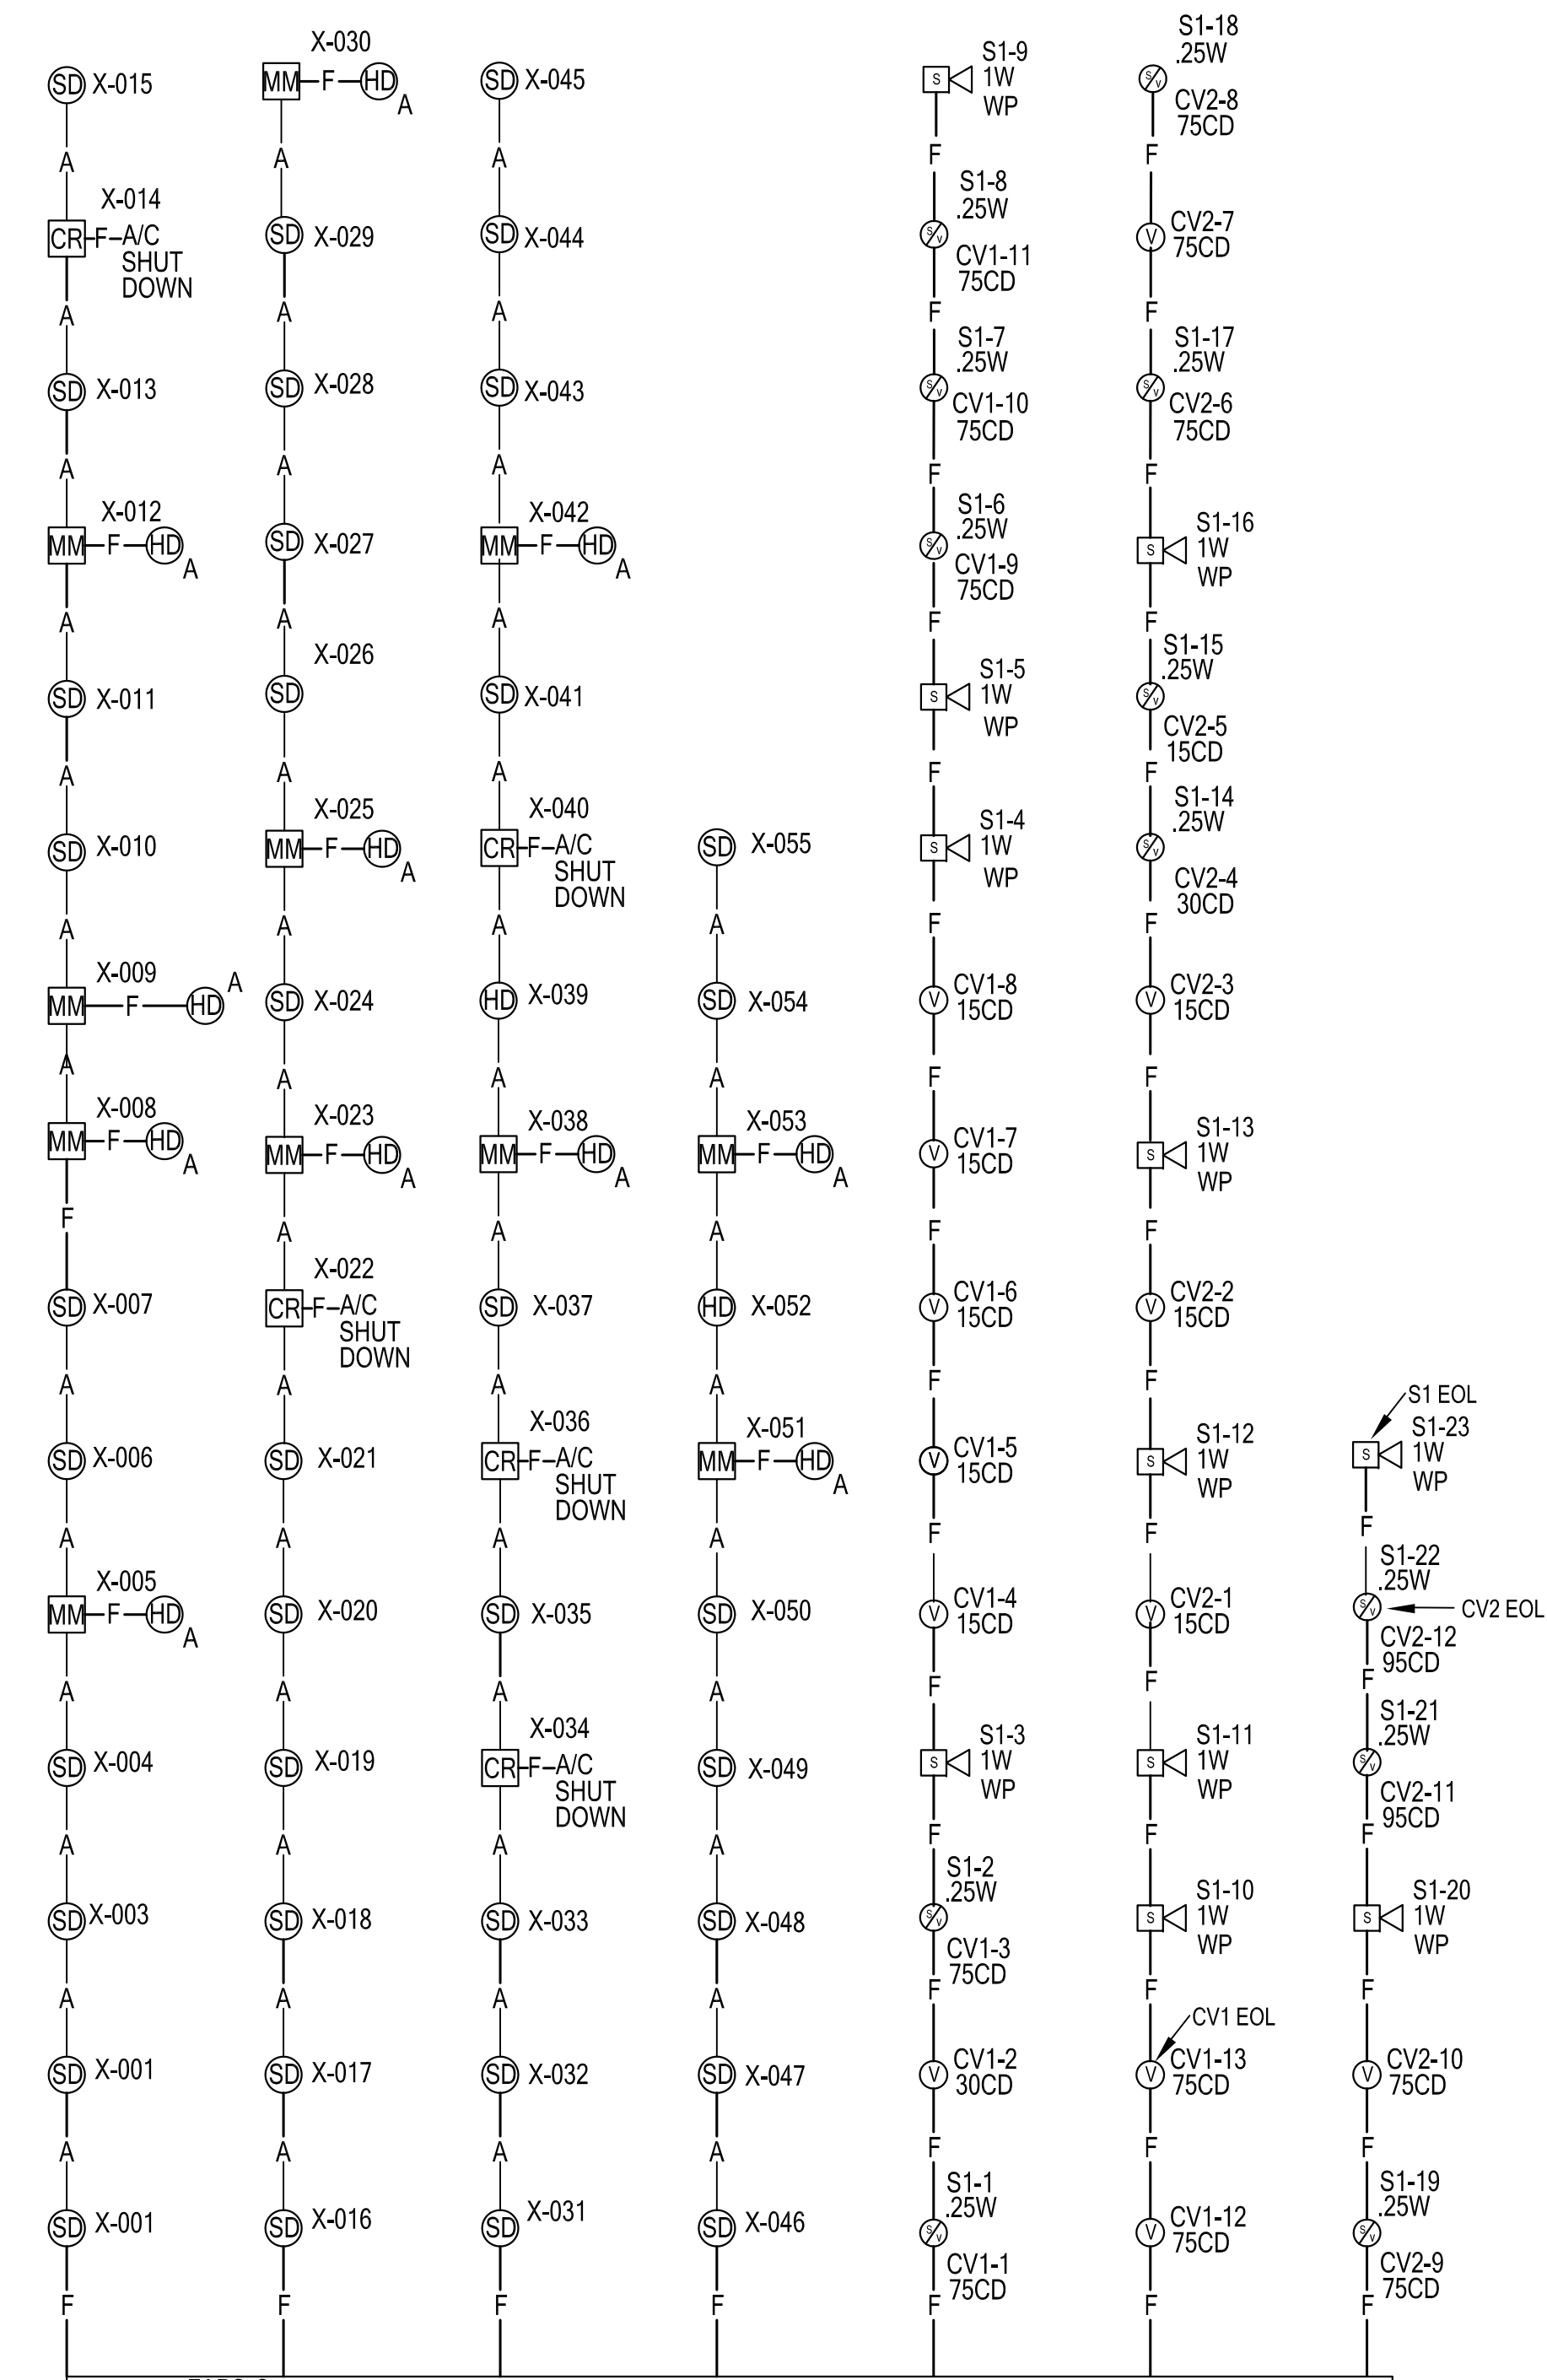

FACP "C" BATTERY CALCULATIONS

ITEM	DESCRIPTION	QTY.	AMPS	TOTAL AMPS
A.	4100 FIRE ALARM CONTROL CIRCUIT BOARD	1	.4450	.4450
B.	4100 UDACT	1	.0400	.0400
C.	4003 EVAC CONTROL PANEL	1	.130	.1300
D.	FIRE ALARM ANNUNCIATOR PANEL	1	.300	.3000
E.	ADDRESSABLE SMOKE DETECTOR	37	.0008	.0296
F.	ADDRESSABLE HEAT DETECTOR	2	.0008	.0016
G.	MONITOR MODULES	11	.0008	.0088
H.	CONTROL MODULES	5	.0008	.0040
I.				
J.				
K.				
L.				
M.				
N.				
STANDBY AMPS TOTAL				.9590 A
24 HR. STANDBY				X 24 HR
STAND BY AHR TOTAL				23.0160 AHR

ITEM	DESCRIPTION	QTY.	AMPS	TOTAL AMPS
A.	4100 FIRE ALARM CONTROL CIRCUIT BOARD	1	.5000	.5000
B.	4100 UDACT	1	.0400	.0400
C.	4003 EVAC CONTROL PANEL	1	.1300	.1300
D.	FIRE ALARM ANNUNCIATOR PANEL	1	.3000	.3000
E.	ADDRESSABLE SMOKE DETECTOR	37	.0010	.0370
F.	ADDRESSABLE HEAT DETECTOR	2	.0010	.0020
G.	MONITOR MODULES	11	.0010	.0110
H.	CONTROL RELAY	5	.0010	.0050
I.	SPEAKERS 25W	12	.0038	.0456
J.	SPEAKERS 1W	11	.0070	.0770
K.	STROBES (REFER TO FAPS-C CALCS.)			
L.	STROBES/STROBES (REFER TO FAPS-C CALCS.)			
M.				
ALARM CONDITION TOTAL AMPS				1.2404
15 MINUTE OPERATION				x .25 HR
SUB TOTAL				.3101 AHR
GRAND TOTAL (STANDBY & ALARM)				23.3261 AHR
(2) BAT-12650 BATTERY USED 50AHR @ 80%				40.0000 AHR
SPARE CAPACITY				16.6739 AHR

FAPS-C BLDG. "C"

BATTERY CALCULATIONS

(8) CEILING STROBES	15 CD (8x .040) =	.320 A
(1) CEILING STROBE	30 CD (1x .053) =	.053 A
(1) CEILING STROBE	75 CD (4x .155) =	.620 A
(1) CEILING SPEAKER/STROBE	15 CD (1x .040) =	.040 A
(1) CEILING SPEAKER/STROBE	30 CD (1x .053) =	.053 A
(8) CEILING SPEAKER/STROBES	75 CD (8x .155) =	1.240 A
(2) CEILING SPEAKER/STROBES	95 CD (2x .248) =	.496 A
TOTAL = 2.822 A		

NAC ALARM (15 MIN.) 2.822 A x .249HR = .702 AHR
 NAC STANDBY (24 HOURS) .070 A X 24HR = 1.6800 AHR

NAC TOTAL STANDBY & ALARM = 5.204 AHR
 (2 X 12.0AHR USED) 12.0 AHR @ 80% = 9.6000 AHR
 9.6000 AHR - 5.2040 AHR = 4.396 AHR SPARE

FAPS-C BLDG. "C"

VOLTAGE DROP (V) ZONE (CV1)

V=IR

I= (5) CEILING STROBES	15 CD (5x .040) =	.200 A
I= (1) CEILING STROBE	30 CD (1x .053) =	.053 A
I= (2) CEILING STROBES	75 CD (2x .155) =	.310 A
I= (5) CEILING SPEAKER/STROBES	75 CD (5x .155) =	.775 A
TOTAL = 1.338 A		

R = $\frac{2.05}{1000} \times 300 = .615 \Omega$
 VD = $1.338A \times .615 \Omega = .883V \div 24V = .037 \% VD$

FAPS-C BLDG. "C"

VOLTAGE DROP (V) ZONE (CV2)

V=IR

I= (3) CEILING STROBES	15 CD (3x .040) =	.120 A
I= (2) CEILING STROBES	75 CD (2x .155) =	.310 A
I= (1) CEILING SPEAKER/STROBE	15 CD (1x .040) =	.040 A
I= (1) CEILING SPEAKER/STROBE	30 CD (1x .053) =	.053 A
I= (3) CEILING SPEAKER/STROBES	75 CD (3x .155) =	.775 A
I= (2) CEILING SPEAKER/STROBES	95 CD (2x .248) =	.496 A
TOTAL = 1.794 A		

R = $\frac{2.05}{1000} \times 385 = 1.304 \Omega$
 VD = $1.794A \times 1.304 \Omega = 2.339V \div 24V = .097 \% VD$

FIRE ALARM GENERAL NOTES:

- NEWSYSTEM IS A SIMPLEX 4100. AUTOMATIC ACTIVATED. ADDRESSABLE POWER LIMITED. 24V DC. SUPERVISED FIRE ALARM SYSTEM WITH SUPPLEMENTAL MANUAL PROTECTION IN COMPLIANCE WITH CALIFORNIA BUILDING CODE SECTION 907. THE 2016 CALIFORNIA ELECTRICAL CODE, 2016 NFPA 72 AND 2016 CALIFORNIA FIRE CODE. INCLUDE ALL PROGRAMMING.
- FIRE ALARM CABLE SPLICES IN UNDERGROUND PULL BOXES ARE ABSOLUTELY PROHIBITED.
- ALL FIRE ALARM CONDUIT SHALL BE 3/4" C. UNLESS NOTED OTHERWISE. ALL FIRE ALARM CONDUCTORS SHALL BE INSTALLED IN AN APPROVED RACEWAY.
- ALL CONDUCTORS SHALL BE #12 THWN 600V FOR ALL ALARM AND FA DEVICE POWER CIRCUITS UNLESS NOTED OTHERWISE.
- ALL CONDUCTORS SHALL BE #18 T.S.P. 600 VOLT FOR ALL INITIATING CIRCUITS UNLESS NOTED OTHERWISE.
- CONTRACTOR SHALL FIELD VERIFY NEW DEVICES AND MATCH EXISTING PRIOR TO ROUGH-IN.
- COLOR CODING OF CONDUCTORS AS RECOMMENDED BY MANUFACTURERS REPRESENTATIVE AND AS INDICATED BELOW:
 FIRE ALARM PULL STATIONS - (1) DARK BLUE (NEG.), (1) ORANGE (POS.)
 FIRE ALARM SMOKE - (1) LT. BLUE (NEG.), (1) YELLOW (POS.)
 FIRE ALARM AUDIBLE - (1) BLACK (NEG.), (1) RED (POS.)
 FIRE ALARM VISUALS - (1) GRAY (NEG.), (1) PINK (POS.)
- UPON COMPLETION OF THE FIRE ALARM SYSTEM INSTALLATION, THE SYSTEM SHALL BE TESTED IN THE PRESENCE OF AND IN A MANNER ACCEPTABLE TO THE DSA/PROJECT INSPECTOR OF RECORD (IOR). THE LOCAL FIRE AUTHORITY SHALL BE NOTIFIED OF DATE AND TIME OF FINAL FIRE ALARM TESTING AND SHALL ASSIST/WITNESS SUCH TESTING WHEN ABLE.
- FIRE ALARM CONTRACTOR SHALL SUPPLY ALL NECESSARY TEST EQUIPMENT TO PERFORM REQUIRED TESTING INCLUDING A "SOUND LEVEL METER" TO CHECK THE ACCEPTABLE LEVELS OF AUDIBLE DEVICES. ALL NORMALLY OCCUPIED AREAS SHALL BE PROVIDED WITH A FIRE ALARM AUDIBLE LEVEL AT 15dba ABOVE AMBIENT NOISE LEVELS. PROVIDE INTELLIGIBILITY TEST FOR ALL AREAS OF COVERAGE.
- FIRE ALARM CONTRACTOR SHALL PERFORM AN "END OF LINE RESISTENCE" TEST IN THE PRESENCE OF THE "IOR" FOR EACH CIRCUIT AND IT SHALL NOT EXCEED 10% OF THE 24 VOLT SYSTEM. EACH COMPONENT IN THE SYSTEM SHALL NOT EXCEED THE LISTED MANUFACTURER'S MINIMUM OPERATING VOLTAGE. THE LOOP RESISTANCE TEST INCLUDES ALL INITIATING AND INDICATING (NOTIFICATION APPLIANCE) CIRCUITS.
- IOR SHALL VERIFY THAT ALL STROBE APPLIANCES FLASH AT A RATE OF NOT EXCEEDING TWO FLASHES PER SECOND, NOR BE LESS THAN ONE FLASH PER SECOND.
- FIRE ALARM CONTRACTOR SHALL PROVIDE ALL TEST RESULTS AND A "RECORD OF COMPLETION" TO THE IOR AFTER COMPLETION OF OPERATIONAL ACCEPTANCE TESTS (2016 NFPA 72, SECTION 10.4.1, SECTION 1-7.2.2 & FIGURE 1-7.2.1) TO THE ARCHITECT, ENGINEER, DSA, PROJECT INSPECTOR (IOR), OWNER AND TO THE LOCAL FIRE AUTHORITY HAVING JURISDICTION.
- EVERY NEW FIRE ALARM SYSTEM SHALL PROVIDE A DOCUMENTATION CABINET, INSTALLED AT THE SYSTEM CONTROL PANEL OR OTHER APPROVED LOCATION. THE DOCUMENTATION CABINET SHALL BE PROMINENTLY LABELED "SYSTEM RECORD DOCUMENTS". ALL RECORD AND TESTING DOCUMENTATION SHALL BE STORED IN THE CABINET. CONTENTS SHALL BE ACCESSIBLE BY AUTHORIZED PERSONNEL ONLY. WHERE CABINET IS INSTALLED IN A LOCATION OTHER THAN THE SYSTEM CONTROL UNIT, ITS LOCATION SHALL BE IDENTIFIED AT THE SYSTEM CONTROL UNIT. SYSTEM DOCUMENTS AS APPLICABLE:
 RECORD DRAWINGS/AS-BUILTS, EQUIPMENT CUT SHEETS AND CSFM LISTINGS
 ALTERNATIVE MEANS AND METHODS, PERFORMANCE BASED DESIGN DOCUMENTATION
 SYSTEM RECORD OF COMPLETION & ANY SUPPLEMENTAL INSPECTION AND TESTING DOCUMENTATION, EMERGENCY RESPONSE PLAN, EVALUATION DOCUMENTATION
 RISK ANALYSIS DOCUMENTATION, SOFTWARE & FIRMWARE CONTROL DOCUMENTATION

SEQUENCE OF OPERATIONS

ACTION	DEVICE	AREA SMOKE DETECTOR	AREA HEAT DETECTOR	A/C POWER FAILURE	LOW BATTERY
SOUND ALARM THROUGHOUT BLDG.		YES	YES	NO	NO
REPORT TO CENTRAL STATION		YES	YES	YES	YES
ANNUNCIATE AT PANEL AND ANNUNCIATOR		YES	YES	YES	YES
CLOSE SMOKE FIRE DAMPERS HVAC SHUTDOWN		YES	YES	YES	YES
TONE FOLLOWED BY VOICE EVACUATION		YES	YES	NO	NO
SOUND TROUBLE BUZZER	ON WIRING FAULT	ON WIRING FAULT		YES	YES

EQUIPMENT LISTING

SYMBOL	MANUFACTURER & MODEL #	DESCRIPTION	CSFM #
[FACP]	SIMPLEX 4100-9114	FIRE ALARM CONTROL PANEL W/ 2 SLC LOOP CARDS, W/ DIGITAL ALARM COMMUNICATOR TRANSMITTER	7165-0026:0251
[EVAC]	SIMPLEX 4003EC	FIRE ALARM VOICE EVAC AMPLIFIER PANEL	6911-0026:0332
[FAPS]	SIMPLEX 4009	FIRE ALARM POWER SUPPLY	7300-0026:0368
[SD]	SIMPLEX 4098-9714 (BASE) 4098-9792	FIRE ALARM PHOTOELECTRIC SMOKE DETECTOR SURFACE CEILING	7272-0026:0218 7300-0026:0217
[HD]	SIMPLEX 4098-9733 (BASE) 4098-9792	FIRE ALARM HEAT DETECTOR DETECTOR SURFACE CEILING	7272-0026:0216 7300-0026:0217
[HD A]	SYSTEM SENSOR 5602	FIRE ALARM HEAT DETECTOR 194 DEG. FIXED "A" INDICATES MOUNTED IN ATTIC	7270-1653:0167
[MM]	IAM 4090-9001	FIRE ALARM MONITOR MODULE SURFACE CEILING	7300-0026:0223
[CR]	IAM 4090-9002	FIRE ALARM CONTROL MODULE SURFACE CEILING	7300-0026:0223
[V ₁₅]	EXCEDER LSTRC3 CANDELA AS NOTED	FIRE ALARM STROBE CEILING MOUNTED	7125-0785:0169
[25W S ₇₅]	EXCEDER LSPSTRC3 CANDELA & WATTS AS NOTED	FIRE ALARM SPEAKER/STROBE CEILING MOUNT	7125-0785:0175
[1W SK WP]	WHEELLOCK ET1010 W/ WBB BACKBOX	FIRE ALARM WEATHERPROOF SPEAKER	7320-0785:0105

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
 RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT

next step
 DESIGN, INC.

26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 REG # 09-28

REGISTERED PROFESSIONAL ENGINEER
 S. SCOTT BELMONT
 No. 4296
 REGISTERED PROFESSIONAL ENGINEER
 Reed R. Stout
 No. 60077A
 REGISTERED PROFESSIONAL ARCHITECT
 STATE OF CALIFORNIA

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

REVISIONS

NO	DATE	BY	DESCRIPTION

DRAWN: JC CHECKED: RFH
 DATE: 8/31/2018 SCALE: AS NOTED
 PROJECT NUMBER: 17-301

FIRE ALARM SUBMITTAL

DRAWING NUMBER: E2.2

LEGEND		
SYMBOL	ABBR.	DESCRIPTION
	-	SUPPLY AIR RISER
	-	RETURN AIR RISER
	-	EXHAUST AIR RISER
	SAG	SUPPLY AIR GRILLE
	RAG	RETURN AIR GRILLE
	EAG	EXHAUST AIR GRILLE
	SWR	SIDEWALL REGISTER
	(L)	LINED DUCTWORK
	-	FLEXIBLE CONNECTION
	FC	FLEXIBLE CONNECTION
	-	NEW DUCT (SEE PLAN)
	MVD	MANUAL VOLUME DAMPER
	BDD	BACKDRAFT DAMPER
	UC	UNDERCUT DOOR 3/4"
	SFD	SMOKE / FIRE DAMPER
	FD	FIRE DAMPER
	T-STAT	THERMOSTAT
	S	SWITCH
	W	WITH
	SM	SHEET METAL
	G.C.	GENERAL CONTRACTOR
	VTR	VENT THRU ROOF
	O/C	ON CENTER
	E	ITEMS FURNISHED AND INSTALLED BY THE ELECTRICAL CONTRACTOR AS SPECIFIED ON THE ELECTRICAL CONTRACT DOCUMENTS
	M	ITEMS FURNISHED AND INSTALLED BY THE MECHANICAL CONTRACTOR AS SPECIFIED ON THE MECHANICAL CONTRACT DOCUMENTS
	EM	ITEMS FURNISHED BY ELECTRICAL CONTRACTOR AND INSTALLED BY MECHANICAL CONTRACTOR
	ME	ITEMS FURNISHED BY MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR

GENERAL NOTES

- ENTIRE INSTALLATION SHALL CONFORM TO THE REQUIREMENTS OF THE 2016 CALIFORNIA MECHANICAL CODE, 2016 CALIFORNIA BUILDING CODE, AND ALL OTHER APPLICABLE CODES AND REGULATIONS, INCLUDING 2016 CALIFORNIA ENERGY CONSERVATION STANDARDS DIVISION T-24.
- COORDINATE ENTIRE INSTALLATION OF THE HVAC SYSTEM WITH THE WORK OF ALL OTHER TRADES PRIOR TO ANY FABRICATION OR INSTALLATION. PROVIDE ALL FITTINGS, OFFSETS, AND TRANSITIONS AS REQUIRED FOR A COMPLETE WORKABLE INSTALLATION. THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE ITEMS TO BE PROVIDED BY OTHER TRADES WHERE MENTIONED IN THE CONTRACT DOCUMENTS PRIOR TO BID - NO EXCEPTIONS.
- COORDINATE THE LOCATIONS OF ALL CEILING DIFFUSERS, REGISTERS AND GRILLES WITH THE ARCHITECTURAL REFLECTIVE CEILING PLAN, ELECTRICAL LIGHTING LAYOUT AND ARCHITECTURAL ROOM ELEVATIONS. THE ARCHITECT AND ENGINEER SHALL BE IMMEDIATELY NOTIFIED OF ANY CONFLICTS PRIOR TO FABRICATION AND INSTALLATION.
- ALL EQUIPMENT, DUCTS, PIPING, AND OTHER DEVICES AND MATERIALS INSTALLED OUTSIDE OF THE BUILDING OR OTHERWISE EXPOSED TO THE WEATHER SHALL BE COMPLETELY WEATHER-PROOFED AND PAINTED TO MATCH, COORDINATE WITH ARCHITECT PRIOR TO PAINTING.
- ALL DIMENSIONS SHOWN ON THESE PLANS ARE APPROXIMATE AND MUST BE CONFIRMED ON SITE.
- PRIOR TO OCCUPANCY, THE ENTIRE H.V.A.C. SYSTEMS SHALL BE BALANCED IN ACCORDANCE WITH "AABC" OR "NEEB" STANDARDS BY AN INDEPENDENT THIRD PARTY AIR BALANCE CONTRACTOR MEMBER OF "AABC" OR "NEEB". CERTIFICATION SHALL BE PROVIDED BY THE CONTRACTOR FOR AIR AND HYDRONIC AS APPLICABLE. SYSTEMS SHALL BE BALANCED AS INDICATED ON PLANS INCLUDING FRESH AIR VENTILATION. WHERE THERE IS A CONFLICT WITH THE MECHANICAL PLANS, THE AIR BALANCE CONTRACTOR SHALL NOTIFY THE ENGINEER PRIOR TO BALANCING SYSTEM. IF NOT THE AIR BALANCE CONTRACTOR SHALL BEAR ALL COSTS INCURRED FOR WORK THAT MUST BE RE-BALANCED DUE TO CONFLICTS ON CONTRACT DOCUMENTS. CONTRACTOR SHALL PROVIDE THREE COPIES OF THE AIR BALANCE REPORT TO THE ENGINEER FOR APPROVAL.
- FOR INACCESSIBLE AREAS THE CONTRACTOR SHALL PROVIDE ACCESS PANELS TO ALL DAMPERS, EQUIPMENT, SMOKE DETECTORS, AND CONTROL DEVICES. THESE PANELS SHALL MATCH THE RATING OF THE WALL AND/OR CEILING THAT THEY ARE LOCATED IN. MINIMUM ACCESS PANEL SIZES SHALL BE AS FOLLOWS:
 - HAND ACCESS: 12"x12".
 - BODY ACCESS: 30"x30" MIN. WHERE A LARGER ACCESS SIZE IS REQUIRED DUE TO INSTALLATION CONSTRAINTS, THE CONTRACTOR SHALL DO SO AT NO ADDITIONAL COST AND SHALL NOTIFY THE ARCHITECT AND ENGINEER OF DEVIATIONS PRIOR TO INSTALLATION.
- COORDINATE THE LOCATION OF ALL ROOF OPENINGS AND THE LOCATION OF ALL ROOF MOUNTED EQUIPMENT WITH THE STRUCTURAL AND ARCHITECTURAL PLANS PRIOR TO ANY INSTALLATION.
- PLATFORMS, CURBS, AND FLASHINGS FOR MECHANICAL EQUIPMENT SHALL BE AS INDICATED ON THE STRUCTURAL AND ARCHITECTURAL PLANS, UNLESS NOTED OTHERWISE. WHERE THERE IS A CONFLICT WITH THE MECHANICAL PLANS, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT AND ENGINEER PRIOR TO FABRICATION AND INSTALLATION.
- ALL EQUIPMENT, ACCESSORIES, AND RELATED PIPING SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE EQUIPMENT MANUFACTURER'S RECOMMENDATIONS. PROVIDE ALL FITTINGS, TRANSITIONS, DAMPERS, VALVES, AND OTHER DEVICES REQUIRED FOR A COMPLETE WORKABLE INSTALLATION.
- MAINTENANCE LABEL SHALL BE AFFIXED TO ALL MECHANICAL EQUIPMENT AND A MAINTENANCE MANUAL SHALL BE PROVIDED FOR THE OWNER'S USE.
- PROVIDE MERV 13 MIN. EFFICIENCY THROWAWAY FILTERS FOR ALL AIR CONDITIONING UNITS. SEE EQUIPMENT SCHEDULE AND SPECIFICATIONS FOR TYPE. SIZES SHALL BE AS RECOMMENDED BY THE MANUFACTURER, UNLESS OTHERWISE SPECIFIED.
- AIR FILTERS SHALL BE STATE FIRE MARSHALL APPROVED AND LISTED. PREFORMED FILTERS HAVING COMBUSTIBLE FRAMING SHALL BE TESTED AS A COMPLETE ASSEMBLY. AIR FILTERS SHALL BE ACCESSIBLE FOR CLEANING OR REPLACEMENT.
- ALL EQUIPMENT WITH MOVING PARTS SHALL BE PROVIDED WITH FLEXIBLE DUCT AND PIPE CONNECTION.
- ALL HVAC EQUIPMENT SHALL BE CERTIFIED BY THE CALIFORNIA ENERGY COMMISSION TO COMPLY WITH LATEST EFFICIENCY STANDARDS.
- AC UNITS PROVIDED WITH ECONOMY CYCLE DAMPERS SHALL HAVE DAMPERS SET UP TO CLOSE AUTOMATICALLY ON FAN SHUTDOWN.
- PROVIDE MANUAL VOLUME DAMPERS AND BACKDRAFT DAMPERS FOR FRESH AIR INTAKES ON ALL AIR HANDLING EQUIPMENT AND EXHAUST FANS SERVING CONDITIONED SPACES. EXCEPTION: EQUIPMENT WITH FACTORY ECONOMIZERS.
- ALL FRESH AIR INTAKES SHALL MEET CODE REQUIRED CLEARANCES FROM EXHAUST, FLUE, FUEL BURNING APPLIANCE AND PLUMBING VENT OUTLETS. FOR GAS/ELECTRIC AIR CONDITIONING UNITS WHERE THE CODE REQUIRED CLEARANCES ARE NOT MET, A FACTORY FLUE GAS DEFLECTOR AND EXTENSION SHALL BE USED TO MINIMIZE THESE CLEARANCES. CONTRACTOR SHALL DETERMINE LOCATIONS WHERE REQUIRED PRIOR TO BID. THIS SHALL BE PROVIDED AT NO ADDITIONAL COST.
- ALL AIR HANDLING EQUIPMENT SERVING CONDITIONED SPACES SHALL PROVIDE CONTINUOUS FRESH AIR TO SPACES IN OCCUPIED MODE.
- CONTRACTOR SHALL VERIFY ALL CLEARANCES AND AVAILABLE SPACE FOR DUCTWORK PRIOR TO ORDERING AND / OR FABRICATING MATERIAL.
- CONTRACTOR TO SUBMIT ALL EQUIPMENT, DUCTWORK, AIR DISTRIBUTION DEVICES, AND OTHER ACCESSORIES TO THE ENGINEER FOR APPROVAL PRIOR TO ANY ANY ORDERING OF SUCH ITEMS.
- CONTRACTOR SHALL BE RESPONSIBLE FOR COMMISSIONING OF EQUIPMENT AS STIPULATED ON MECH-1-C FORM ON PLANS UNLESS NOTED OTHERWISE.
- PAINT EXPOSED SURFACE, WHETHER OR NOT COLORS ARE DESIGNATED IN SCHEDULES, EXCEPT WHERE A SURFACE OR MATERIAL IS SPECIFICALLY INDICATED NOT TO BE PAINTED OR IS TO REMAIN NATURAL WHERE AN ITEM OR SURFACE IS NOT SPECIFICALLY MENTIONED. PAINT THE SAME AS SIMILAR ADJACENT MATERIALS OR SURFACES. IF COLOR OR FINISH IS NOT DESIGNATED, THE OWNER'S REPRESENTATIVE WILL SELECT FROM STANDARD COLORS OR FINISHES AVAILABLE.

1. PAINTING INCLUDES FIELD PAINTING EXPOSED BARE AND COVERED PIPES AND DUCTS (INCLUDING COLOR CODING), HANGERS, EXPOSED STEEL AND IRON WORK, AND PRIMED METAL SURFACES OF MECHANICAL AND ELECTRICAL EQUIPMENT.
- NOT USED.
- ALL LINE AND LOW VOLTAGE WIRING SHALL BE INSTALLED IN CONDUIT. ALL LINE VOLTAGE CONDUIT AND WIRING, INCLUDING FINAL CONNECTIONS, SHALL BE FURNISHED AND INSTALLED BY THE ELECTRICAL CONTRACTOR AS INDICATED ON THE ELECTRICAL DRAWINGS OR SPECIFIED IN THE ELECTRICAL SECTION OF THE SPECIFICATIONS. ALL ELECTRICAL WORK SHALL BE INSTALLED IN ACCORDANCE WITH ALL APPLICABLE CODES AND REGULATIONS OF ALL GOVERNING BODIES HAVING JURISDICTION THEREOF.
- ALL LOW VOLTAGE CONDUIT AND WIRING AS APPLICABLE, INCLUDING FINAL CONNECTIONS, SHALL BE FURNISHED AND INSTALLED BY THE MECHANICAL CONTRACTOR AS INDICATED ON MECHANICAL DRAWINGS OR SPECIFIED IN THE MECHANICAL SECTION OF THE SPECIFICATIONS.
 - ALL LOW VOLTAGE WIRING SHALL BE INSTALLED IN CONDUIT.
 - WHERE THE CONTROLS CONTRACTOR IS RETAINED THEY SHALL BE RESPONSIBLE FOR THE FOLLOWING:
 - FURNISH AND INSTALL ALL DEVICES, WIRING, AND TERMINATIONS REQUIRED FOR A COMPLETE AND FUNCTIONAL INSTALLATION.
 - COORDINATE ALL WORK AND REQUIREMENTS WITH OTHER TRADES INCLUDING GENERAL, MECHANICAL, AND ELECTRICAL CONTRACTORS PRIOR TO BID.
 - CONTRACTOR SHALL FOLLOW ALL SUBMITTAL REQUIREMENTS PER DRAWINGS AND SPECIFICATIONS
 - ALL CONTROL WIRING SHALL BE INSTALLED IN MIN. 3/4" CONDUIT.
- ELECTRICAL CONTRACTOR SHALL PROVIDE REQUIRED RELAY ACCESSORIES FOR CONNECTION OF 120 VOLT, 1 PHASE VENTILATING EQUIPMENT TO 277 VOLT, 1 PHASE LIGHTING AS APPLICABLE.
- NOT USED.
- NOTES:
 - THERMOSTATS THAT ARE PART OF ANY ENERGY MANAGEMENT SYSTEM SHALL FOLLOW CONTROL SPECIFICATIONS AND DRAWING REQUIREMENTS.
 - SHOULD THE LOCATION OF THE THERMOSTAT NOT MEET THE ADA HEIGHT REQUIREMENTS DUE TO OBSTRUCTIONS, THEN AN ALTERNATE LOCATION SHALL BE PROPOSED OR REQUESTED BY CONTRACTOR THAT SHALL BE APPROVED BY THE ENGINEER AND ARCHITECT.
- LINE VOLTAGE THERMOSTATS SHALL BE FURNISHED BY THE MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR.
- CONTROLS CONTRACTOR AND AIR BALANCE CONTRACTOR SHALL COORDINATE WORK AND PERFORM NECESSARY TASKS AS REQUIRED TO OBTAIN AIR AND WATER FLOW QUANTITIES FOR SYSTEMS SHOWN HEREIN.
- CONTROLS SHALL BE PROVIDED TO PROVIDE THE MINIMUM RATE OF OUTDOOR AIR REQUIRED BY THE STATE ENERGY REGULATIONS.

AIR DISTRIBUTION

- ALL DUCTWORK SHALL BE SHEET METAL CONSTRUCTED OR SPIRAL, ERECTED, AND TESTED IN ACCORDANCE WITH THE MOST RESTRICTIVE OF LOCAL REGULATIONS, PROCEDURES DETAILED IN THE ASHRAE HANDBOOK OF FUNDAMENTALS, CHAPTER 6 OF UNIFORM MECHANICAL CODE, OR THE APPLICABLE STANDARDS ADOPTED BY THE SHEET METAL AND AIR CONDITIONING CONTRACTORS NATIONAL ASSOCIATION.
- ALL FLEXIBLE DUCTWORK SHALL NOT EXCEED FIVE FEET IN LENGTH TO RESPECTIVE DIFFUSERS, GRILLES, AND REGISTERS, OR OTHER AIR DEVICES.
- PROVIDE SEISMIC RESTRAINTS TO ALL DUCTWORK, PIPE, AND EQUIPMENT SUPPORTS IN ACCORDANCE WITH THE LATEST SMACNA GUIDELINES FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS. SUSPENDED EQUIPMENT SHALL BE PROVIDED WITH SEISMIC ANCHORAGE AND ISOLATION SUPPORTS.
- ALL DUCTS TURNS IN SUPPLY, RETURN, AND EXHAUST DUCTS SHALL HAVE TURNING VANES UNLESS OTHERWISE NOTED.
- ALL INSULATION SHALL HAVE A FLAME SPREAD OF NOT MORE THAN 25 AND A SMOKE DENSITY NOT EXCEEDING 50.
- MANUAL VOLUME DAMPERS SHALL BE PROVIDED IN ALL DUCT BRANCHES TO INDIVIDUAL DIFFUSERS, GRILLES AND REGISTERS, AS WELL AS FRESH AIR INTAKE DUCTS. DAMPERS SHALL BE LOCATED AT THE BRANCH DUCT LOCATIONS. THE MECHANICAL CONTRACTOR SHALL COORDINATE LOCATIONS OF DAMPERS WITH THE AIR BALANCE CONTRACTOR PRIOR TO BID, SO THEY ARE ACCESSIBLE PRIOR TO INSTALLATION. IN LOCATIONS WHERE THESE DAMPERS ARE INACCESSIBLE, CABLE OPERATED ADJUSTMENT CONTROLS SHALL BE PROVIDED AT NO ADDITIONAL COST. OPPOSED BLADE DAMPERS SHALL NOT BE PERMITTED UNLESS NOTED OTHERWISE.
- DUCTWORK HANDLING CONDITIONED AIR SHALL BE INSULATED OR LINED AS INDICATED ON DRAWINGS. SUPPLY AND RETURN DUCT INSULATION SHALL BE MIN 3" THICK, 3/4 LB./CUBIC FT. DENSITY AND HAVE A MIN VALUE OF R-8 WHERE LOCATED IN ONE OR MORE OF THE FOLLOWING SPACES:
 - OUTDOORS, OR
 - IN A SPACE BETWEEN THE ROOF AND AN INSULATED CEILING, OR
 - IN A SPACE DIRECTLY UNDER A ROOF WITH FIXED VENTS OR OPENINGS TO THE OUTSIDE OR UNCONDITIONED SPACES, OR
 - IN AN UNCONDITIONED CRAWLSPACE, OR
 - IN OTHER UNCONDITIONED SPACES

PER 2016 C.E.C., OTHERWISE PROVIDE R-8.0 WHEN LOCATED IN CONDITIONED ATTIC SPACES ABOVE CEILING. ALL DUCTWORK EXPOSED ON ROOF SHALL BE INTERNALLY LINED WITH 1/2" THICK, 1.5 LB./CUBIC FT. DENSITY DUCT LINER UNLESS OTHERWISE INDICATED OR SPECIFIED. ALL DUCT SIZES ARE SHEET METAL SIZES. ALL DUCT JOINTS SHALL BE SEALED PER C.M.C. CHAPTER 6 REQUIREMENTS. PROVIDE PIPING AND DUCT INSULATION IN ACCORDANCE WITH THE LATEST STANDARDS OF THE CALIFORNIA ENERGY COMMISSION.
- AUTOMATIC FIRE DAMPER REQUIREMENTS ARE AS FOLLOWS:
 - PROVIDE AUTOMATIC FIRE DAMPERS AT ALL PENETRATIONS OF FIRE-RATED CEILINGS AND WALLS THROUGHOUT. CONTRACTOR SHALL COORDINATE FIRE-RATED AREAS WITH THE ARCHITECTURAL DRAWINGS AND OTHER TRADES PRIOR TO INSTALL AND SHALL NOTIFY PERTINENT PARTIES PRIOR TO ANY WORK PERFORMED IN THESE AREAS. IN ADDITION, CONTRACTOR SHALL BE RESPONSIBLE TO PROVIDE PROPER ACCESS FOR DAMPERS INSTALLED. THE DAMPER FIRE RATING SHALL BE COMPATIBLE WITH THE CEILING/WALL RATING.
 - LOCATION OF FIRE-RATED CEILINGS AND WALLS ARE AS INDICATED ON THE ARCHITECTURAL DRAWINGS.
 - FIRE AND / OR SMOKE DAMPER(S) SHALL BE PROVIDED AS REQUIRED BY THE LATEST CALIFORNIA BUILDING CODE.
 - CONTRACTOR SHALL FURNISH FLUSH MOUNTED FIRE AND / OR SMOKE DAMPERS, SO THAT THAT DAMPER DO NOT EXTEND PASS WALLS, FOR AREAS WITHOUT CEILINGS FOR QUALITY WORKMANSHIP.
- NOT USED.
- ALL DUCT WORK PASSING THROUGH FIRE RATED CORRIDORS AND LOBBIES SHALL BE MIN. 26 GAGE SHEET METAL CONSTRUCTION.
- ALL DUCTWORK, PIPING, CONDUIT, & ETC. PENETRATING FIRE RATED CONSTRUCTION SHALL HAVE APPROVED FIRE STOPPING.
- CONTRACTOR SHALL STUDY COMPLETELY AND THOROUGHLY THE DESIGN OF THE ENTIRE AIR CONDITIONING SYSTEM, AND VERIFY THE CONSTRUCTABILITY WITH OTHER TRADES PRIOR TO BID. NOTIFY THE ARCHITECT AND ENGINEER IMMEDIATELY IF THERE IS A CONFLICT. ALL CONSTRUCTABILITY ISSUES ARISE AFTER BID SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. NO EXCEPTION.
- UNLESS SPECIFICALLY SHOWN ON THESE PLANS NO STRUCTURAL MEMBERS SHALL BE CUT, DRILLED NOR NOTCHED WITHOUT PRIOR WRITTEN AUTHORIZATION FROM THE STRUCTURAL ENGINEER AND THE DISTRICT STRUCTURAL ENGINEER FROM THE DIVISION OF THE STATE ARCHITECT.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 03-119661 INC.
REVIEWED FOR
SS FLS ACS
DATE: 10/25/2019



2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rhhawkinsconsulting.com

CONSULTANT

pais
consulting group
18 Pine Hill Lane
Ladera Ranch, CA 92694
phone: 949.610.9675



HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221

NO	DATE	BY	DESCRIPTION

REVISIONS	
DRAWN: IZ	CHECKED: IP
DATE: 8/31/2018	SCALE: AS NOTED
PROJECT NUMBER: 17-302	

MECHANICAL GENERAL NOTES, LEGEND

DRAWING NUMBER : M0.1

PACKAGED HEAT PUMP UNIT SCHEDULE (ROOF TOP) - CAFETERIA BUILDING


SYMBOL	MANUFACTURER & MODEL	LOCATION	AREA SERVED	NOMINAL TONAGE	CFM	EXT. S.P.	SUPPLY FAN BHP	OSA CFM	COOLING			HEATING		ELECTRICAL							WEIGHT		NOTES	ANCHORAGE DETAIL	
									TOTAL (mbh)	SENSIBLE (mbh)	SEER	CAPACITY (mbh)	HSPF	V	PH	HZ	MCA	MCCP	FLA	LRA	CURB	TOTAL			
(HP-K1)	TRANE 4WCC3048A3000B (NEW)	ROOF BUILDING	KITCHEN	4	1,600	0.8	0.93	450	46.0	44.5	13.0	43.5	7.70	208	1	60	28	40	19.1	116	450	110	560	1, 2, 3, 4, 5, 6, 7	
(HP-K2)	TRANE 4WCC3048A3000B (NEW)	ROOF BUILDING	KITCHEN	4	1,600	0.8	0.93	450	46.0	44.5	13.0	43.5	7.70	208	1	60	28	40	19.1	116	450	110	560	1, 2, 3, 4, 5, 6, 7	
(HP-K3)	TRANE 4WCC3048A3000B (NEW)	ROOF BUILDING	KITCHEN	4	1,600	0.8	0.93	450	46.0	44.5	13.0	43.5	7.70	208	1	60	28	40	19.1	116	450	110	560	1, 2, 3, 4, 5, 6, 7	

NOTES:

- VERTICAL DISCHARGE ROOFTOP HEAT PUMP WITH OUTSIDE AIR AND BAROMETRIC RELIEF HOOD, TIME GUARD II CONTROL CIRCUIT, LOW AMBIENT KIT AND CRANKCASE HEATER
- PROVIDE WITH R410A REFRIGERANT.
- PROVIDE GLASS FIBER DISPOSABLE MEDIA IN METAL FRAMES, SIZED PER MANUFACTURER WITH MINIMUM ARRESTANCE ACCORDING TO ASHRAE 52.1, AND A MINIMUM EFFICIENCY REPORTING VALUE (MERV) ACCORDING TO ASHRAE 52.2
- PROVIDE FIELD INSTALLED DISCONNECT SWITCH. SEE ELECTRICAL DRAWINGS.
- PROVIDE FAN STATUS AND PRESSURE DIFFERENTIAL SENSOR FILTER STATUS.
- AREAS WITH UNIT SUPPLYING MORE THAN 2,000 CFM SHALL BE EQUIPPED WITH TOTAL COVERAGE DETECTION SYSTEM, ABLE TO SHUT DOWN UNIT(S) WITHIN COVERAGE AREA AND SEND SIGNAL TO BUILDING FIRE ALARM PANEL PER 2016 CMC, SECTION 608. SEE FIRE ALARM DRAWINGS FOR COMPLETE WIRING AND UNIT SHUT DOWN SEQUENCE.
- PROVIDED WITH REFRIGERATION SERVICE PORTS, FITTED WITH LOCKING TYPE TAMPER RESISTANT CAP OR SHALL BE PROTECTED FROM UNAUTHORIZED ACCESS IN ACCORDANCE WITH 2016 CMC, SECTION 1105.11

AIR DISTRIBUTION DEVICE SCHEDULE

SYMBOL	MFR & MODEL	NECK SIZE	CFM RANGE	NECK VELOCITY	MAX N.C.	S.P. DROP	TYPE	DAMPER	REMARKS
SA-1	KRUEGER 5180	8"x8"	0-170	400	30	0.03	CURVED BLADE, ADJUSTABLE MULTI-DEFLECTIONAL ALUMINUM DIFFUSER	OBD	FRAME 22 FOR GYPBOARD CEILING.
		10"x10"	171-270						
		12"x12"	271-400						
		14"x14"	401-550						
		16"x16"	551-700						
18"x18"	701-1000								
RA-1	KRUEGER EGC10	8"x8"	0-170	400	30	0.04	1"x1"x1" GRID ALUMINUM CUBE CORE	OBD	FRAME 22 FOR GYPBOARD CEILING.
		10"x10"	171-270						
		12"x12"	271-400						
		14"x14"	401-550						
		16"x16"	551-700						
		18"x18"	701-1000						
		20"x20"	1001-1250						
22"x22"	1251-1500								

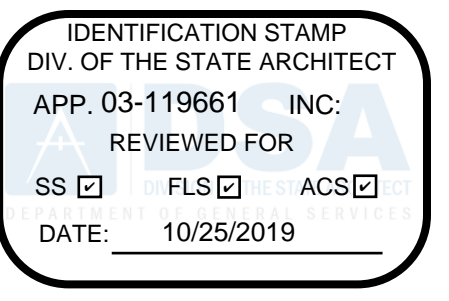

2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rfhawkinsconsulting.com

CONSULTANT
pais consulting group
18 Pine Hill Lane
Ladera Ranch, CA 92694
phone: 949.610.9675



**HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221**

△			
△			
△			
△			
NO	DATE	BY	DESCRIPTION

REVISIONS

DRAWN: IZ	CHECKED: IP
DATE: 8/31/2018	SCALE: AS NOTED
PROJECT NUMBER: 17-302	

**MECHANICAL
SCHEDULES**

DRAWING NUMBER : **M0.2**

STATE OF CALIFORNIA
MECHANICAL SYSTEMS
 CEC-NRCC-MCH-01-E (Revised 01/16)

CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE
 NRCC-MCH-01-E
 Mechanical Systems
 (Page 3 of 4)

Project Name: **HVAC ADDITIONS TO CAFETERIA BUILDING 'Q'** Date Prepared: **01.16.2019**

C. MECHANICAL HVAC ACCEPTANCE FORMS (check box for required compliance documents)

Test Performed By:
 Designer:
 This compliance document is to be used by the designer and attached to the plans. Listed below are all the acceptance tests for HVAC systems. The designer is required to check the applicable boxes for all acceptance tests that apply and list all equipment that requires an acceptance test. All equipment of the same type that requires a test, list the equipment description and the number of systems.

Installing Contractor:
 The contractor who installed the equipment is responsible to either conduct the acceptance test themselves or have a qualified entity run the test for them. If more than one person has responsibility for the acceptance testing, each person shall sign and submit the Certificate of Acceptance applicable to the portion of the construction or installation for which they are responsible.

Enforcement Agency:
 Plancheck - The NRCC-MCH-01-E compliance document is not considered a completed document and is not to be accepted by the building department unless the correct boxes are checked.
 Inspector - Before occupancy permit is granted all newly installed process systems must be tested to ensure proper operations.

Test Description	MCH-12-A	MCH-13-A	MCH-14-A	MCH-15-A	MCH-16-A	MCH-17-A	MCH-18-A
Equipment Requiring Testing or Verification	# of Units	Fault Detection & Diagnostics for DX Units	Automatic Fault Detection & Diagnostics for Air & Zone	Distributed Energy Storage DX AC Systems	Thermal Energy Storage (TES) Systems	Supply Air Temperature Reset Controls	Condenser Water Reset Controls
HP-K1	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
HP-K2	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
HP-K3	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
MECHANICAL SYSTEMS
 CEC-NRCC-MCH-01-E (Revised 01/16)

CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE
 NRCC-MCH-01-E
 Mechanical Systems
 (Page 1 of 4)

Project Name: **HVAC ADDITIONS TO CAFETERIA BUILDING 'Q'** Date Prepared: **01.16.2019**

A. MECHANICAL COMPLIANCE DOCUMENTS & WORKSHEETS (check box if worksheet is included)

For detailed instructions on the use of this and all Energy Efficiency Standards compliance forms, refer to the 2016 Nonresidential Manual
Note: The Enforcement Agency may require all forms to be incorporated into the building plans.

YES	NO	Comp. Doc./Worksheet #	Title
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-MCH-01-E (Part 1 of 3)	Certificate of Compliance, Declaration. Required on plans for all submittals.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-MCH-01-E (Part 2 of 3)	Certificate of Compliance, Required Acceptance Tests (MCH-02-A to 11-A). Required on plans for all submittals.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-MCH-01-E (Part 3 of 3)	Certificate of Compliance, Required Acceptance Tests (MCH-12-A to 18-A). Required on plans where applicable.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCC-MCH-02-E (Part 1 of 2)	Mechanical Dry Equipment Summary is required for all submittals with Central Air Systems. It is optional on plans.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCC-MCH-02-E (Part 2 of 2)	Mechanical Wet Equipment Summary is required for all submittals with chilled water, hot water or condenser water systems. It is optional on plans.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-MCH-03-E	Mechanical Ventilation and Reheat is required for all submittals with multiple zone heating and cooling systems. It is optional on plans.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCC-MCH-07-E (Part 1 of 2)	Power Consumption of Fans. Required on plans where applicable
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCC-MCH-07-E (Part 2 of 2)	Power Consumption of Fans, Declaration. Required on plans where applicable

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
MECHANICAL SYSTEMS
 CEC-NRCC-MCH-01-E (Revised 01/16)

CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE
 NRCC-MCH-01-E
 Mechanical Systems
 (Page 4 of 4)

Project Name: **HVAC ADDITIONS TO CAFETERIA BUILDING 'Q'** Date Prepared: **01.16.2019**

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
 1. I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: **ILIE PAIS** Documentation Author Signature: *Ilie Pais*

Company: **RFHC** Signature Date: **01.16.2019**

Address: **2357 NAPLES AVENUE** CEAT/HERS Certification Identification (if applicable):

City/State/Zip: **MENTONE, CA 92359-9635** Phone: **(949) 610-9675**

RESPONSIBLE PERSON'S DECLARATION STATEMENT
 I certify the following under penalty of perjury, under the laws of the State of California:
 1. The information provided on this Certificate of Compliance is true and correct.
 2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
 3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
 4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
 5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: **ILIE PAIS** Responsible Designer Signature: *Ilie Pais*

Company: **RFHC** Date Signed: **01.16.2019**

Address: **2357 NAPLES AVENUE** License: **M-36549**

City/State/Zip: **MENTONE, CA 92359-9635** Phone: **(949) 610-9675**

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
MECHANICAL SYSTEMS
 CEC-NRCC-MCH-01-E (Revised 01/16)

CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE
 NRCC-MCH-01-E
 Mechanical Systems
 (Page 2 of 4)

Project Name: **HVAC ADDITIONS TO CAFETERIA BUILDING 'Q'** Date Prepared: **01.16.2019**

B. MECHANICAL HVAC ACCEPTANCE FORMS (check box for required compliance documents)


Test Performed By:
 Designer:
 This compliance document is to be used by the designer and attached to the plans. Listed below are all the acceptance tests for HVAC systems. The designer is required to check the applicable boxes for all acceptance tests that apply and list all equipment that requires an acceptance test. All equipment of the same type that requires a test, list the equipment description and the number of systems.

Installing Contractor:
 The contractor who installed the equipment is responsible to either conduct the acceptance test themselves or have a qualified entity run the test for them. If more than one person has responsibility for the acceptance testing, each person shall sign and submit the Certificate of Acceptance applicable to the portion of the construction or installation for which they are responsible.

Enforcement Agency:
 Plancheck - The NRCC-MCH-01-E compliance document is not considered a completed document and is not to be accepted by the building department unless the correct boxes are checked.
 Inspector - Before occupancy permit is granted all newly installed process systems must be tested to ensure proper operations.

Test Description	MCH-02-A	MCH-03-A	MCH-04-A	MCH-05-A	MCH-06-A	MCH-07-A	MCH-08-A	MCH-09-A	MCH-10-A	MCH-11-A
Equipment Requiring Testing or Verification	# of Units	Outdoor Air	Single Zone Unitary	Air Distribution Ducts	Economizer Controls	Demand Control Ventilation (DCV)	Supply Fan VAV	Valve Leakage Test	Supply Water Temp. Reset	Hydronic System Variable Flow Control
HP-K1	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
HP-K2	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
HP-K3	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

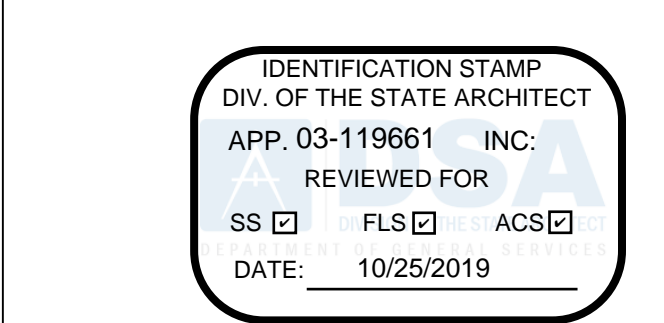

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
 pais consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675



HVAC ADDITIONS TO CAFETERIA BLDG.
COMPTON COMMUNITY COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221

△			
△			
△			
△			

NO	DATE	BY	DESCRIPTION
REVISIONS			
DRAWN:	IZ	CHECKED:	IP
DATE:	8/31/2018	SCALE:	AS NOTED
PROJECT NUMBER:	17-302		

BUILDING 'Q'
TITLE-24
COMPLIANCE

DRAWING NUMBER : **M0.3**

STATE OF CALIFORNIA
HVAC SYSTEM REQUIREMENTS
 CEC-NRCC-MCH-02-E (Revised 08/14) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-MCH-02-E
 HVAC Wet System Requirements (Page 3 of 3)
 Project Name: HVAC ADDITIONS TO CAFETERIA BUILDING 'Q' Date Prepared: 01.16.2019

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
 1. I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: ILIE PAIS
 Signature Date: 01.16.2019
 Company: RFHC
 Address: 2357 NAPLES AVENUE
 City/State/Zip: MENTONE, CA 92359-9635
 Phone: (949) 610-9675

RESPONSIBLE PERSON'S DECLARATION STATEMENT
 I certify the following under penalty of perjury, under the laws of the State of California:
 1. The information provided on this Certificate of Compliance is true and correct.
 2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
 3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
 4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
 5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: ILIE PAIS
 Signature Date: 01.16.2019
 Company: RFHC
 Address: 2357 NAPLES AVENUE
 City/State/Zip: MENTONE, CA 92359-9635
 License: M-36549
 Phone: (949) 610-9675

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
HVAC DRY & WET SYSTEM REQUIREMENTS
 CEC-NRCC-MCH-02-E (Revised 01/18) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-MCH-02-E
 HVAC Dry & Wet System Requirements (Page 1 of 3)
 Project Name: HVAC ADDITIONS TO CAFETERIA BUILDING 'Q' Date Prepared: 01.16.2019

A. Equipment Tags and System Description¹ - Dry Systems

	T-24 Sections	HP-K1	HP-K2	HP-K3
MANDATORY MEASURES				
Reference to the Requirements in the Contract Documents ²				
Heating Equipment Efficiency ³	110.1 or 110.2(a)	M0.2	M0.2	M0.2
Cooling Equipment Efficiency ³	110.1 or 110.2(a)	M0.2	M0.2	M0.2
HVAC or Heat Pump Thermostats	110.2(b), 110.2(c)	Heat Pump	Heat Pump	Heat Pump
Furnace Standby Loss Control	110.2(d)	N/A	N/A	N/A
Low Leakage AHUs	110.2(f)	N/A	N/A	N/A
Ventilation ⁴	120.1(b)	M0.2	M0.2	M0.2
Demand Control Ventilation ⁵	120.1(c)(4)	N/A	N/A	N/A
Occupant Sensor Ventilation Control ⁶	120.1(c)(5), 120.2(e)(3)	N/A	N/A	N/A
Shutoff and Reset Controls ⁷	120.2(e)	N/A	N/A	N/A
Outdoor Air and Exhaust Damper Control	120.2(f)	M1.1	M1.1	M1.1
Isolation Zones	120.2(g)	N/A	N/A	N/A
Automatic Demand Shed Controls	120.2(h)	N/A	N/A	N/A
Economizer FDD	120.2(i)	N/A	N/A	N/A
Duct Insulation	120.4	M0.1	M0.1	M0.1
PRESCRIPTIVE MEASURES				
Equipment is sized in conformance with 140.4(a & b)	140.4(a & b)	Y/N	Y/N	Y/N
Supply Fan Pressure Control	140.4(c)	N	N	N
Simultaneous Heat/Cool ⁸	140.4(d)	N	N	N
Economizer	140.4(e)	N	N	N
Heat and Cool Air Supply Reset	140.4(f)	N	N	N
Electric Resistance Heating ⁹	140.4(g)	N	N	N
Duct Leakage Sealing and Testing ¹⁰	140.4(i)	N	N	N

Notes:
 1. Provide equipment tags (e.g. AHU 1 to 10) and system description (e.g. Single Duct VAV reheat) as appropriate. Multiple units with common requirements can be grouped together.
 2. Provide references to plans (i.e. Drawing Sheet Numbers) and/or specifications (including Section name/number and relevant paragraphs) where each requirement is specified. Enter "N/A" if the requirement is not applicable to this system.
 3. The referenced plans and specifications must include all of the following information: equipment tag, equipment nominal capacity, Title 24 minimum efficiency requirements, and actual rated equipment efficiencies. Where multiple efficiency requirements are applicable (e.g. full- and part-load) include all. Where appliance standards apply (110.1), identify where equipment is required to be listed per Title 20 1601 et seq.
 4. Identify where the ventilation requirements are documented for each central HVAC system. Include references to both central unit schedules and sequences of operation. If one or more spaces is naturally ventilated identify where this is documented in the plans and specifications. Multiple zone central air systems must also provide a MCH-03-E compliance document.
 5. If one or more spaces has demand controlled ventilation identify where it is specified including the sensor specifications and the sequence of operation.
 6. If one or more space has occupant sensor ventilation control identify where it is specified including the sensor specifications and the sequence of operation.
 7. If the system is DDC identify the sequences for the system start/stop, optimal start, setback (if required) and setup (if required). For all systems identify the specification for the thermostats and time clocks (if applicable).
 8. Identify where the heating, cooling and deadband airflows are scheduled for this system. Include a reference to the specification of the zone controls. Provide a MCH-03-E compliance document.
 9. Enter N/A if there is no electric heating. If the system has electric heating indicate which exception to 140.4(g) applies.
 10. If duct leakage sealing and testing is required, a MCH-04-A compliance document must be submitted.

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
MECHANICAL VENTILATION AND REHEAT
 CEC-NRCC-MCH-03-E (Revised 05/16) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-MCH-03-E
 Mechanical Ventilation & Reheat (Page 2 of 2)
 Project Name: HVAC ADDITIONS TO CAFETERIA BUILDING 'Q' Date Prepared: 01.16.2019

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
 1. I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: ILIE PAIS
 Signature Date: 01.16.2019
 Company: RFHC
 Address: 2357 NAPLES AVENUE
 City/State/Zip: MENTONE, CA 92359-9635
 Phone: (949) 610-9675

RESPONSIBLE PERSON'S DECLARATION STATEMENT
 I certify the following under penalty of perjury, under the laws of the State of California:
 1. The information provided on this Certificate of Compliance is true and correct.
 2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
 3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
 4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
 5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: ILIE PAIS
 Signature Date: 01.16.2019
 Company: RFHC
 Address: 2357 NAPLES AVENUE
 City/State/Zip: MENTONE, CA 92359-9635
 License: M-36549
 Phone: (949) 610-9675

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance May 2016


STATE OF CALIFORNIA
MECHANICAL VENTILATION AND REHEAT
 CEC-NRCC-MCH-03-E (Revised 05/16) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-MCH-03-E
 Mechanical Ventilation & Reheat (Page 1 of 2)
 Project Name: HVAC ADDITIONS TO CAFETERIA BUILDING 'Q' Date Prepared: 01.16.2019

A. Mechanical Ventilation and Reheat


ZONE / SYSTEM / VAV BOX TAG	ACTUAL DESIGN INFO (FROM EQUIPMENT SCHEDULES, ETC)											OCCUPANCY BASIS				MINIMUM				VAV Reheat Primary Air CFM		VAV Deadband Primary Air CFM	
	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG	ZONE / SYSTEM / VAV BOX TAG			
HP-K1	1,600	N/A	1,600	N	N/A	950	0.15	143	6	15	90	143	143	Pass	N/A	N/A	Pass	N/A	N/A	Pass			
HP-K1	1,600	N/A	1,600	N	N/A	950	0.15	143	10	15	150	143	150	Pass	N/A	N/A	Pass	N/A	N/A	Pass			
HP-K1	1,600	N/A	1,600	N	N/A	950	0.15	143	20	15	300	143	300	Pass	N/A	N/A	Pass	N/A	N/A	Pass			

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance May 2016

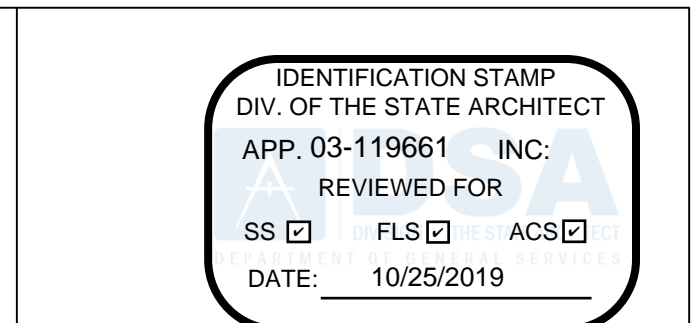

RFHC
 RF Hawkins Consulting
 2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rhwkinsconsulting.com

CONSULTANT
 pais consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675

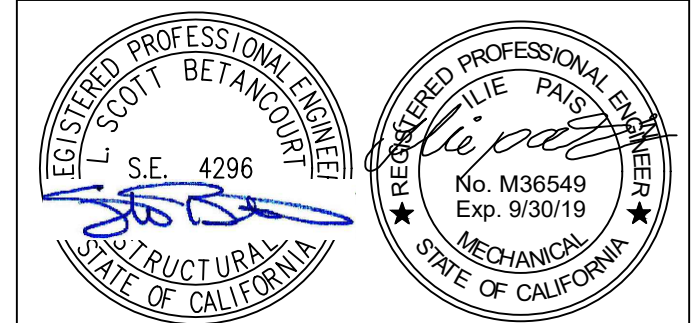

HVAC ADDITIONS TO
 CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

NO	DATE	BY	DESCRIPTION

REVISIONS
 DRAWN: IZ CHECKED: IP
 DATE: 8/31/2018 SCALE: AS NOTED
 PROJECT NUMBER: 17-302

**BUILDING 'Q'
 TITLE-24
 COMPLIANCE**

DRAWING NUMBER : **M0.4**


IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
 RF Hawkins Consulting



2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT


pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675

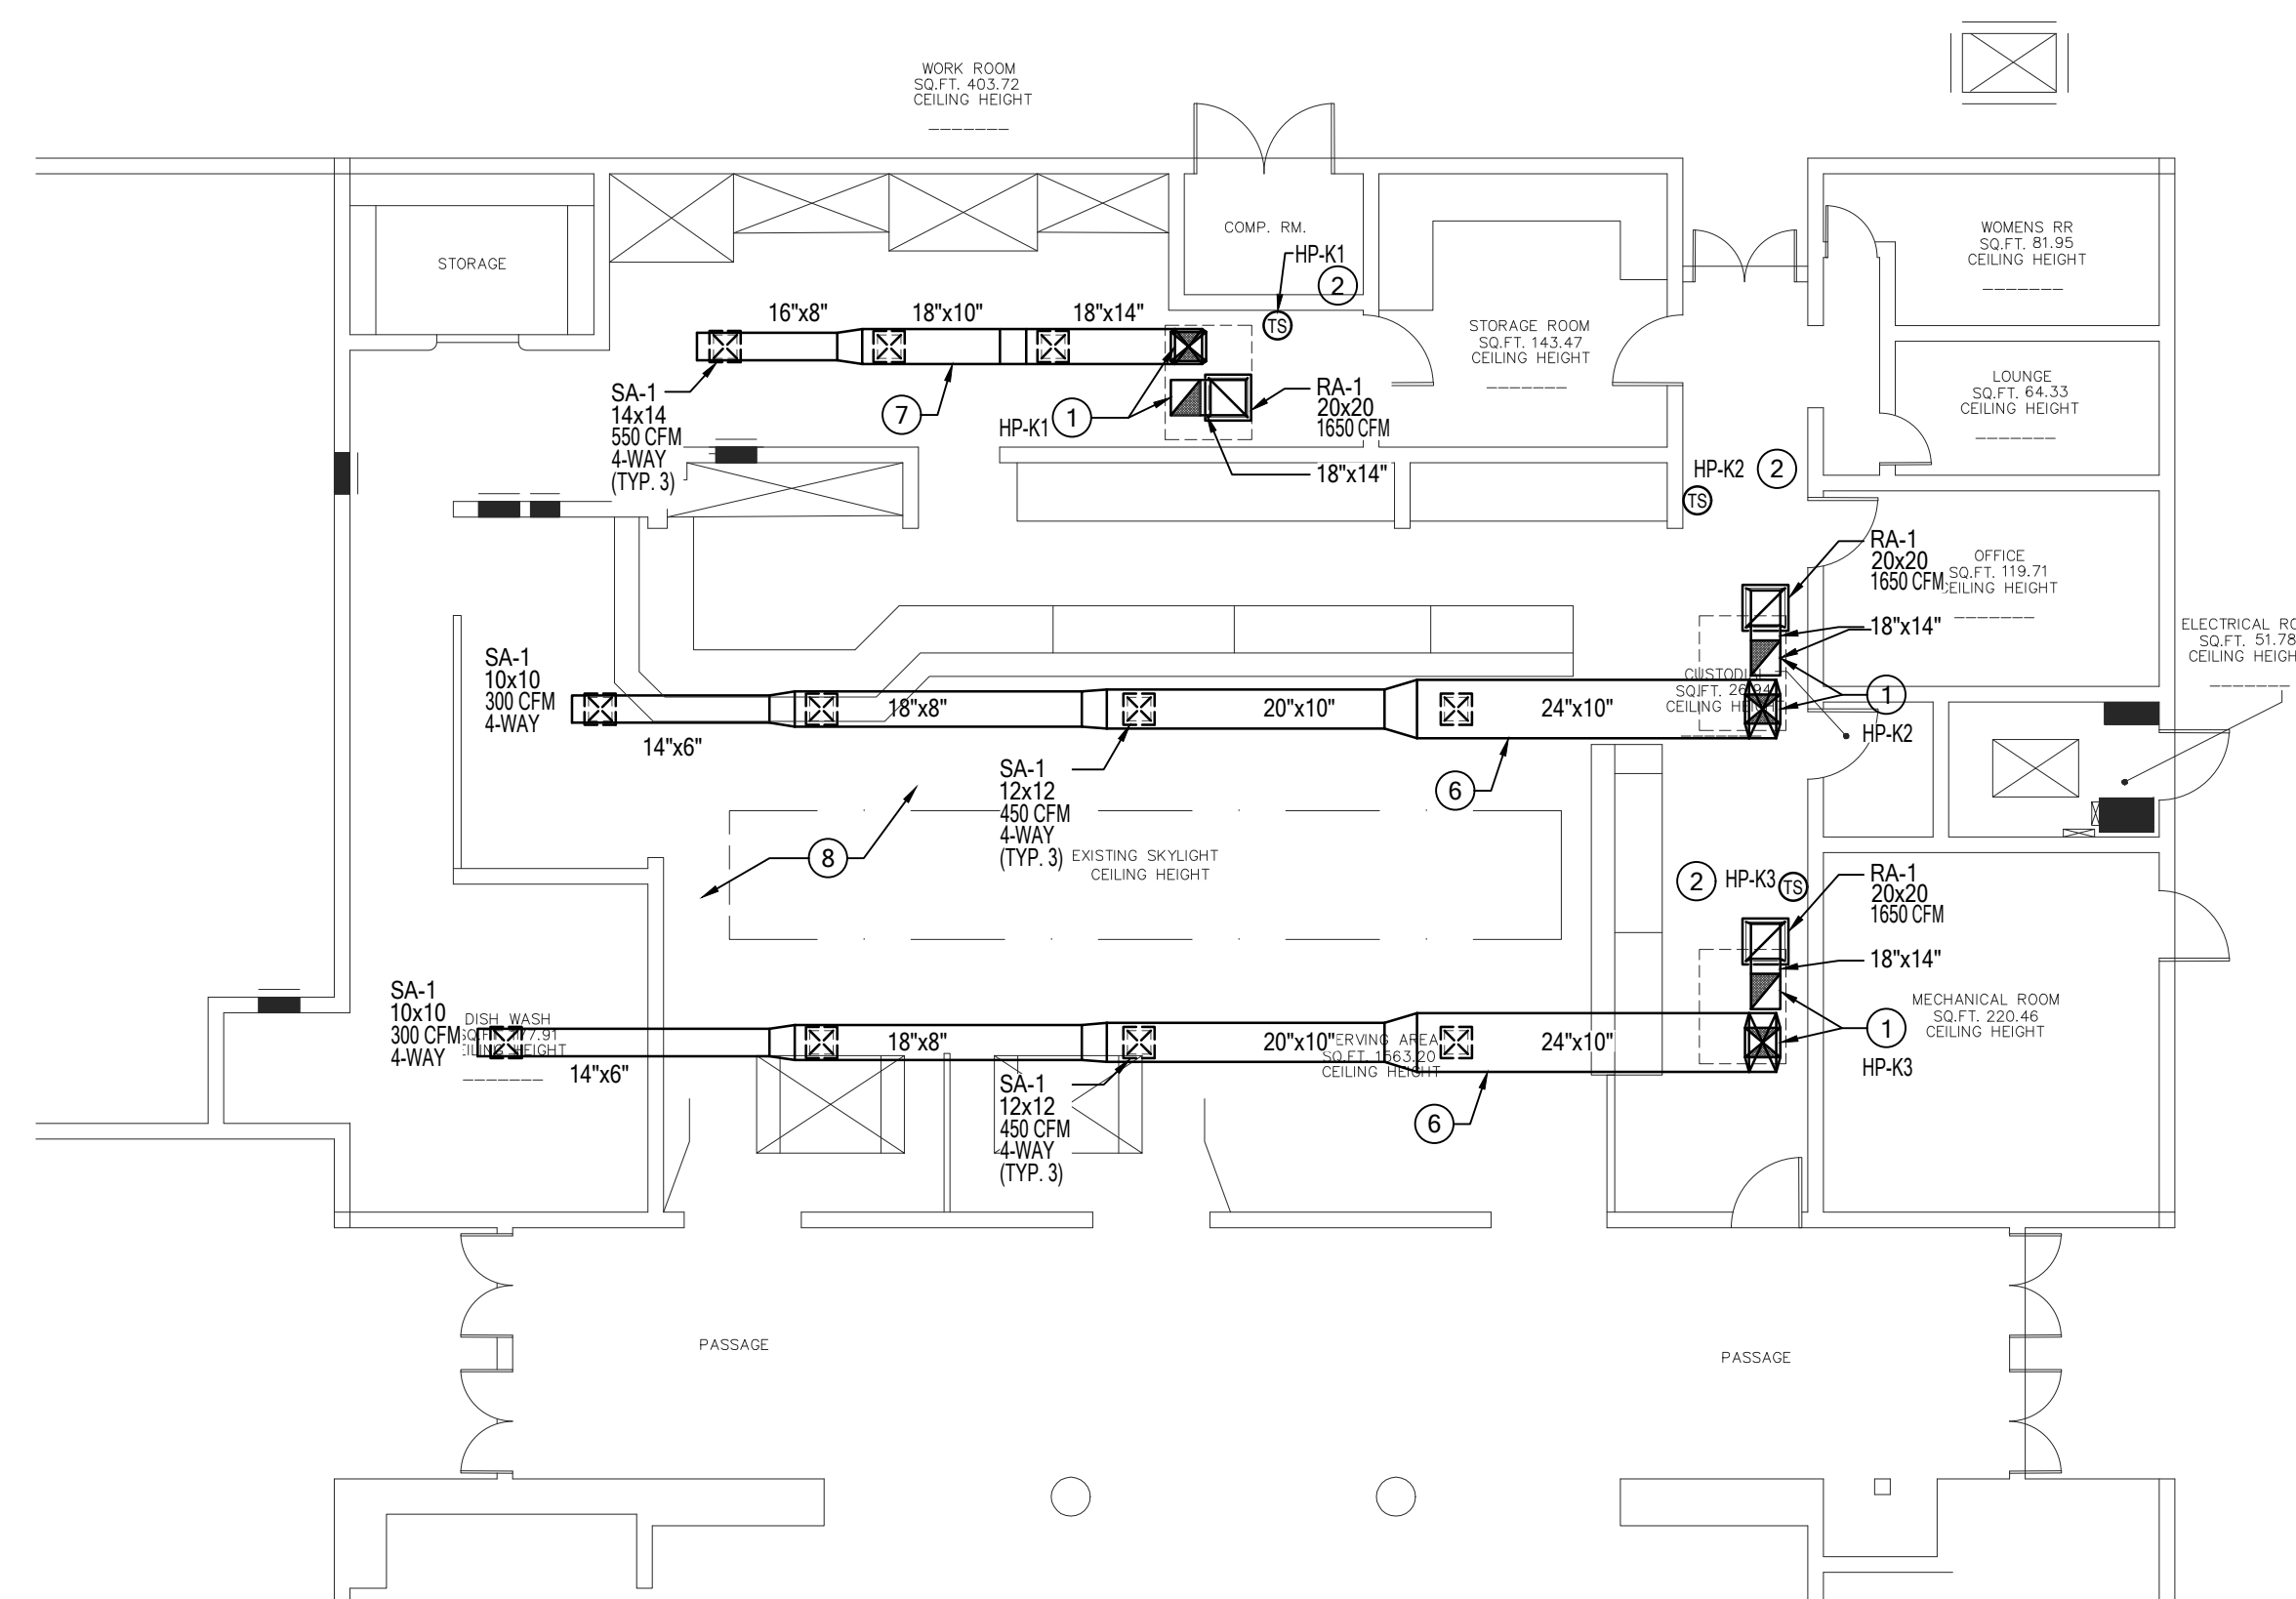

1 Mechanical Floor Plan
 SCALE: 1/8" = 1'-0"

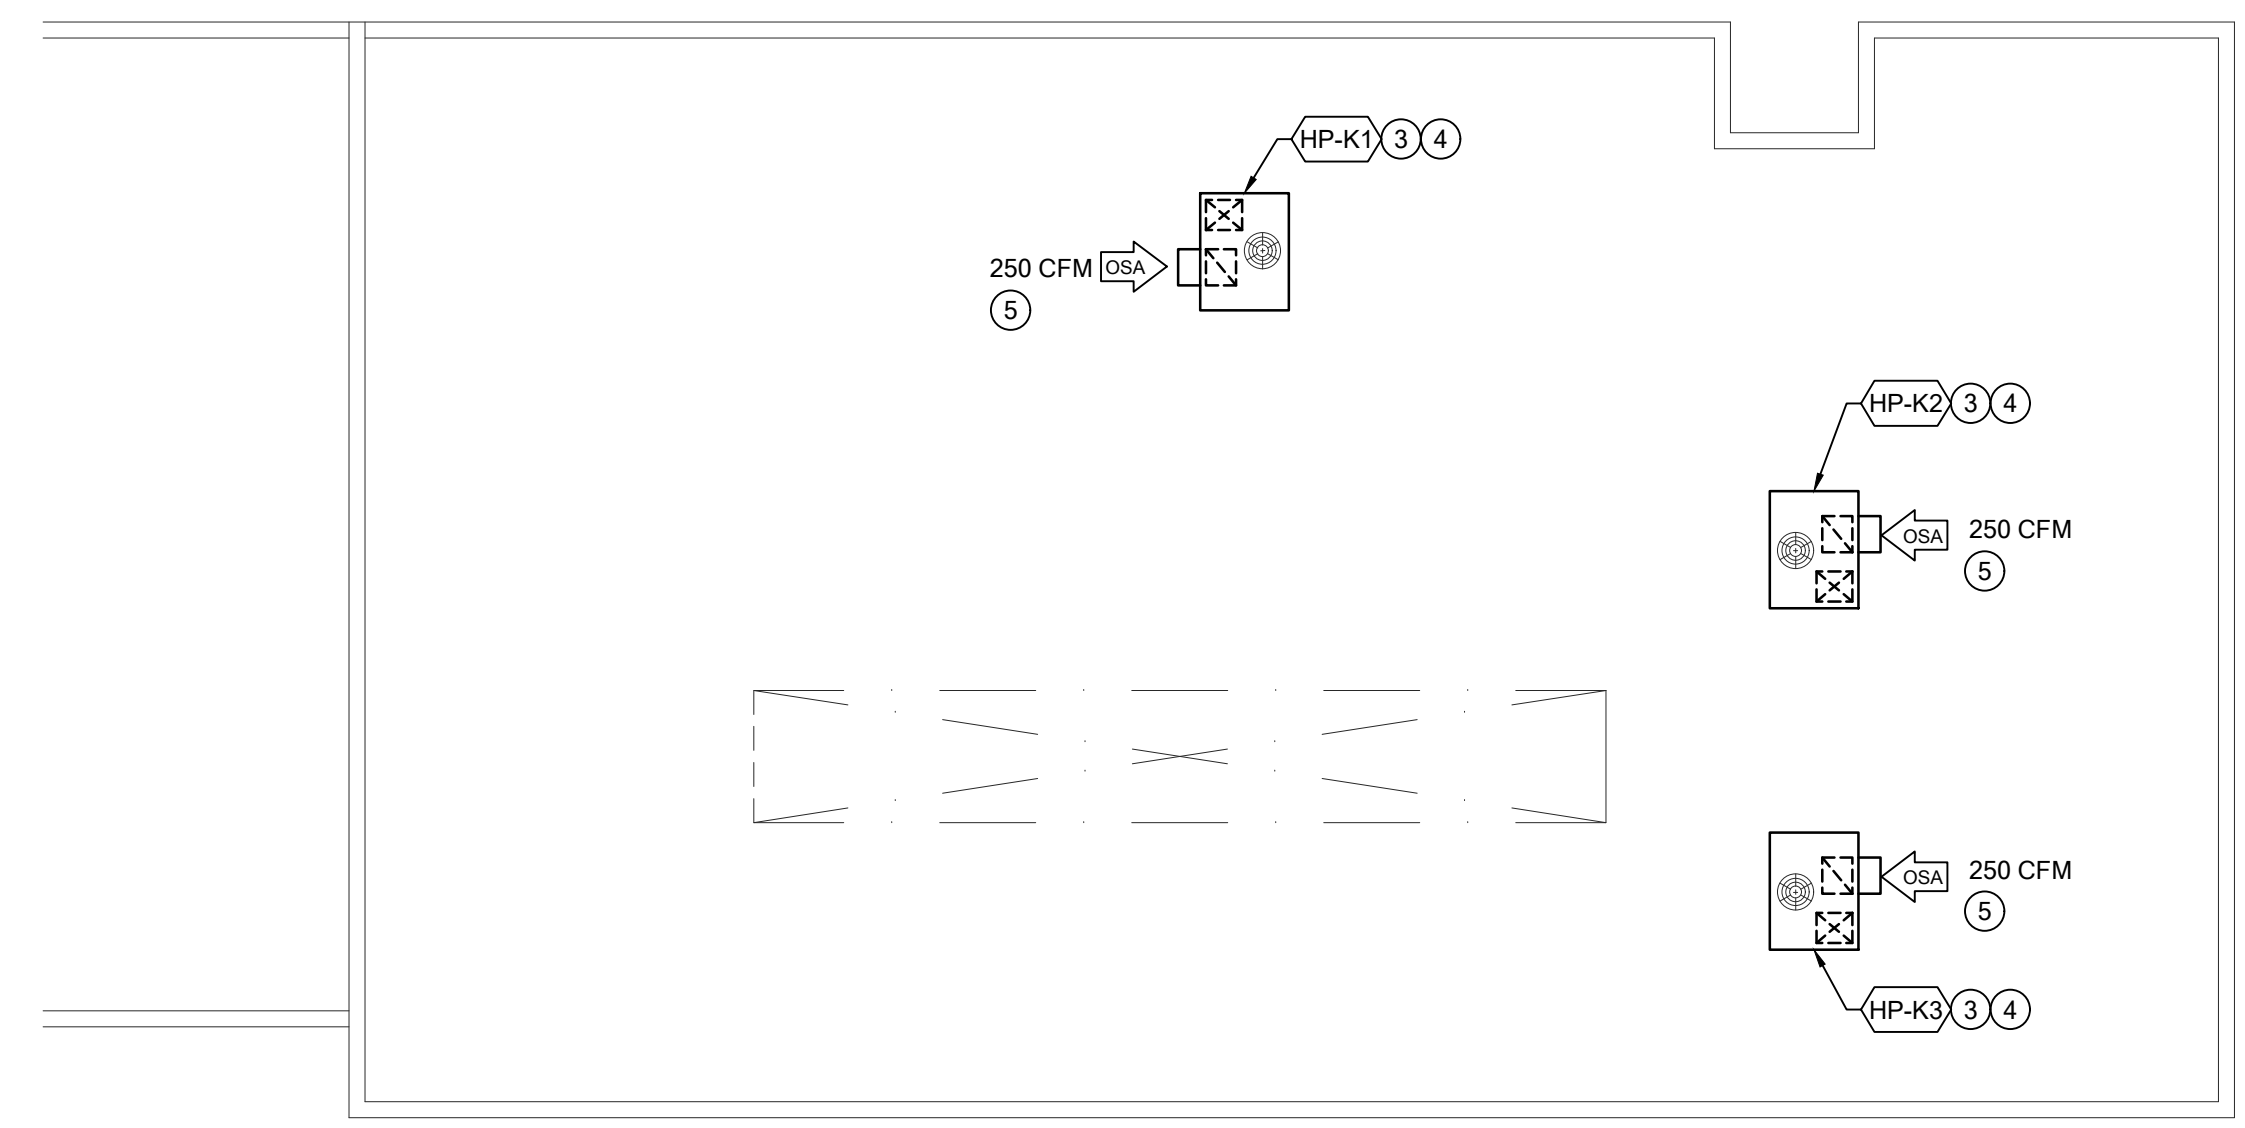

2 Mechanical Roof Plan
 SCALE: 1/8" = 1'-0"



PLAN NOTES:

- FRESH AIR INTAKES SHALL BE 10'-0" MIN. AWAY FROM ALL EXHAUST OUTLETS, PLUMBING VENTS, AND FLUES.
- CONTRACTOR SHALL COORDINATE EXACT EQUIPMENT, DUCTWORK AND PIPING SIZES AND LOCATIONS WITH OTHER TRADES PRIOR TO INSTALLATION.
- MAINTAIN MANUFACTURER MIN. CLEARANCES ON ALL ROOF-TOP MECHANICAL EQUIPMENT.
- THE MINIMUM VENTILATION RATES IN BREATHING ZONES SHALL BE IN CONFORMANCE WITH CALIFORNIA MECHANICAL CODE TABLE 4-1 AND/OR CALIFORNIA ENERGY CODE TABLE 121-A.
- DUCT SIZES SHOWN ON PLAN ARE INSIDE DIMENSIONS.
- CONTRACTOR SHALL PROVIDE SHOP DRAWINGS WITHIN 30 DAYS OF AWARD OF CONTRACT. IF SHOP DRAWINGS ARE NOT PROVIDED TO THE ENGINEER FOR APPROVAL, AND ANY CONFLICTS OCCUR BETWEEN TRADES, DURING CONSTRUCTION, & ETC. THEN, THE CONTRACTOR SHALL BE RESPONSIBLE AND BEAR ALL COST INCURRED FOR ANY REVISIONS, AT NO ADDITIONAL COST TO THE CLIENT. THE ARCHITECT AND ENGINEER SHALL BE NOTIFIED IMMEDIATELY PRIOR TO FABRICATION AND INSTALLATION OF ANY CONFLICTS BETWEEN TRADES, DURING CONSTRUCTION, & ETC.

PLAN KEY NOTES:

- FULL SIZE SUPPLY AND RETURN AIR DUCT UP THRU ROOF. TRANSITION TO 16"x16" DUCT IN VERTICAL DROP WITH ELL AND TURNING VANES AND TRANSITION HORIZONTALLY AS INDICATED WITH 1" ACOUSTICAL LINING. NO PLENUM TAPS.
- PROVIDE PROGRAMMABLE THERMOSTATS IN OFFICE WITH LOCKING COVERS, MOUNT AT +48" A.F.F.
- INSTALL LEVEL NEW EQUIPMENT WITH NEW ROOF CURBS. CONTRACTOR TO VERIFY IN FIELD EXACT LOCATION AND COORDINATE WITH ALL EXISTING MECHANICAL, PLUMBING AND ELECTRICAL ROOF EQUIPMENT AND COMPONENTS.
- CONTRACTOR TO RELOCATE ALL EXISTING MECHANICAL, PLUMBING AND ELECTRICAL SYSTEM COMPONENTS THAT ARE IN CONFLICT WITH NEW ROOFTOP UNIT AND ALL RELATED SYSTEMS.
- FRESH AIR INTAKES SHALL BE 10'-0" MIN. AWAY FROM ALL EXHAUST OUTLETS, PLUMBING VENTS, AND FLUES.
- INSTALL DUCTWORK AND AIR OUTLET DEVICE AS HIGH AS POSSIBLE, BELOW EXISTING CEILING. PAINT EXPOSED DUCT WORK AND ACCESSORIES TO MATCH EXISTING CEILING COLOR.
- INSTALL DUCTWORK ABOVE EXISTING CEILING. REMOVE AND REPLACE CEILING TO MATCH EXISTING AS REQUIRED.
- ALL NON-FUNCTIONAL EXISTING CEILING GRILLES/ DIFFUSERS SHALL BE REMOVED. CAP DUCTWORK AND REPLACE AND REPAIR CEILING TO MATCH EXISTING

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

△			
△			
△			
△			
NO	DATE	BY	DESCRIPTION
REVISIONS			
DRAWN: IZ		CHECKED: IP	
DATE: 8/31/2018		SCALE: AS NOTED	
PROJECT NUMBER:		17-302	

MECHANICAL PLANS

DRAWING NUMBER : **M1.1**


IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com


CONSULTANT

pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675

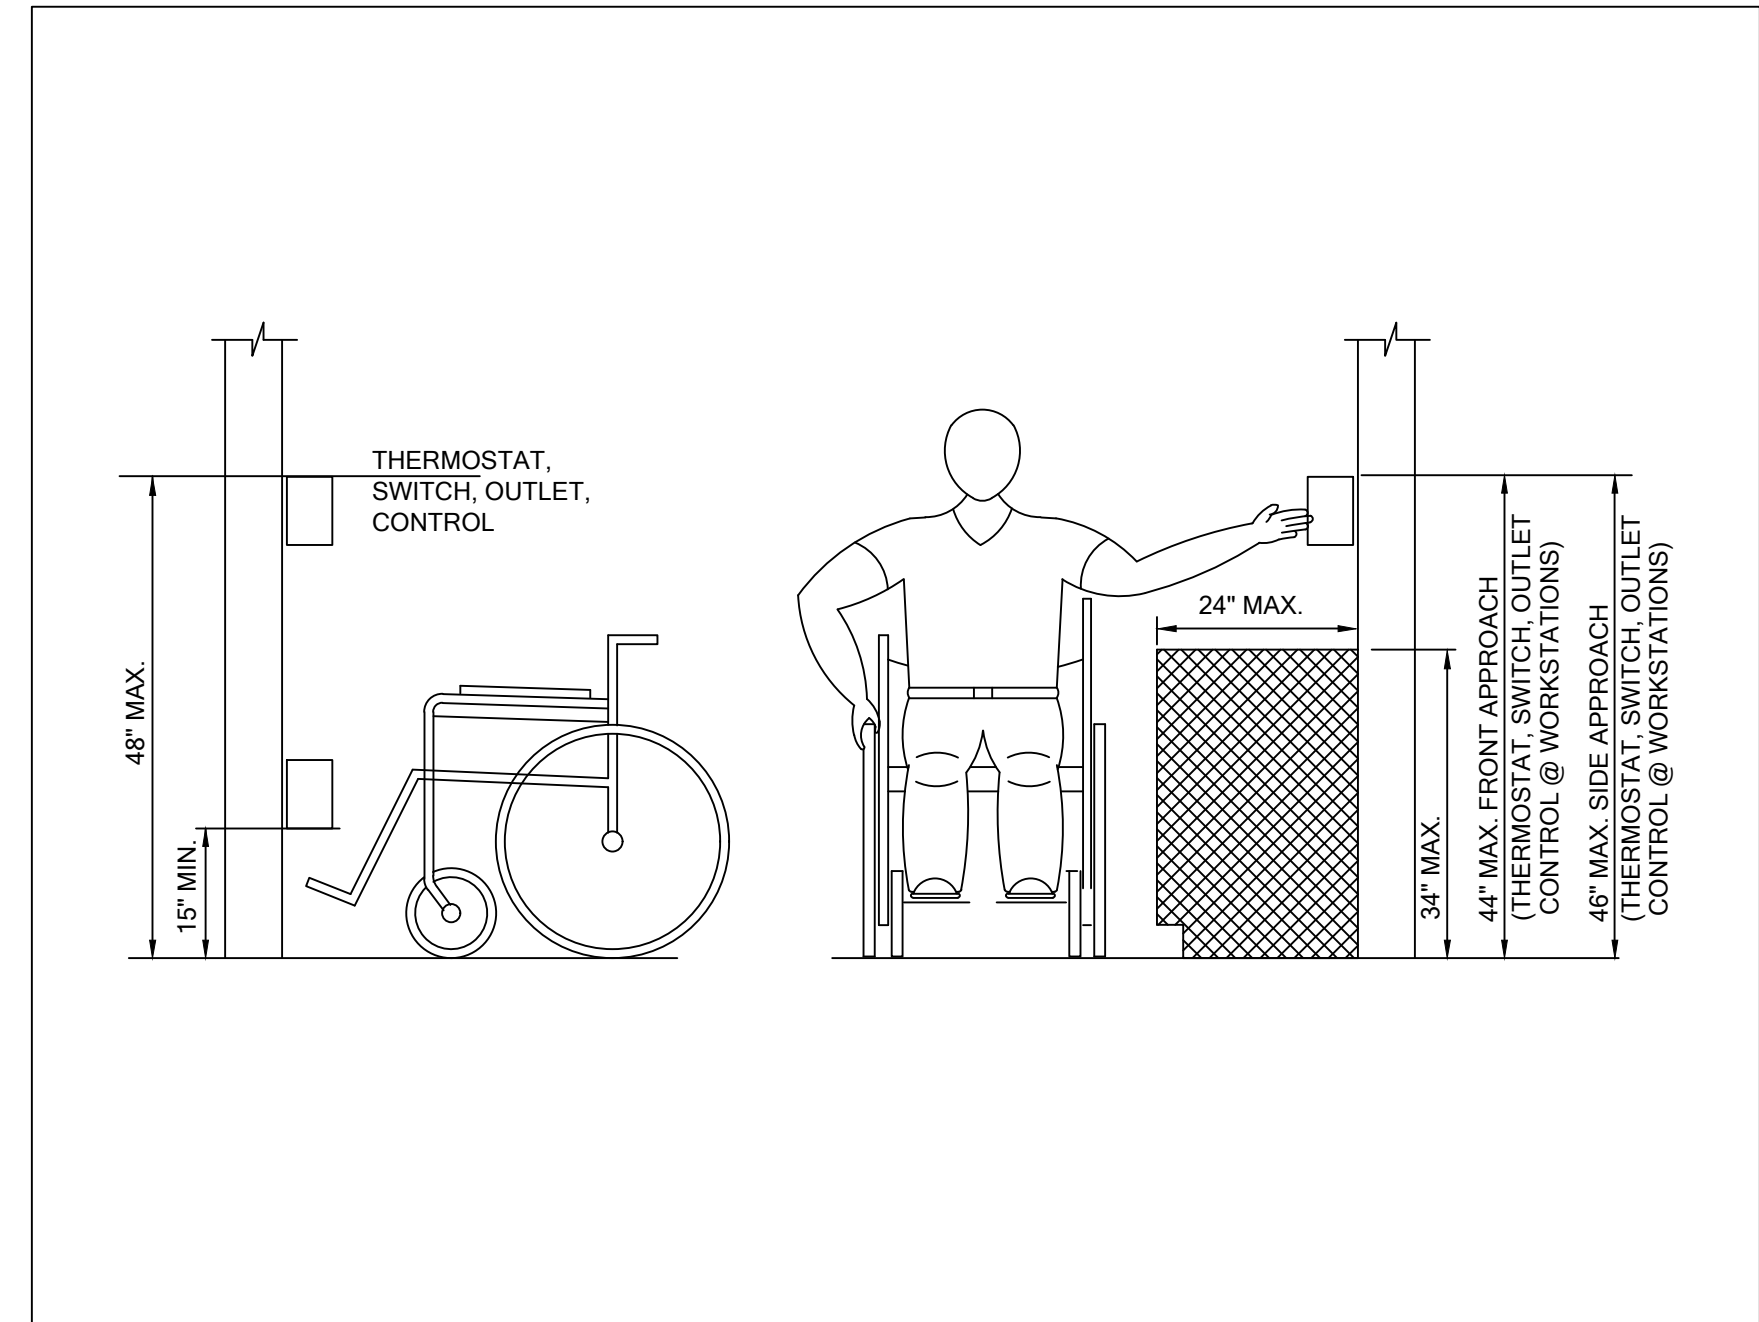

CONTROL DEVICE MOUNTING DETAIL

SCALE
 NONE 1

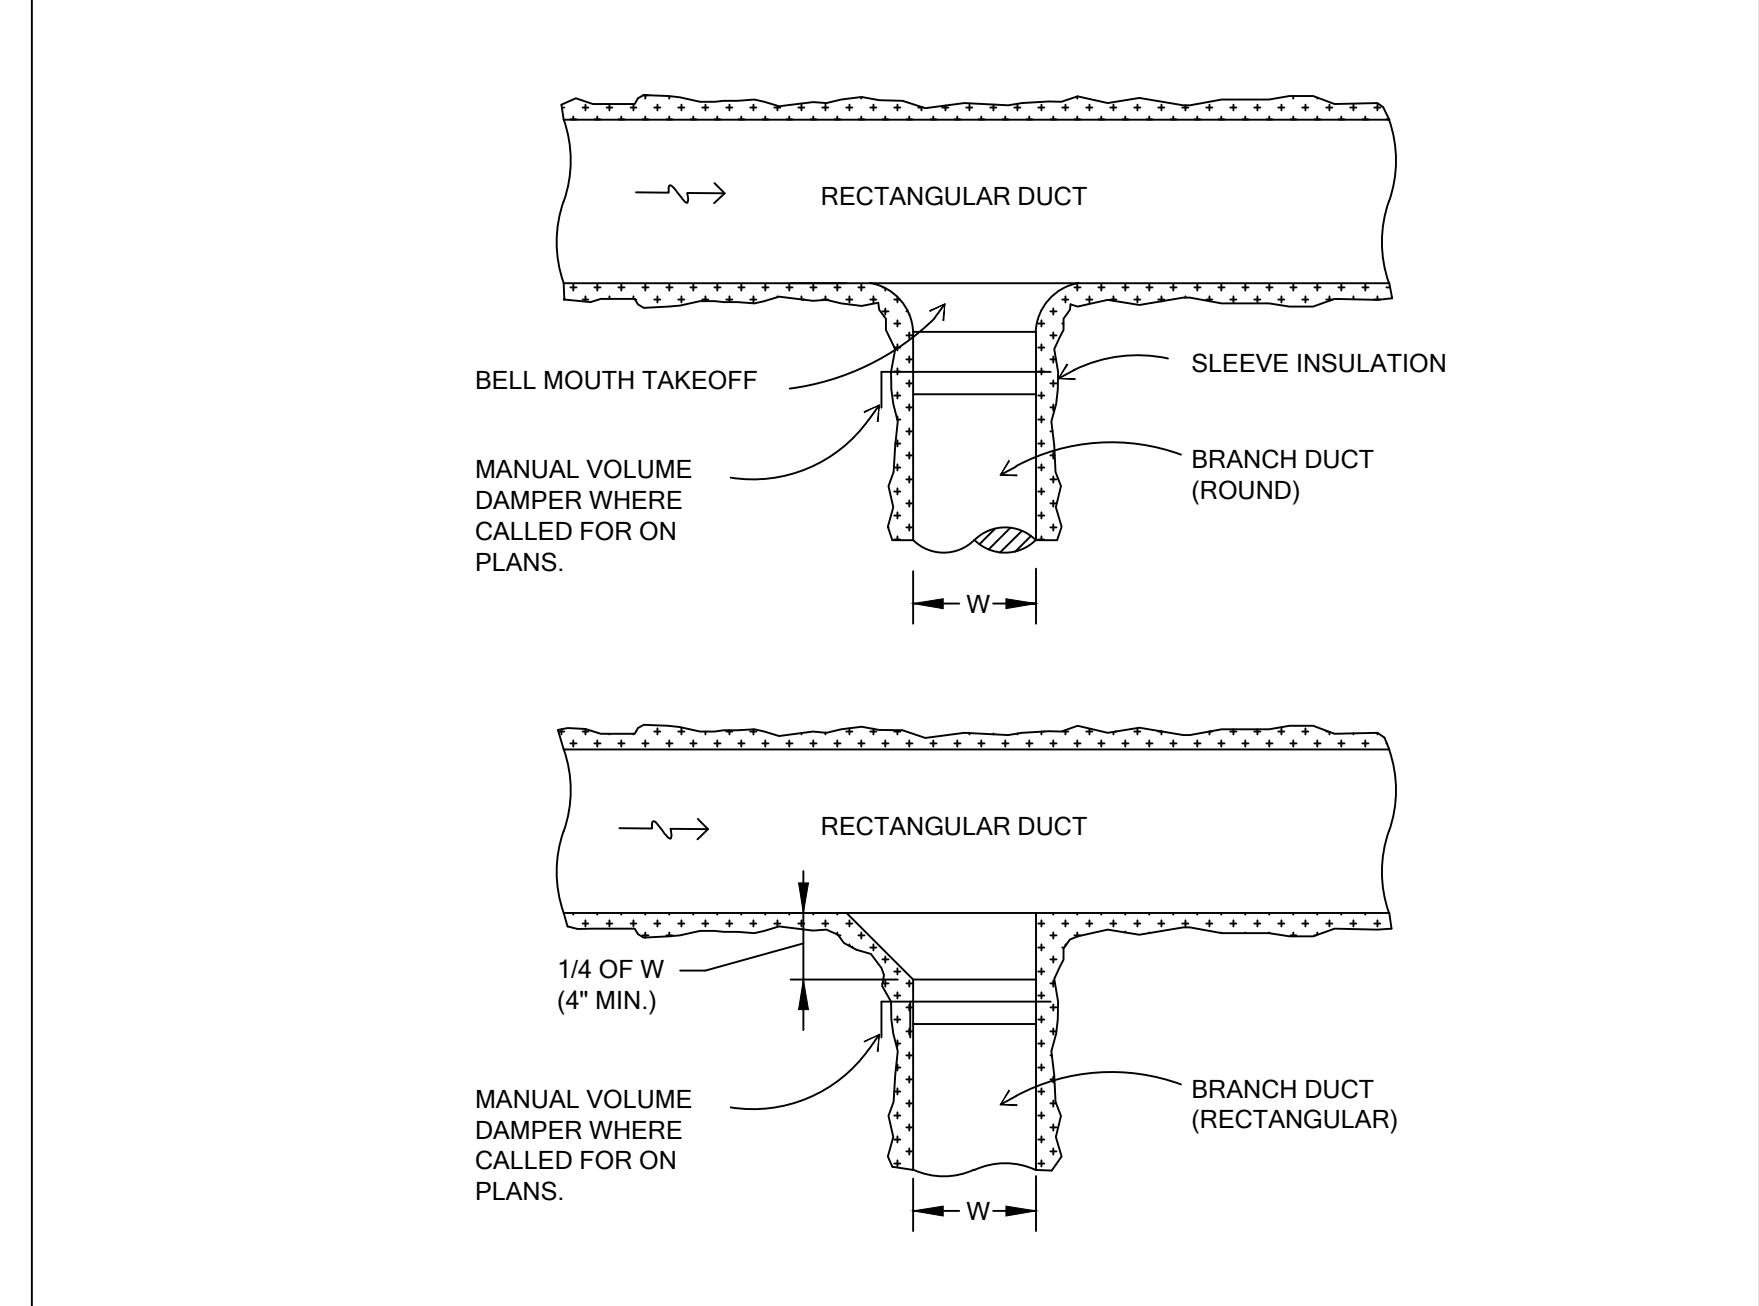

BRANCH TAKEOFF (REC)

SCALE
 NONE 2

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

△			
△			
△			
△			
NO	DATE	BY	DESCRIPTION

REVISIONS

DRAWN:	IZ	CHECKED:	IP
DATE:	8/31/2018	SCALE:	AS NOTED
PROJECT NUMBER:	17-302		

**MECHANICAL
 DETAILS**

DRAWING NUMBER : **M2.1**

SEISMIC ANCHORAGE NOTES

EQUIPMENT ANCHORAGE NOTE:

ALL MECHANICAL AND ELECTRICAL EQUIPMENT SHALL BE ANCHORED OR BRACED TO MEET THE HORIZONTAL AND VERTICAL FORCES PRESCRIBED IN THE 2010 CBC, SECTION 1614A.1.13 AND ASCE 7-05 SECTIONS 13.3, 13.4, 13.6, AND CHAPTER 6.

THE ATTACHMENTS OF THE FOLLOWING ITEMS SHALL BE DESIGNED TO RESIST THE FORCES PRESCRIBED ABOVE, BUT NEED NOT TO BE DETAILED ON THE PLANS, AND THE PROJECT INSPECTOR WILL VERIFY THAT THESE ITEMS (EQUIPMENT) HAVE BEEN ANCHORED.

- A. EQUIPMENT WEIGHING LESS THAN 400 POUNDS SUPPORTED DIRECTLY ON THE FLOOR OR ROOF.
- B. FURNITURE REQUIRED TO BE ATTACHED IN ACCORDANCE WITH ASCE 7-05, SECTION 13.5
- C. TEMPORARY OR MOVABLE EQUIPMENT WITH FLEXIBLE CONNECTION TO POWER OR UTILITIES.
- D. EQUIPMENT WEIGHING LESS THAN 20 POUNDS SUPPORTED BY VIBRATION ISOLATORS.
- E. EQUIPMENT WEIGHING LESS THAN 20 POUNDS SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

FOR THOSE ELEMENTS THAT DO NOT REQUIRE DETAILS ON THE APPROVED DRAWINGS, THE INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE MECHANICAL/ELECTRICAL ENGINEER. THESE ITEMS (EQUIPMENT) HAVE BEEN ANCHORED.

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE:

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM SHALL BE BRACED TO RESIST THE FORCES PRESCRIBED IN ASCE 7-05 SECTION 13.3 AS DEFINED IN ASCE 7-05 SECTION 13.6.8, 13.6.7, 13.6.5.5 ITEM 6.

THE BRACING ATTACHEMENTS TO THE STRUCTURE SHALL COMPLY WITH ONE OF THE OSHPD PRE- APPROVALS WITH AN OPA #, SUCH AS MASON INDUSTRIES (OPA 349), OR ISAT (OPA 485) AS MODIFIED TO SATISFY ANCHORAGE REQUIREMENTS OF ACI 318, APPENDIX D.

COPIES OF THE MANUAL SHALL BE AVAILABLE ON THE JOBSITE PRIOR TO START OF HANGING AND BRACING OF THE PIPE, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS.

THE STRUCTURAL ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.

LEGEND

SYMBOL	ABBREVIATION	DESCRIPTION
	S OR W	SOIL OR WASTE ABOVE FLOOR
	S OR W	SOIL OR WASTE BELOW FLOOR OR GRADE
	V	SANITARY VENT
	CW	COLD WATER
	HW	HOT WATER
	CD	CONDENSATE DRAIN
	OCD	OVERFLOW CONDENSATE DRAIN
	TP	TRAP PRIMER
	SOV	SHUT-OFF VALVE
	SOV/GC	SHUT-OFF VALVE OR GAS COCK IN YARD BOX
	FCO	FLOOR CLEANOUT
	WCO	WALL CLEANOUT
		RISER UP
		RISER DOWN
	ABV	ABOVE
	BEL	BELOW
	CLG	CEILING
	CONT	CONTINUATION
	DN	DOWN
	EXIST	EXISTING
	FLR	FLOOR
	FFE	FINISH FLOOR ELEVATION
	HDR	HEADER
	I.E.	INVERT ELEVATION
	POC	POINT OF CONNECTION
	PLCS	PLACES
	SLVE	SLEEVE
	VTR	VENT THRU ROOF
	YB	YARD BOX

GENERAL NOTES

- BEFORE COMMENCEMENT OF WORK, THE CONTRACTOR SHALL VERIFY THE EXACT LOCATIONS, ELEVATIONS AND CHARACTERISTICS OF ALL UTILITIES AND PIPING, AND SHALL IMMEDIATELY NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- ALL VALVES, UNIONS, ETC. TO BE SAME SIZE AS PIPE UNLESS OTHERWISE INDICATED ON DRAWINGS.
- ALL PLUMBING FIXTURE VENTS TO TERMINATE A MINIMUM OF 12 INCHES FROM ANY VERTICAL SURFACE AND 10 FEET FROM ANY OUTSIDE AIR INTAKES.
- CONNECTION BETWEEN INCOMPATIBLE MATERIALS ABOVE GRADE AND INSIDE BUILDING SHALL BE MADE WITH TWO (2) DIELECTRIC UNIONS SEPARATED BY A TWELVE INCH (12") SECTION OF RED BRASS PIPE.
- ALL CLEANOUTS SHALL BE INSTALLED WHERE READILY ACCESSIBLE. THE CONTRACTOR SHALL COORDINATE ALL CLEANOUT LOCATIONS WITH EQUIPMENT, CABINETS, ETC., AND THE ARCHITECT PRIOR TO ANY INSTALLATION.
- ALL PLUMBING WORK SHALL BE INSTALLED SO AS TO AVOID INTERFERENCE WITH ELECTRICAL AND MECHANICAL EQUIPMENT AND STRUCTURAL FRAMING.
- ALL WORK AND MATERIAL SHALL BE PERFORMED AND INSTALLED IN COMPLIANCE WITH CALIFORNIA PLUMBING CODE 2013.
- ANY ALTERATIONS TO A STRUCTURAL MEMBER, SUCH AS CUTTING, BORING, BRAZING, DRILLING, WELDING, ETC. SHALL HAVE PRIOR WRITTEN APPROVAL OF ARCHITECT AND STRUCTURAL ENGINEER.
- INSULATION (SEE SPECIFICATION FOR TYPE REQUIRED) AND COVERING ON PIPE AND TUBING SHALL HAVE A FLAME SPREAD RATING NOT TO EXCEED 25 AND A SMOKE DENSITY NOT TO EXCEED 50 WHEN TESTED IN ACCORDANCE WITH 2013 U.B.C. STANDARD NO. 8-1.
- THE SEISMIC ANCHORAGE OF MECHANICAL AND ELECTRIC EQUIPMENT SHALL CONFORM TO ASCE 7-05 CHAPTER 13 TITLE 24 PART 5.

THE SEISMIC BRACING AND ANCHORAGE OF PIPING AND EQUIPMENT SHALL CONFORM TO SEISMIC HAZARD LEVEL "AA" TYPICAL AND BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE "GUIDELINES FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS AND PLUMBING SYSTEMS" PUBLISHED BY SMACNA WITH SUPPLEMENT 2000 AND APPROVED BY THE DSA.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 03-119661 INC:
REVIEWED FOR
SS FLS ACS
DATE: 10/25/2019

RFHC
RF Hawkins Consulting

2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rfhawkinsconsulting.com

CONSULTANT

pais
consulting group
18 Pine Hill Lane
Ladera Ranch, CA 92694
phone: 949.610.9675



HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221

NO	DATE	BY	DESCRIPTION

REVISIONS

DRAWN: IZ CHECKED: IP
DATE: 8/31/2018 SCALE: AS NOTED
PROJECT NUMBER: 17-302

**PLUMBING GENERAL
NOTES, LEGEND &
DETAILS**

DRAWING NUMBER : **P0.1**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
 RF Hawkins Consulting


2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT



pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675




HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

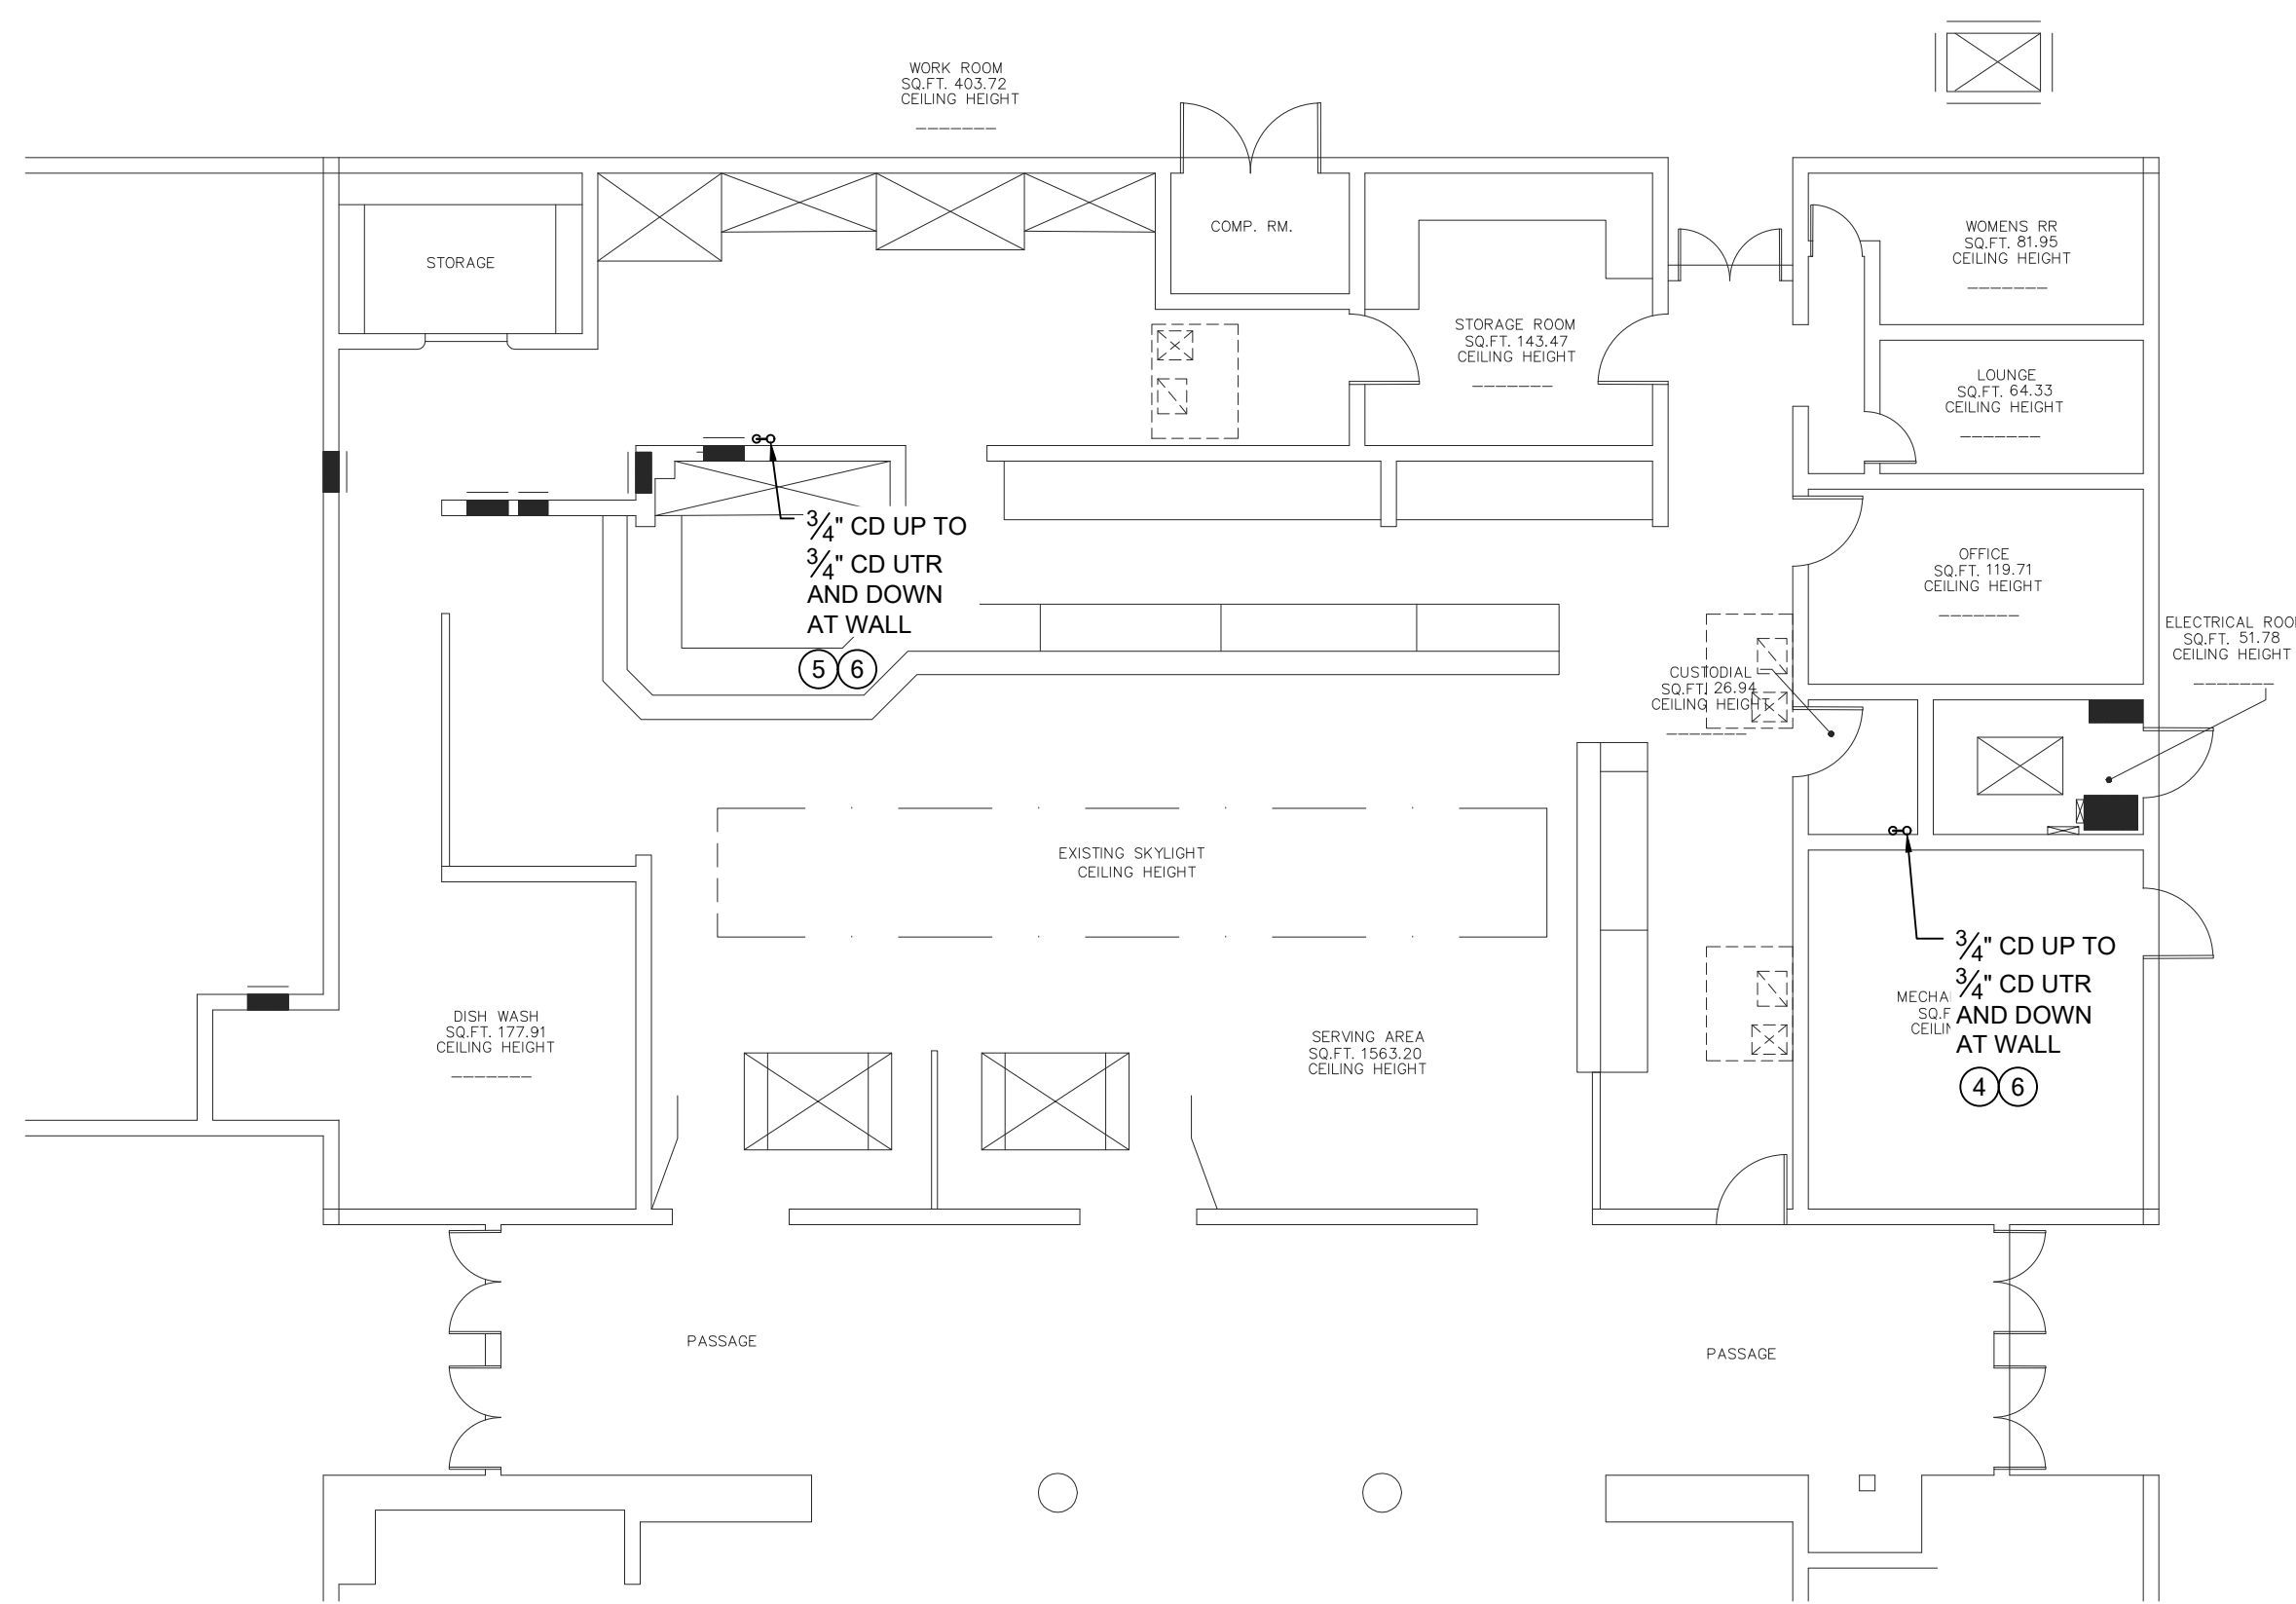

1 Plumbing Floor Plan
 SCALE: 1/8" = 1'-0"

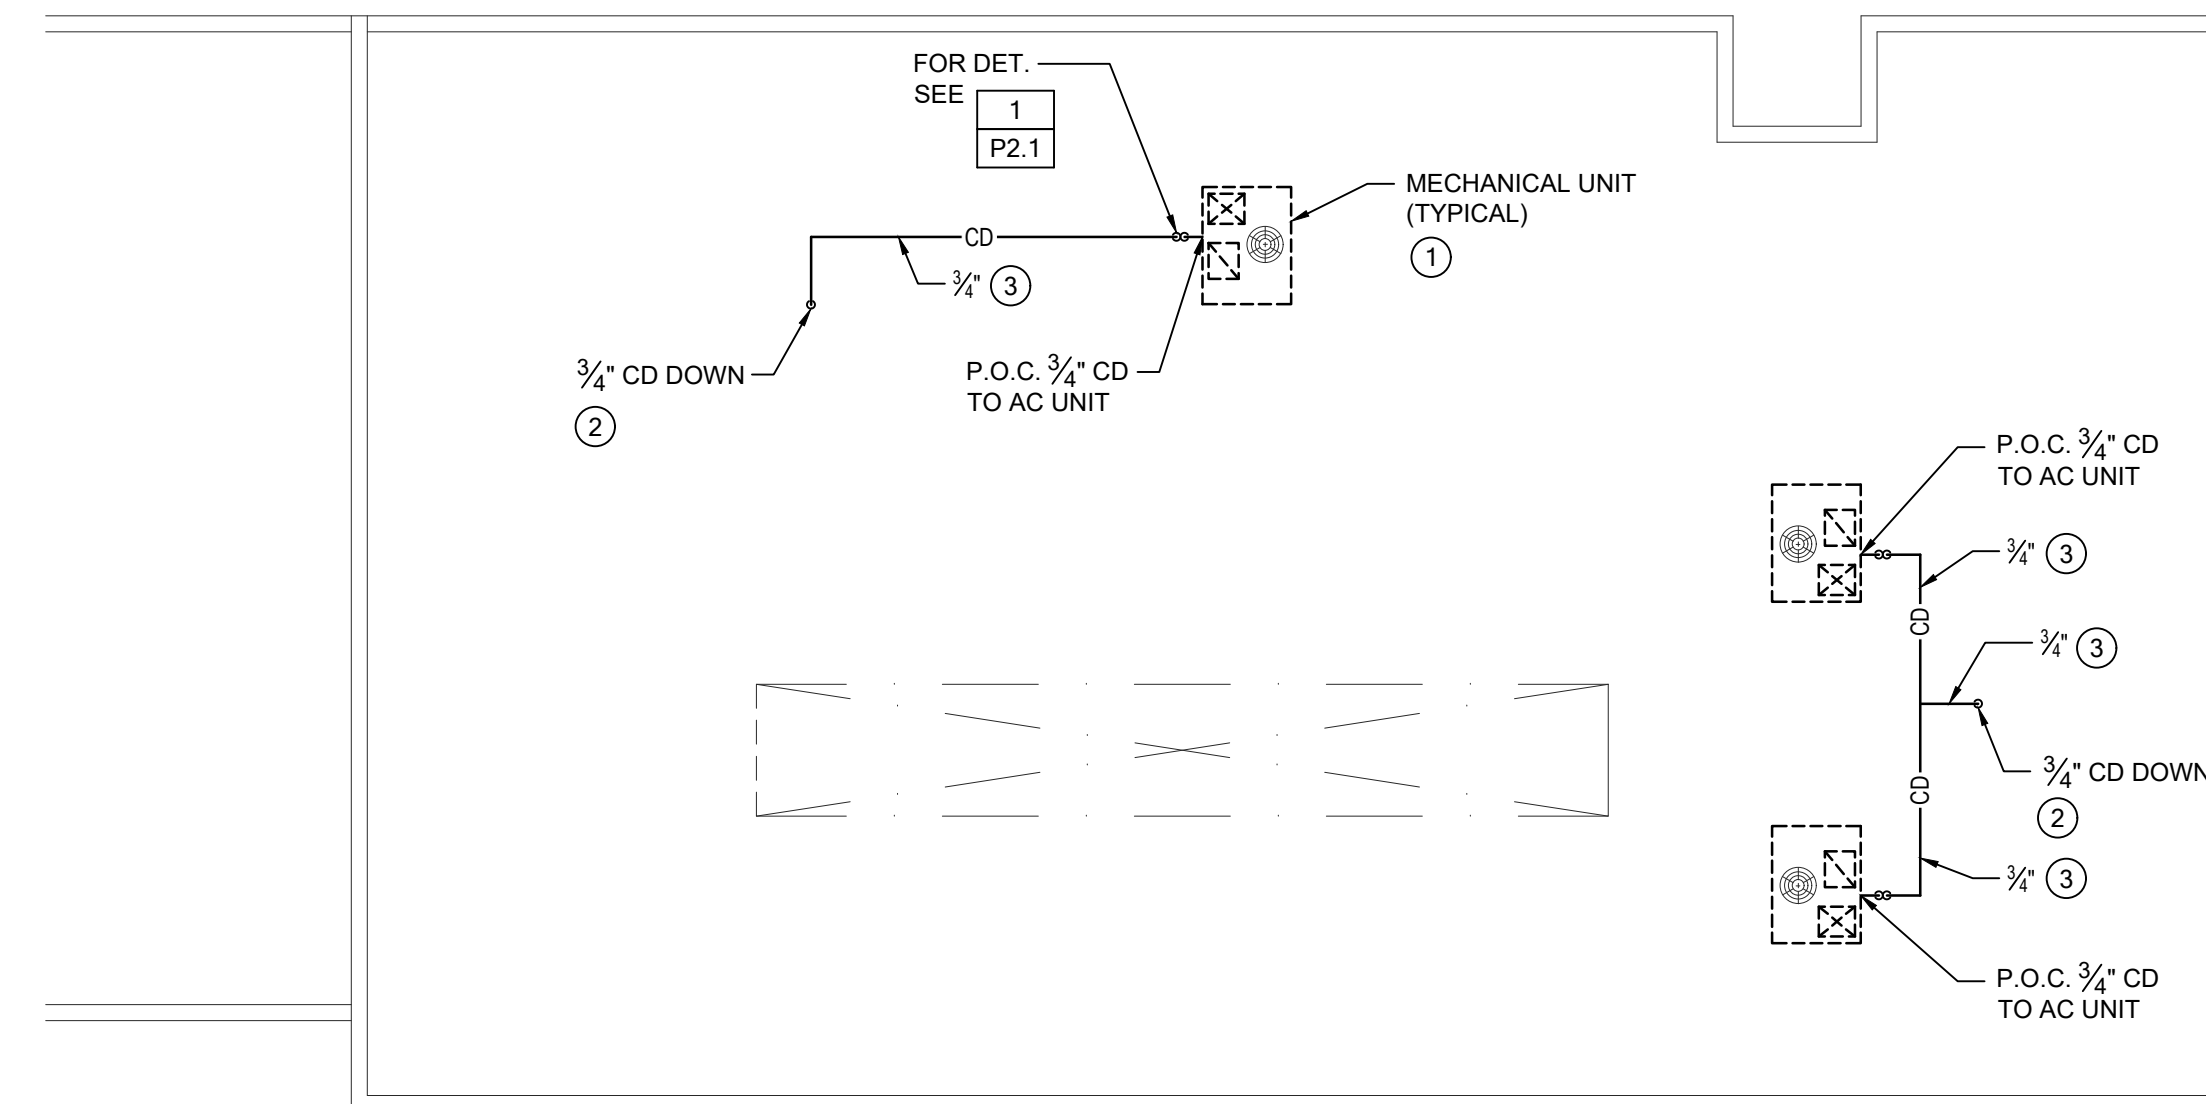

2 Plumbing Roof Plan
 SCALE: 1/8" = 1'-0"



PLAN NOTES:

- BEFORE COMMENCEMENT OF WORK, THE PLUMBING CONTRACTOR SHALL VERIFY THE EXACT LOCATIONS, ELEVATIONS AND CHARACTERISTICS OF ALL UTILITIES AND PIPING BY PHYSICAL EXCAVATION, AND SHALL IMMEDIATELY NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- CONTRACTOR SHALL FIELD VERIFY ALL EXISTING UTILITIES AND POINTS OF CONNECTION PRIOR TO BIDDING THE PROJECT.
- WHERE PLANS INDICATE NEW FIXTURES OR EQUIPMENT CONNECTING TO EXISTING SERVICES, THE PLUMBING CONTRACTOR SHALL MODIFY AND/OR EXTEND EXISTING PIPING OR ROUGH-INS AS REQUIRED TO ACCOMMODATE THE NEW FIXTURE.
- ALL SLEEVES THRU MASONRY WALLS AND FOOTINGS SHALL BE MINIMUM TWO PIPES SIZES LARGER THAN THE PIPE GOING THRU IT, PROVIDE ALL SLEEVES.
- ALL CONDENSATE DRAIN PIPING ABOVE CEILING SHALL SLOPE AT 1% UNLESS OTHERWISE NOTED.

KEY PLAN NOTES:

- NEW ROOF-TOP MECHANICAL UNIT. REFER TO MECHANICAL DRAWINGS FOR LOCATION.
- CONDENSATE DRAIN PIPING DOWN THRU ROOF. FLASH AND COUNTERFLASH ROOF PENETRATION WATER PROOF.
- PIPE ON ROOF. EXACT LOCATION MUST BE VERIFIED AND DETERMINED IN FIELD AND COORDINATED WITH EXISTING ROOF COMPONENTS. PROVIDE ROOF PIPE SUPPORT TO PROVIDE A CONTINUOUS, UNIFORM PIPE SLOPE OF MIN 1%.
- 3/4" CONDENSATE DRAIN PIPING UP AND DOWN SECURED AT WALL. TERMINATE DAYLIGHT WITH TURNDOWN ELBOW AT MOP SINK WITH 2" AIR GAP.
- 3/4" CONDENSATE DRAIN PIPING UP AND DOWN SECURED AT WALL. TERMINATE DAYLIGHT WITH TURNDOWN ELBOW AT FLOOR SINK WITH 2" AIR GAP.
- EXACT LOCATION MUST BE VERIFIED AND DETERMINED IN FIELD AND COORDINATED WITH EXISTING FLOOR/SERVICE SINK AND EXISTING WALL INSTALLED EQUIPMENT.

△			
△			
△			
△			
NO	DATE	BY	DESCRIPTION

REVISIONS

DRAWN: IZ	CHECKED: IP
DATE: 8/31/2018	SCALE: AS NOTED
PROJECT NUMBER: 17-302	

PLUMBING PLANS

DRAWING NUMBER : **P1.1**


IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT

pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675

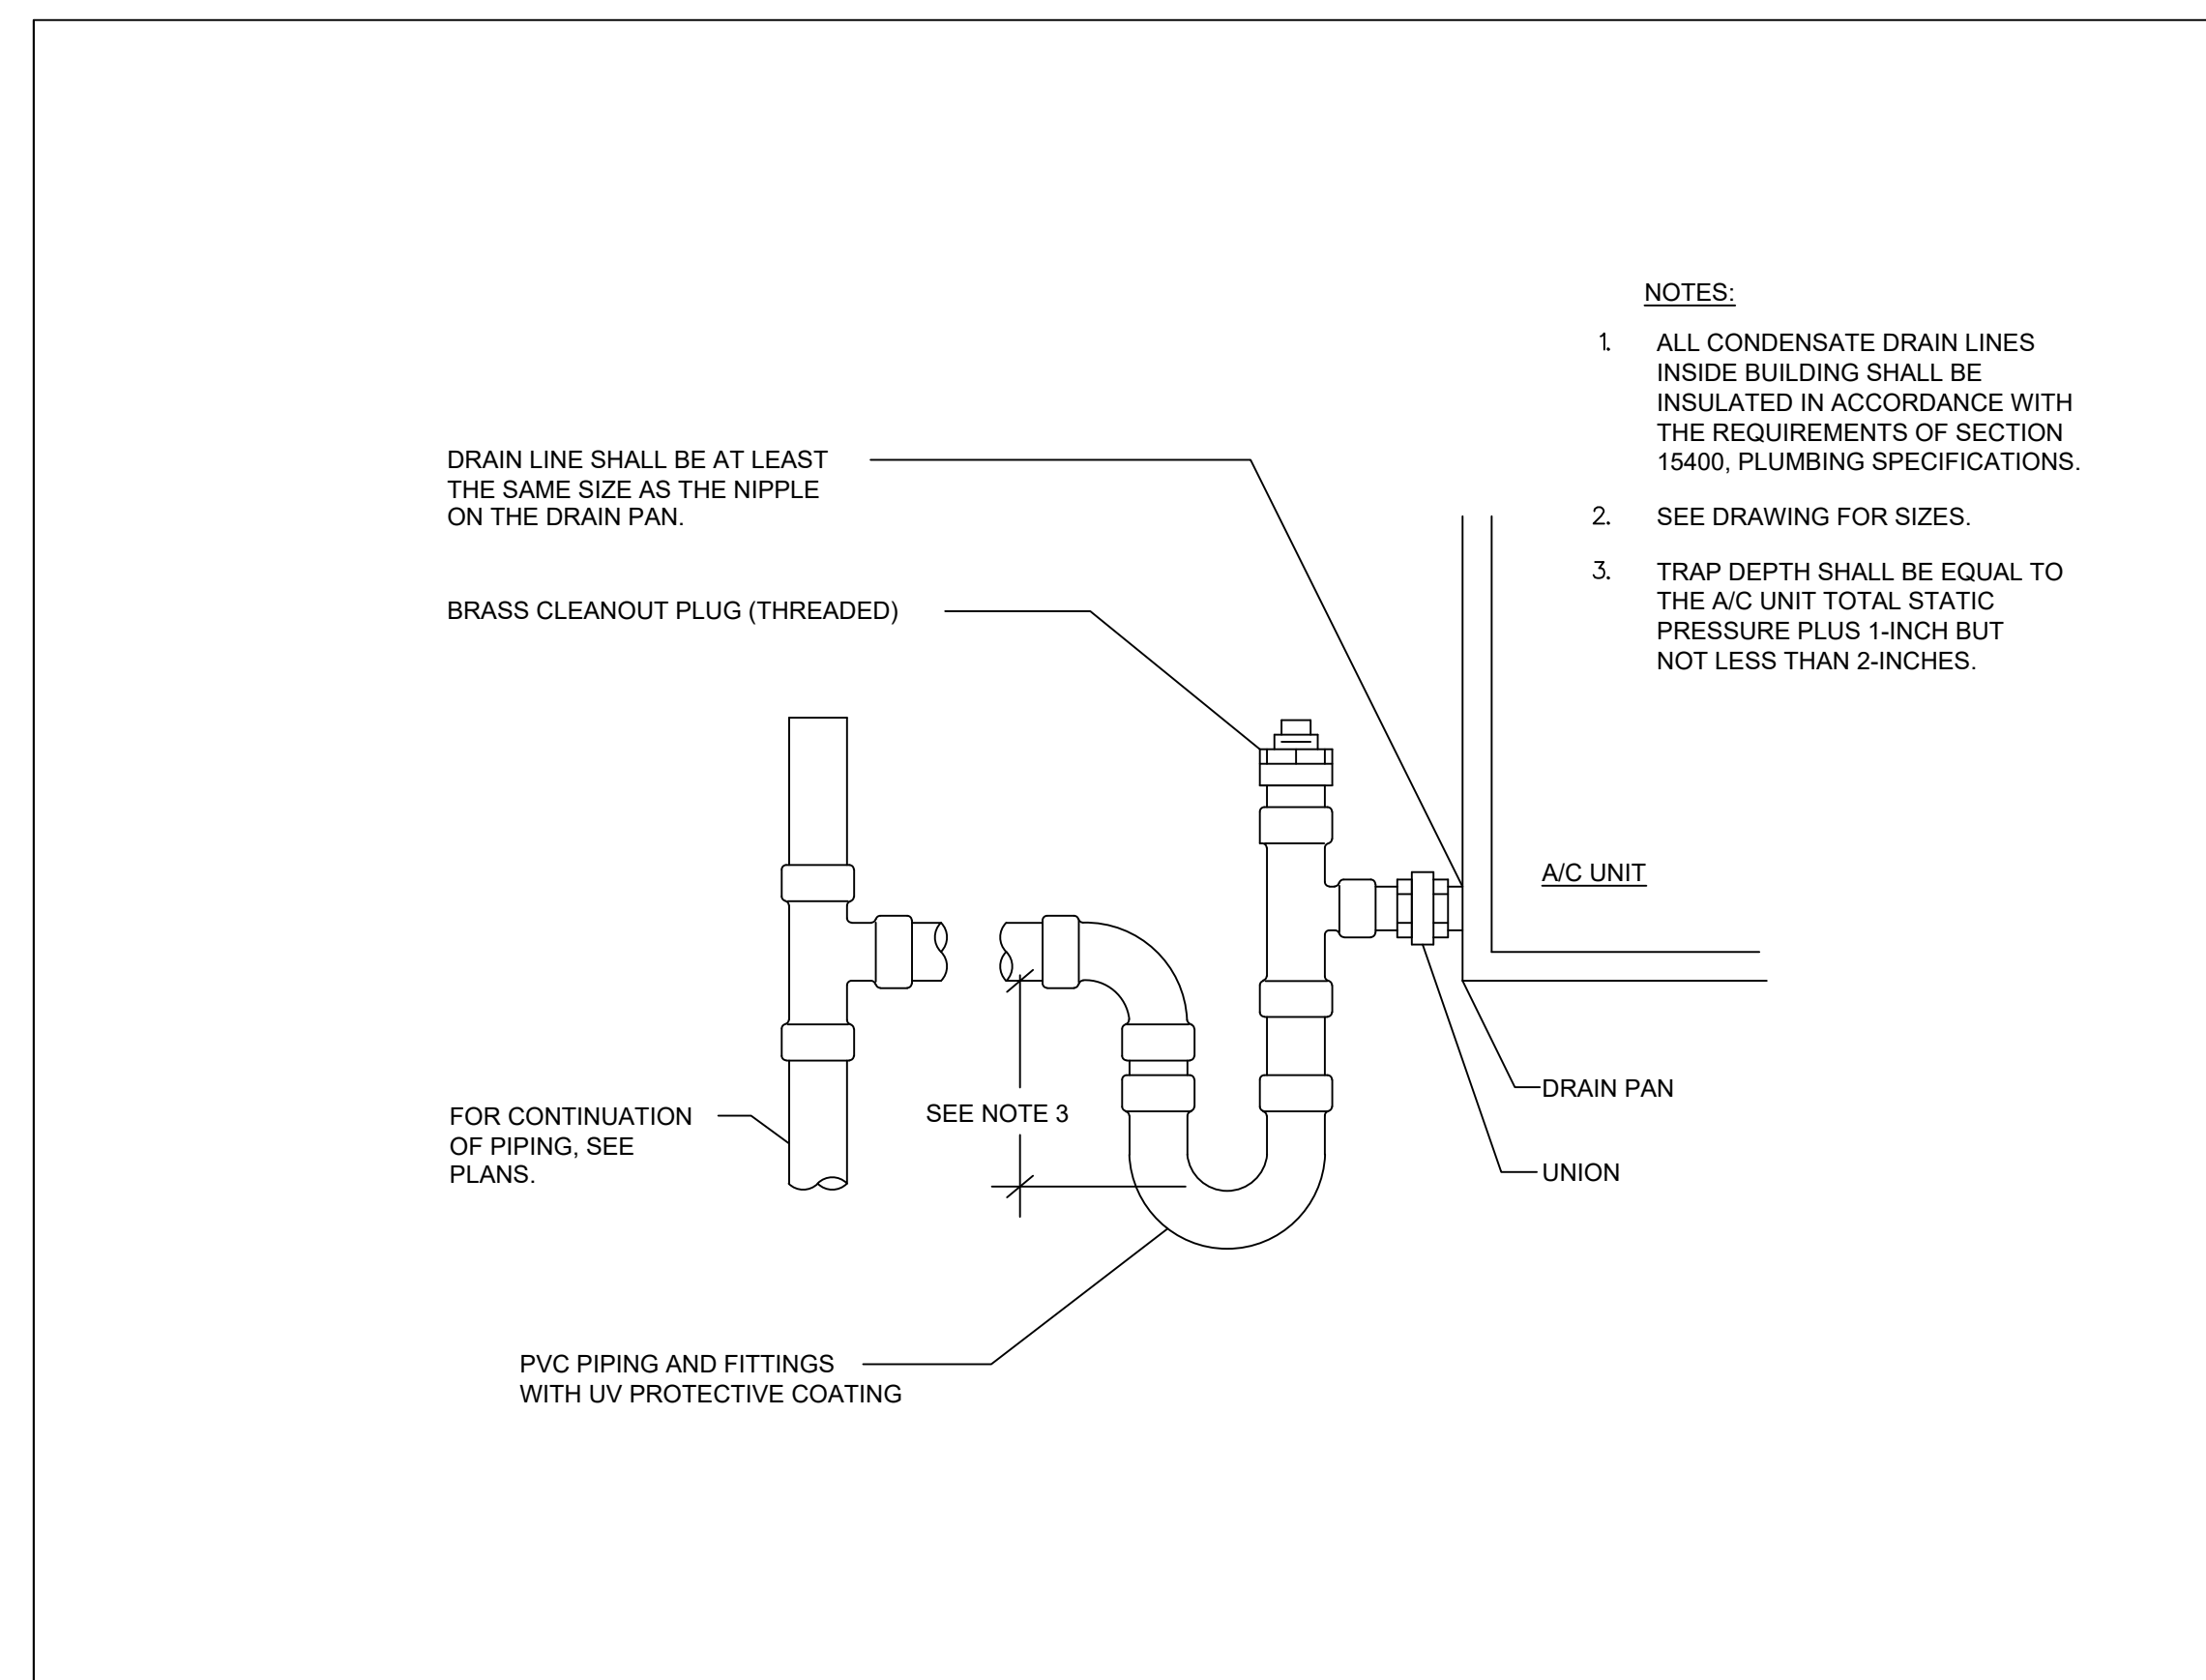

- NOTES:**
1. ALL CONDENSATE DRAIN LINES INSIDE BUILDING SHALL BE INSULATED IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 15400, PLUMBING SPECIFICATIONS.
 2. SEE DRAWING FOR SIZES.
 3. TRAP DEPTH SHALL BE EQUAL TO THE A/C UNIT TOTAL STATIC PRESSURE PLUS 1-INCH BUT NOT LESS THAN 2-INCHES.

CONDENSATE TRAP DETAIL

SCALE	1
NONE	

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

△			
△			
△			
△			
NO	DATE	BY	DESCRIPTION


REVISIONS

DRAWN:	IZ	CHECKED:	IP
DATE:	8/31/2018	SCALE:	AS NOTED
PROJECT NUMBER:	17-302		

**PLUMBING
 DETAILS**

DRAWING NUMBER : **P2.1**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

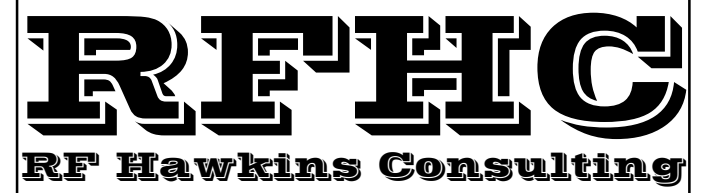


2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
next step
 DESIGN, INC
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 218-3399
 FAX: (949) 457-9375
 NSD JOB # 16-208



HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

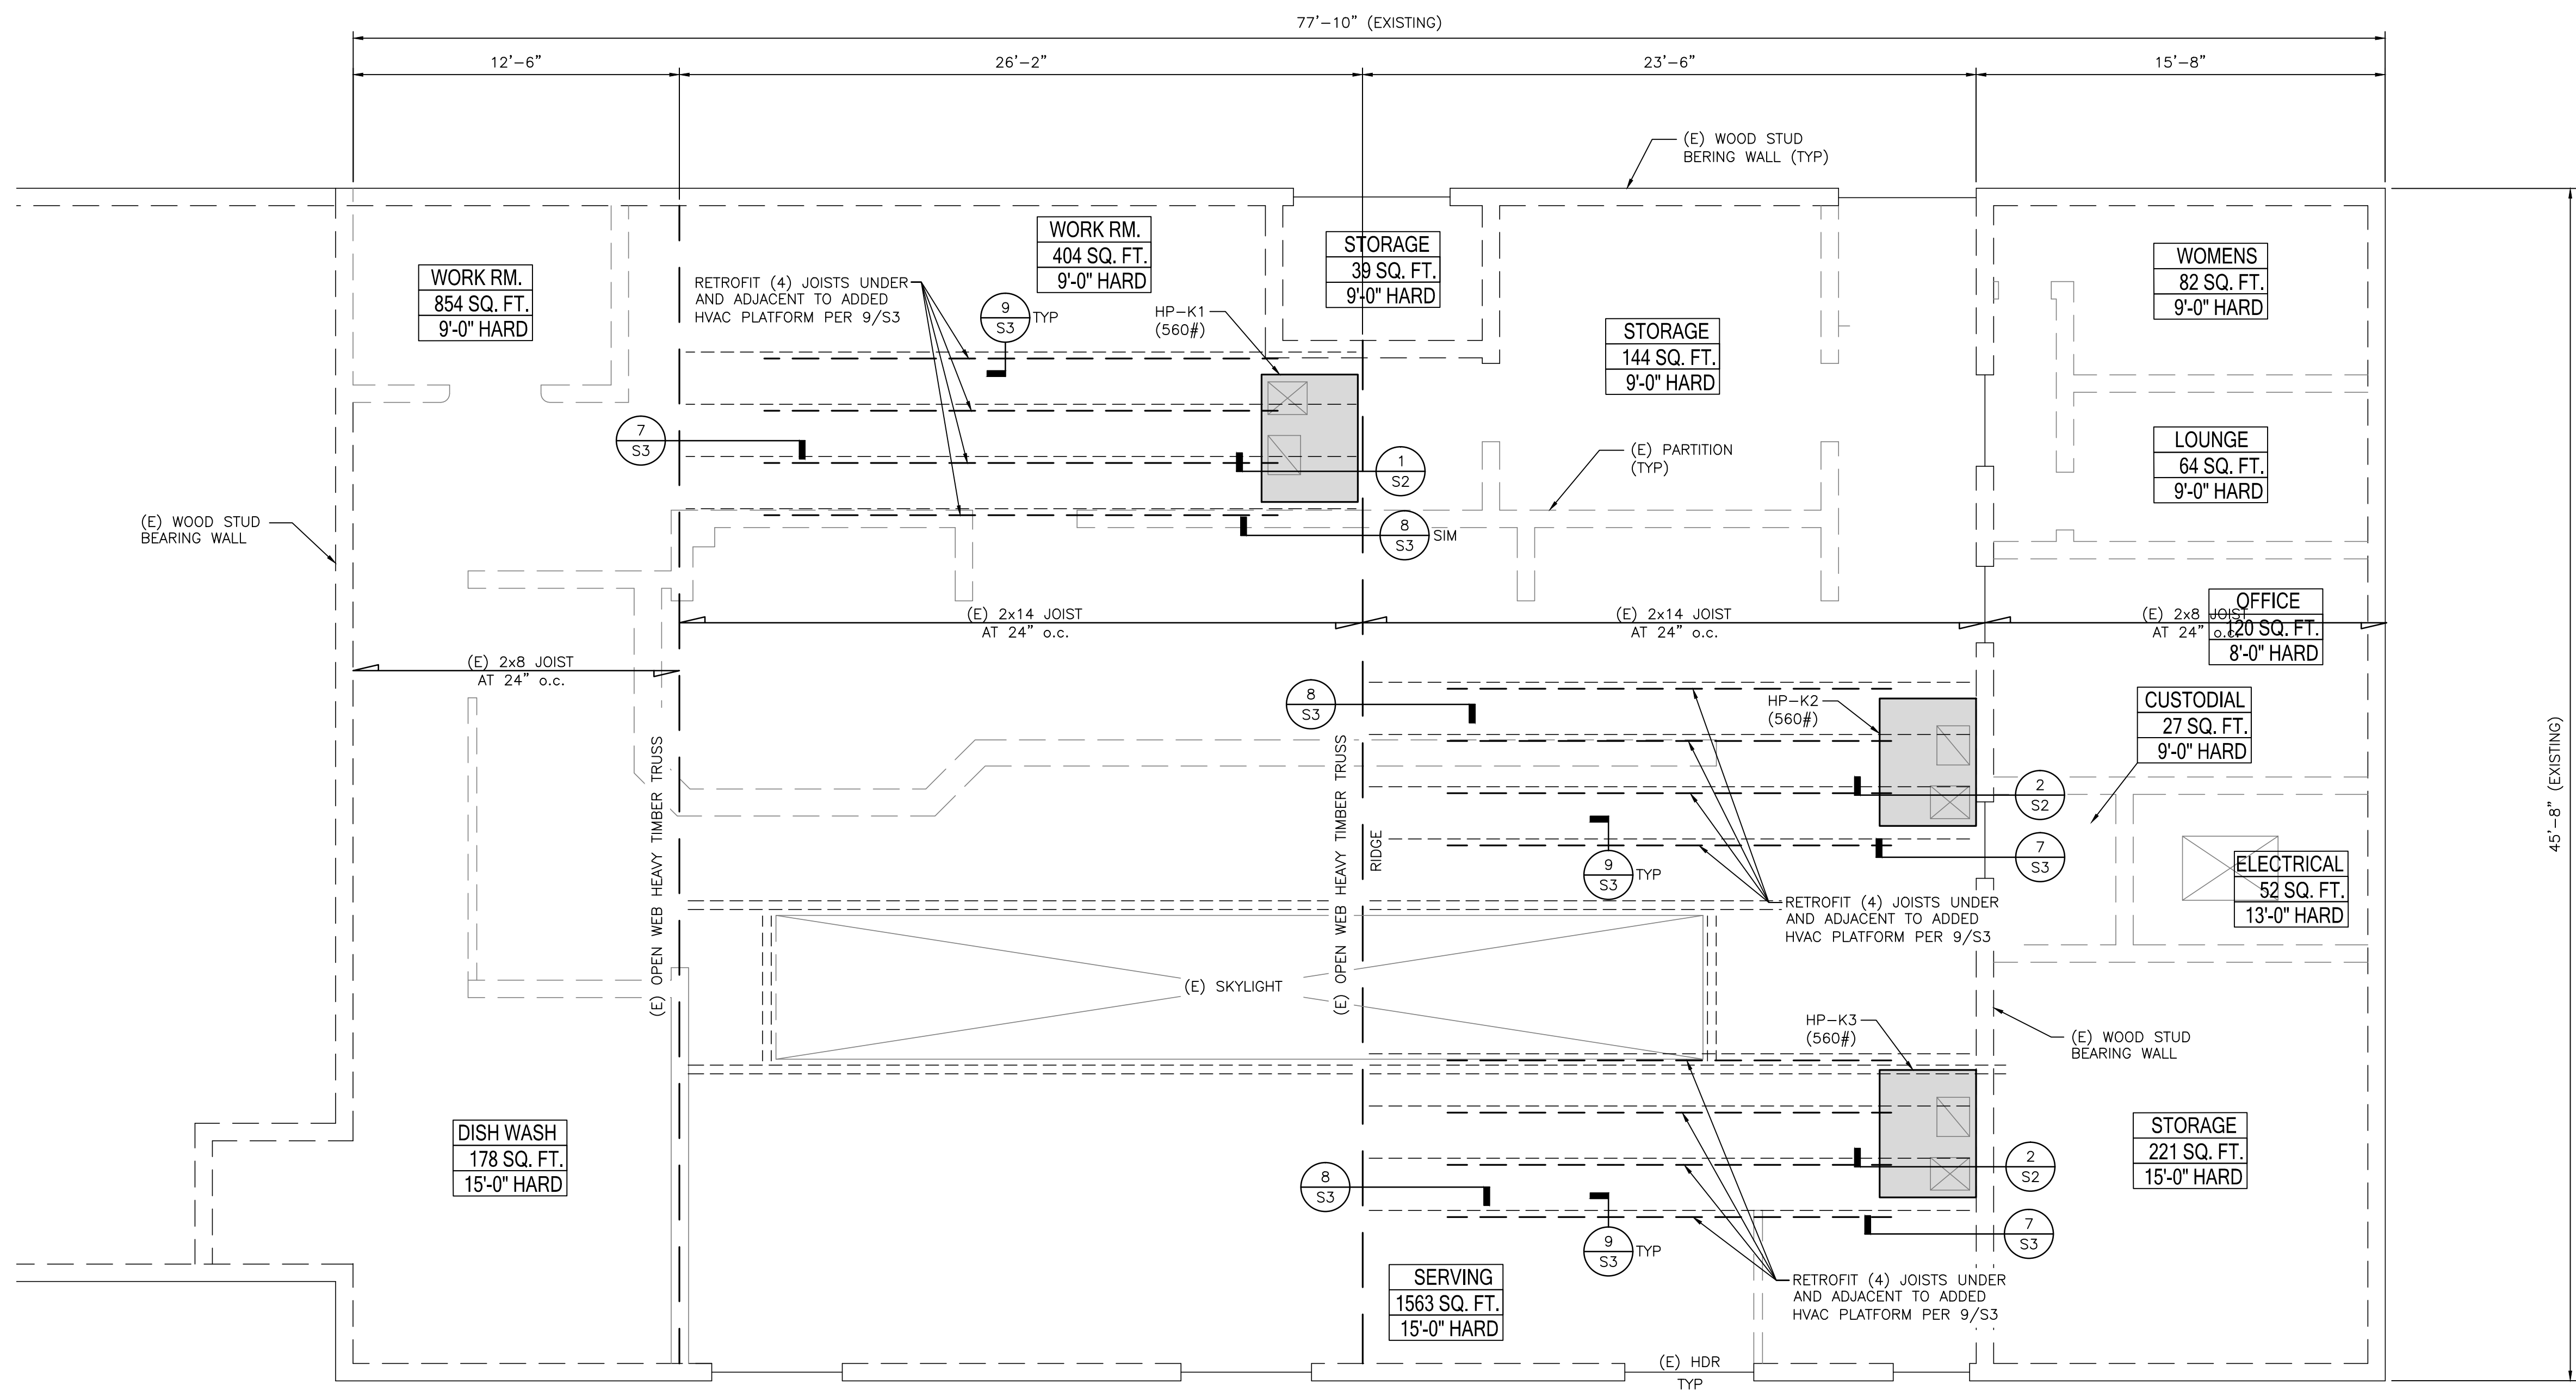

△	02/25/19	SB	100% CD
△			
△			
△			
NO	DATE	BY	DESCRIPTION

REVISIONS

DRAWN: GMB	CHECKED: SB
DATE: 02/25/19	SCALE: AS NOTED
PROJECT NUMBER: 17-301	

ROOF FRAMING PLAN

DRAWING NUMBER : **S-1**

GENERAL NOTES:

- DESIGN CRITERIA:
 - DESIGN CODE: 2016 CALIFORNIA BUILDING CODE (CBC)
 - S_s = 1.67 R = 6.5 OCCUPANCY CAT = 2
 - S_i = .611 C_s = .171 SITE CLASS = D
 - F_o = 1.00 RHO = 1.3 S.F.R.S. = I1 FRAMED WALLS WITH PLYWOOD
 - F_v = 1.50 V = .159xw ANALYSIS PROCEDURE = E.L.F.A.
 - SDS = 1.11 SDC = D WIND SPEED = 85 M.P.H. (A.S.D.)
 - SD1 = .611 I = 1.5 WIND EXPOSURE = B
- ALL MATERIALS AND WORK PERFORMED SHALL CONFORM WITH THE REQUIREMENTS OF THE 2016 CBC AND GOVERNING BUILDING ORDINANCES.
- NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER THESE GENERAL NOTES.
- WHERE A SECTION OR TYPICAL DETAIL IS SHOWN FOR ONE CONDITION, IT SHALL APPLY FOR ALL LIKE OR SIMILAR CONDITIONS UNLESS OTHERWISE NOTED.
- NO CHANGES ARE TO BE MADE TO THESE PLANS WITHOUT THE KNOWLEDGE AND WRITTEN CONSENT OF THIS ENGINEER. UNAUTHORIZED CHANGES RENDER THESE DRAWINGS VOID.
- ANY REFERENCE TO THE WORDS APPROVED, OR APPROVAL IN THESE DOCUMENTS SHALL BE HERE DEFINED TO MEAN GENERAL ACCEPTANCE OR REVIEW AND SHALL NOT RELIEVE THE CONTRACTOR AND/OR HIS SUB-CONTRACTORS OF ANY LIABILITY IN FURNISHING THE REQUIRED MATERIALS OR LABOR SPECIFIED.
- THE CONTRACT DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE AND DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK AND SHALL BE SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES INCLUDING BUT, NOT LIMITED TO BRACING & SHORING. OBSERVATION VISITS TO THE SITE BY FIELD REPRESENTATIVES OF THE ARCHITECT OR ENGINEER SHALL NOT INCLUDE INSPECTIONS OF THE PROTECTIVE MEASURES OR THE CONSTRUCTION PROCEDURES.
- GENERAL CONTRACTOR SHALL VISIT THE JOB SITE AND VERIFY ALL GRADES, DIMENSIONS, AND CONDITIONS PRIOR TO BIDDING AND COMMENCING CONSTRUCTION. ALL DIMENSIONS CONTROLLED BY EXISTING CONDITIONS SHALL BE VERIFIED BY THE CONTRACTOR AT THE SITE.
- IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO LOCATE ALL EXISTING UTILITIES WHETHER SHOWN HEREON OR NOT, AND TO PROTECT THEM FROM DAMAGE. THE CONTRACTOR SHALL BEAR ALL EXPENSE OF REPAIR OR REPLACEMENT IN CONJUNCTION WITH THE EXECUTION OF THIS WORK.
- GENERAL CONTRACTOR SHALL NOTIFY THE ENGINEER AND ARCHITECT IMMEDIATELY OF ANY DISCREPANCIES FOUND WITHIN THE CONTRACT DOCUMENTS, PRIOR TO STARTING WORK.


FRAMING LUMBER:

- ALL VISUALLY GRADED FRAMING LUMBER SHALL CONFORM TO THE GRADING RULES SET FORTH BY THE WEST COAST LUMBER INSPECTION BUREAU (WCLIB) OR THE WESTERN WOOD PRODUCTS ASSOCIATION (WWPA). EACH PIECE SHALL BEAR THE GRADE STAMP OF AN APPROVED GRADING AGENCY, EXCEPT EXPOSED LUMBER SHALL BEAR NO MARKINGS WHICH WILL BE VISIBLE AFTER INSTALLATION.
- FRAMING LUMBER SHALL BE DOUGLAS FIR-LARCH, UNLESS OTHERWISE NOTED. 2x AND 4x SAWN LUMBER SHALL HAVE A MOISTURE CONTENT NOT MORE THAN 19% AT TIME OF FABRICATION. THE FOLLOWING GRADES SHALL BE THE MINIMUM ACCEPTABLE GRADES, UNLESS OTHERWISE NOTED.

ITEM	MINIMUM GRADE
STUDS:	
2" THICK, 4" WIDE (STUD HT = 8'-1" MAX).....	NO. 2
2" THICK, 4" TO 6" WIDE.....	NO. 2
STRUCTURAL JOISTS AND LIGHT FRAMING:	
2" TO 4" THICK, 4" AND WIDER.....	NO. 1
BEAMS AND STRINGERS:	
5" AND THICKER, 6" AND WIDER.....	NO. 1
POST AND TIMBERS:	
5" x 5" AND LARGER.....	NO. 1
- STRUCTURAL PLYWOOD SHALL CONFORM TO U.S. PRODUCT STANDARD PS 1-07. STRUCTURAL USE PANELS SHALL CONFORM TO PS 2-04 (APA PRP-108). APA GRADE STAMP SHALL BE PROVIDED ON ALL SHEATHING. SHEATHING SHALL BE EXPOSURE 1 (EXTERIOR GLUE). INSTALL WITH FACE GRAIN ACROSS SUPPORTS EXCEPT WHERE NOTED ON PLANS OR DETAILS. PROVIDE GAPS AT ALL EDGES AS RECOMMENDED BY APA. ROOF AND FLOOR SHEATHING AND SHEAR WALL PANELS SHALL BE IN PLACE AND INSPECTED BY THE BUILDING OFFICIAL PRIOR TO COVERING.
- FRAMING HARDWARE SHALL BE SIMPSON "STRONG TIE" OR EQUAL, UNLESS OTHERWISE NOTED. SUBSTITUTIONS SHALL BEAR ICC APPROVAL.
- NAILING NOTES:
 - ALL NAILS SHALL BE COMMON NAILS IN CONFORMANCE WITH FEDERAL SPECIFICATION N-105B, UNLESS OTHERWISE SPECIFIED ON DRAWINGS. SINKERS SHALL NOT BE SUBSTITUTED UNLESS SPECIFICALLY APPROVED BY THIS ENGINEER.
 - ALL NAILS EXPOSED TO THE WEATHER SHALL BE GALVANIZED.
 - TOE NAILS SHALL BE DRIVEN AT AN ANGLE OF 30 DEGREES TO THE PIECE SURFACE AND BE STARTED AT 1/3 THE LENGTH FROM THE EDGE OF THE PIECE.
- WOOD SCREWS SHALL BE IN CONFORMANCE WITH A.N.S.I. B18.6.1.
- BOLTS AND LAG SCREWS SHALL CONFORM TO A.N.S.I. B18.2.1. ALL BOLTS THRU WALL SHALL HAVE STANDARD CUT WASHERS EXCEPT WHERE METAL SIDE PLATES ARE SPECIFIED. BOLT HOLES SHALL BE BORED 1/32" TO 1/16" LARGER THAN THE BOLT DIAMETER, UNLESS OTHERWISE NOTED. THE CONTRACTOR SHALL INSTALL A SIMPSON BP-5/8-S WITH (4) SDS 1/4 x 1 1/2 SCREWS AT ALL HOLES LARGER THAN 1/16" OVERSIZED AT NO ADDITIONAL COST. ALL BOLTS SHALL BE RETIGHTENED PRIOR TO APPLICATION OF PLASTER, PLYWOOD, ETC.
- ALL WOOD BEARING ON CONCRETE OR MASONRY IF LESS THAN 4'-0" ABOVE GRADE SHALL BE PRESSURE TREATED DOUGLAS FIR.
- STRUCTURAL MEMBERS SHALL NOT BE CUT FOR PIPES, ETC. UNLESS SPECIFICALLY NOTED OR DETAILED.

ABBREVIATIONS:


- | | | | |
|-------|--------------------------|-------|------------------------|
| AB | ANCHOR BOLT | ID | INSIDE DIAMETER |
| AFF | ABOVE FINISH FLOOR | MB | MACHINE BOLT |
| BLK | BLOCK | MFR | MANUFACTURER |
| BN | BOUNDARY NAILING | MIN | MINIMUM |
| BTM | BOTTOM | (N) | NEW |
| CJ | CEILING JOIST | NS | NEAR SIDE |
| CLR | CLEAR | NTS | NOT TO SCALE |
| CONC | CONCRETE | o.c. | ON CENTER |
| CONT | CONTINUOUS | OD | OUTSIDE DIAMETER |
| DIM | DIMENSION | OH | OPPOSITE HAND |
| DBL | DOUBLE | PLCS | PLACES |
| DF | DOUGLAS FIR | PLY | PLYWOOD |
| DIA | DIAMETER | PT | PRESSURE TREATED |
| (E) | EXISTING | REINF | REINFORCEMENT |
| EA. | EACH | REQ'D | REQUIRED |
| EN | EDGE NAILING | RR | ROOF RAFTER |
| EQ | EQUAL | SHT'G | SHEATHING |
| EQUIP | EQUIPMENT | SIM | SIMILAR |
| FDN | FOUNDATION | SO | SQUARE |
| FRP | FIBER REINFORCED PLASTIC | STD | STANDARD |
| FS | FAR SIDE | STIFF | STIFFENER |
| FTG | FOOTING | THK | THICK |
| GLB | GLU-LAM BEAM | T.O. | TOP OF |
| HD | HOLD DOWN | TS | TUBE STEEL |
| HORIZ | HORIZONTAL | TYP | TYPICAL |
| | | UON | UNLESS OTHERWISE NOTED |
| | | VERT | VERTICAL |

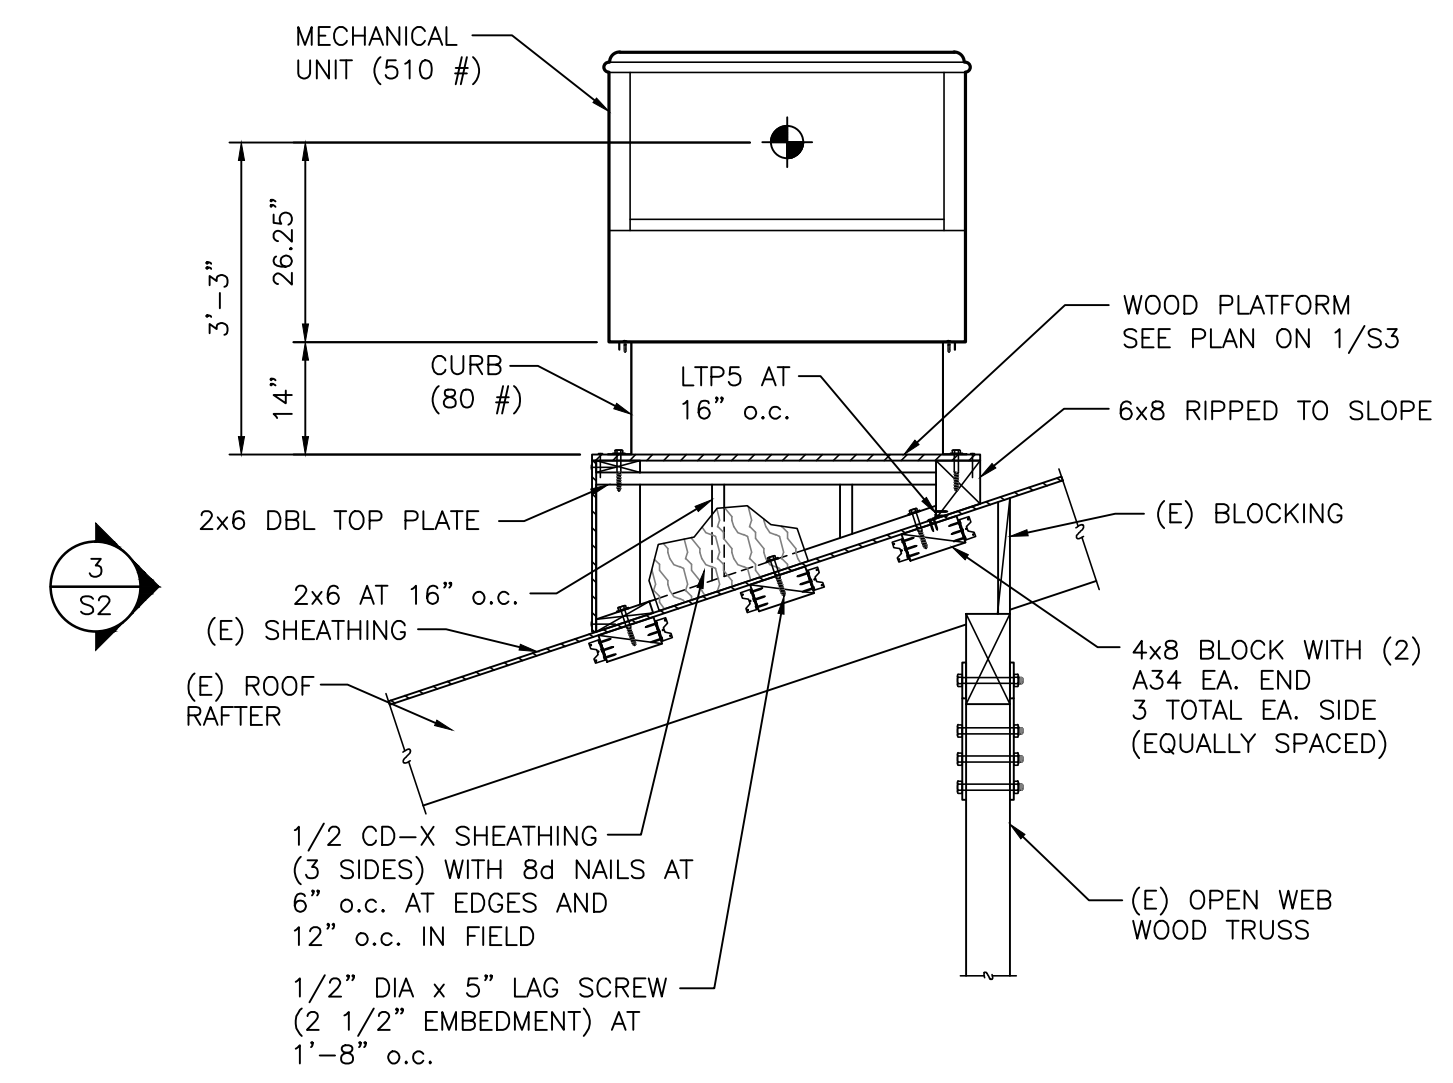

- NOTES:**
- SEE 2/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN TOP FLANGE OF PREFABRICATED CURB.
 - SEE 3/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN BTM FLANGE OF PREFABRICATED CURB.

PLATFORM FRAMING ELEVATION


1

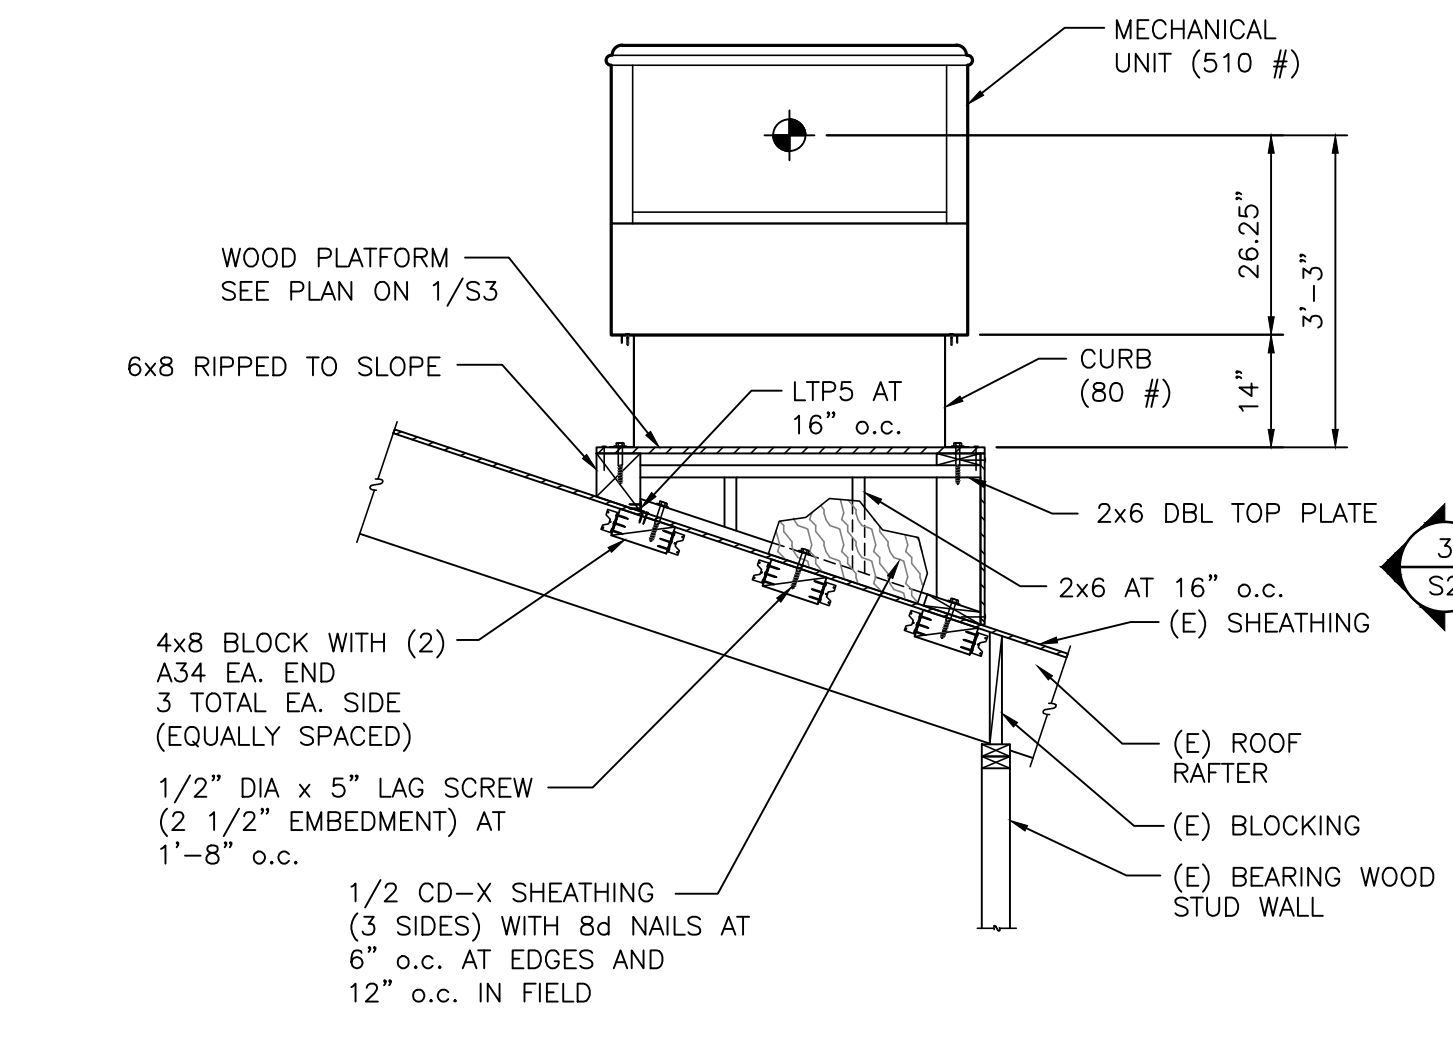

- NOTES:**
- SEE 2/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN TOP FLANGE OF PREFABRICATED CURB.
 - SEE 3/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN BTM FLANGE OF PREFABRICATED CURB.

PLATFORM FRAMING ELEVATION

2

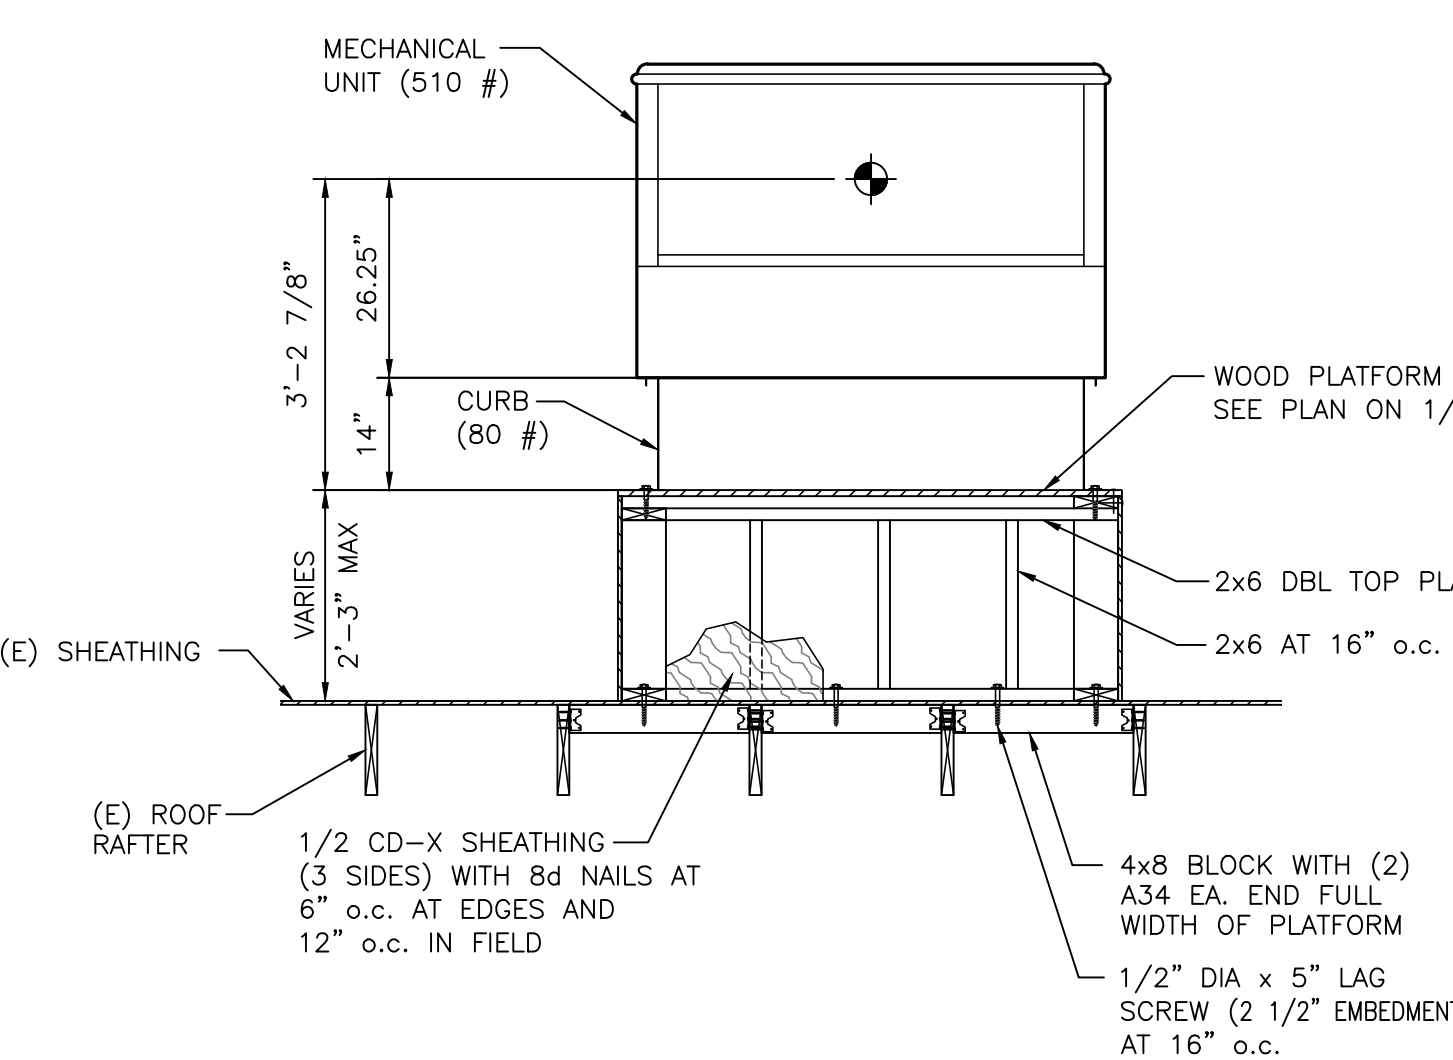

- NOTES:**
- SEE 2/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN TOP FLANGE OF PREFABRICATED CURB.
 - SEE 3/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN BTM FLANGE OF PREFABRICATED CURB.

CONSTRUCTION NOTES

PLATFORM FRAMING ELEVATION


3

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 03-119661 INC.
REVIEWED FOR
SS FLS ACS
DATE: 10/25/2019



2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rfhawkinsconsulting.com

CONSULTANT
next DESIGN, INC.
26170 ENTERPRISE WAY SUITE 400
LAKE FOREST, CA 92630
PHONE: (949) 218-3339
FAX: (949) 457-9375
NSD JOB # 16-208

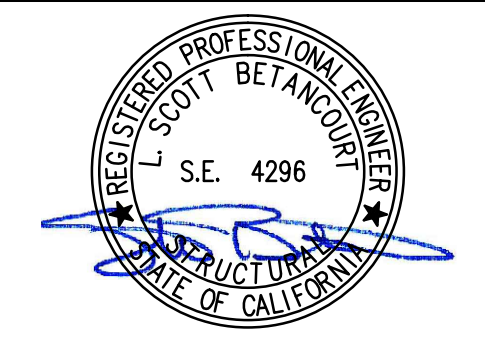

**HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221**


△	02/25/19	SB	100% CD
△			
△			
△			
NO	DATE	BY	DESCRIPTION

REVISIONS


DRAWN: GMB	CHECKED: SB
DATE: 02/25/19	SCALE: AS NOTED
PROJECT NUMBER: 17-301	

**CONSTRUCTION
DETAILS**


DRAWING NUMBER : **S-2**

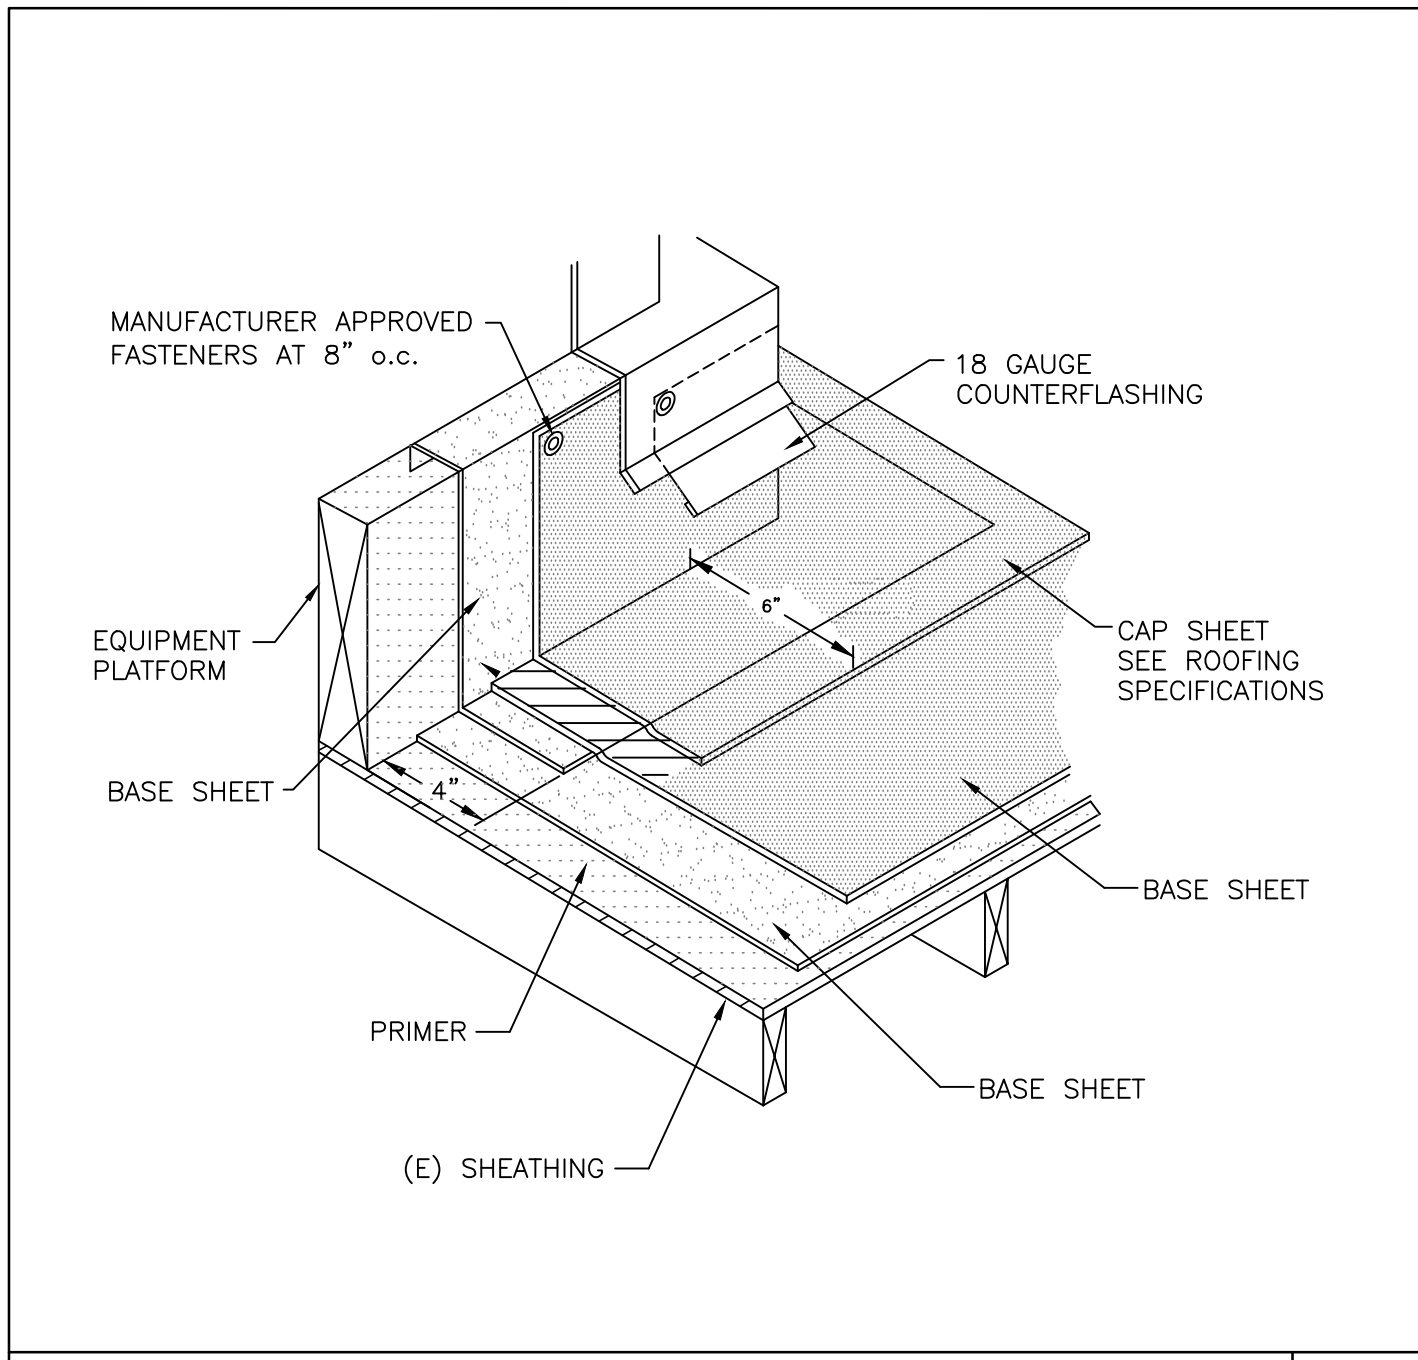

BUILT-UP ROOF AT PLATFORM

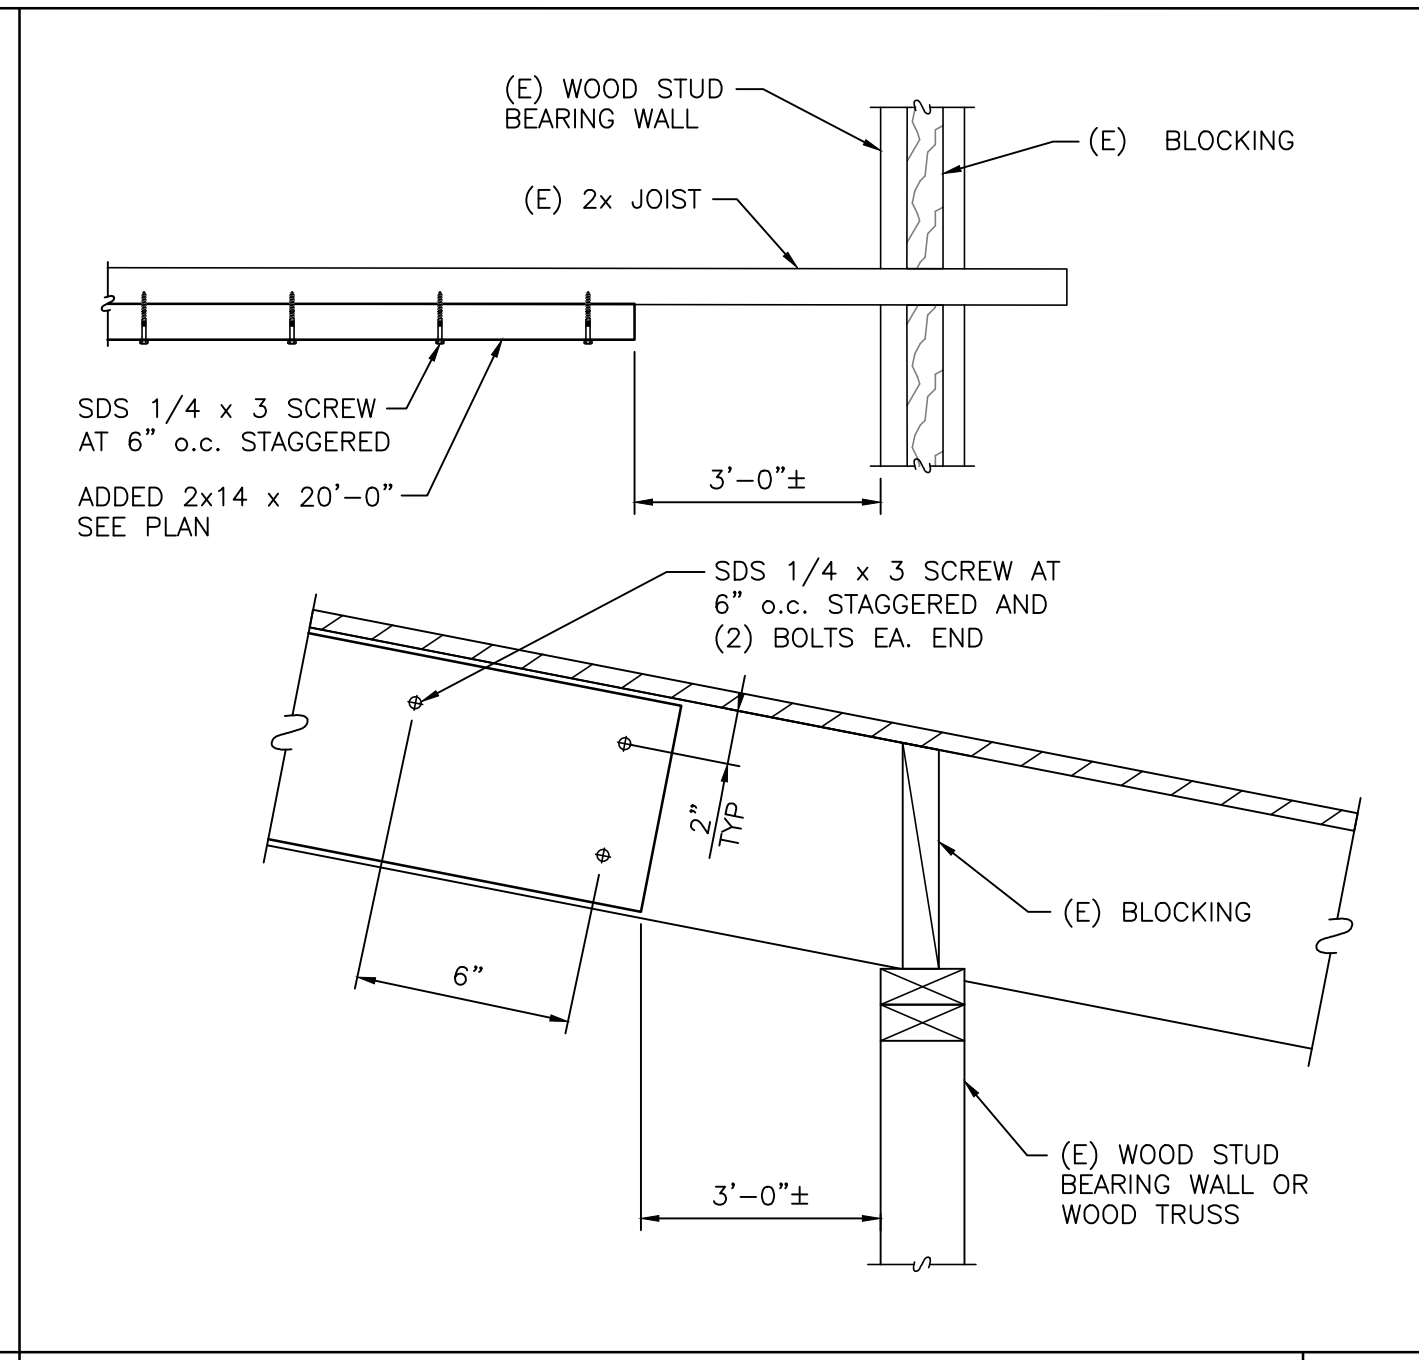

WOOD JOIST RETROFIT

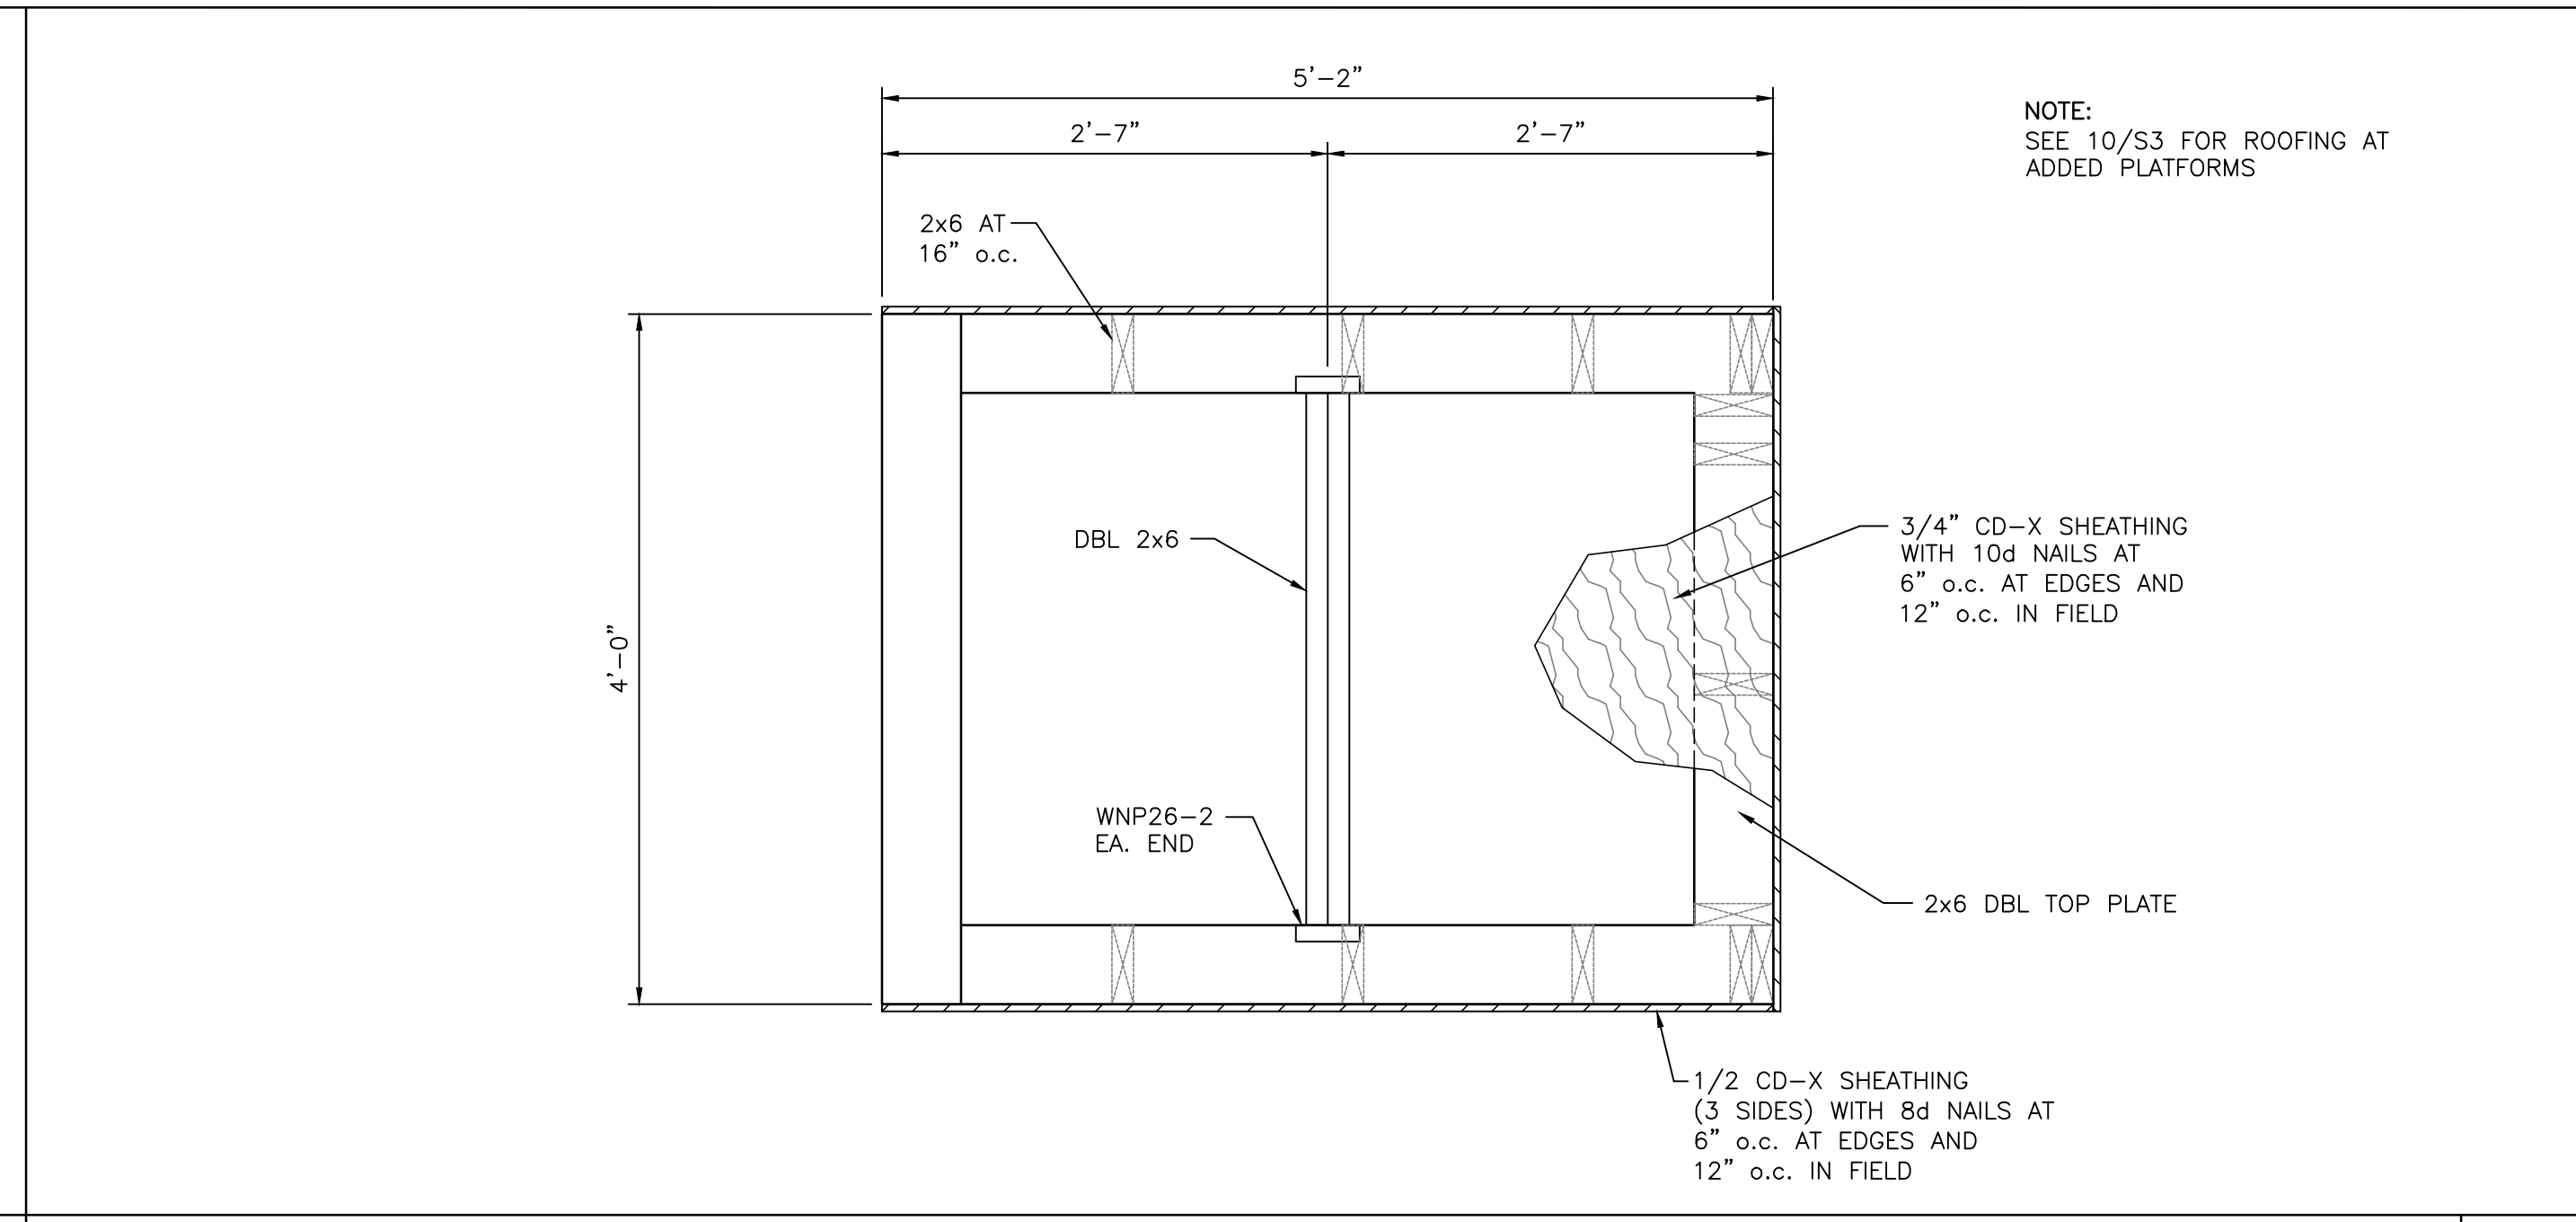

PLATFORM FRAMING PLAN


IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
RF Hawkins Consulting
 2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com


CONSULTANT
next step
DESIGN, INC
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 NSD JOB # 06-208



WOOD JOIST RETROFIT

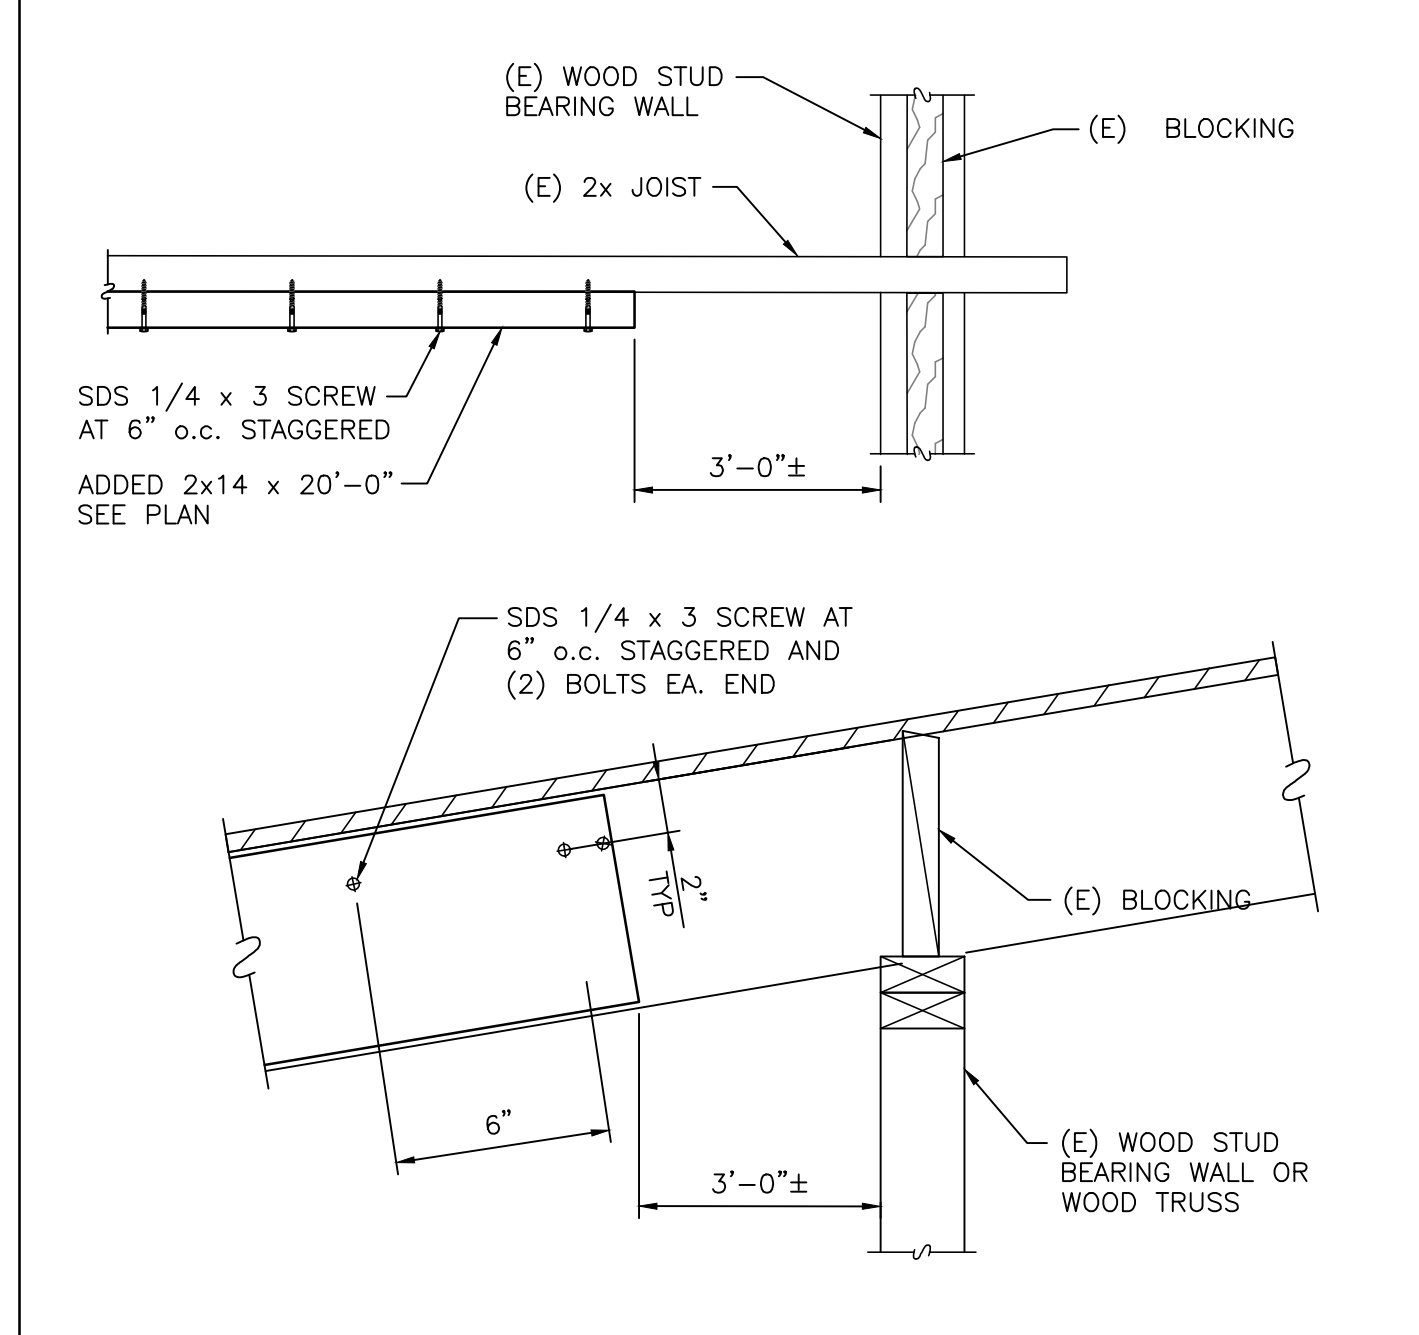


WOOD JOIST RETROFIT

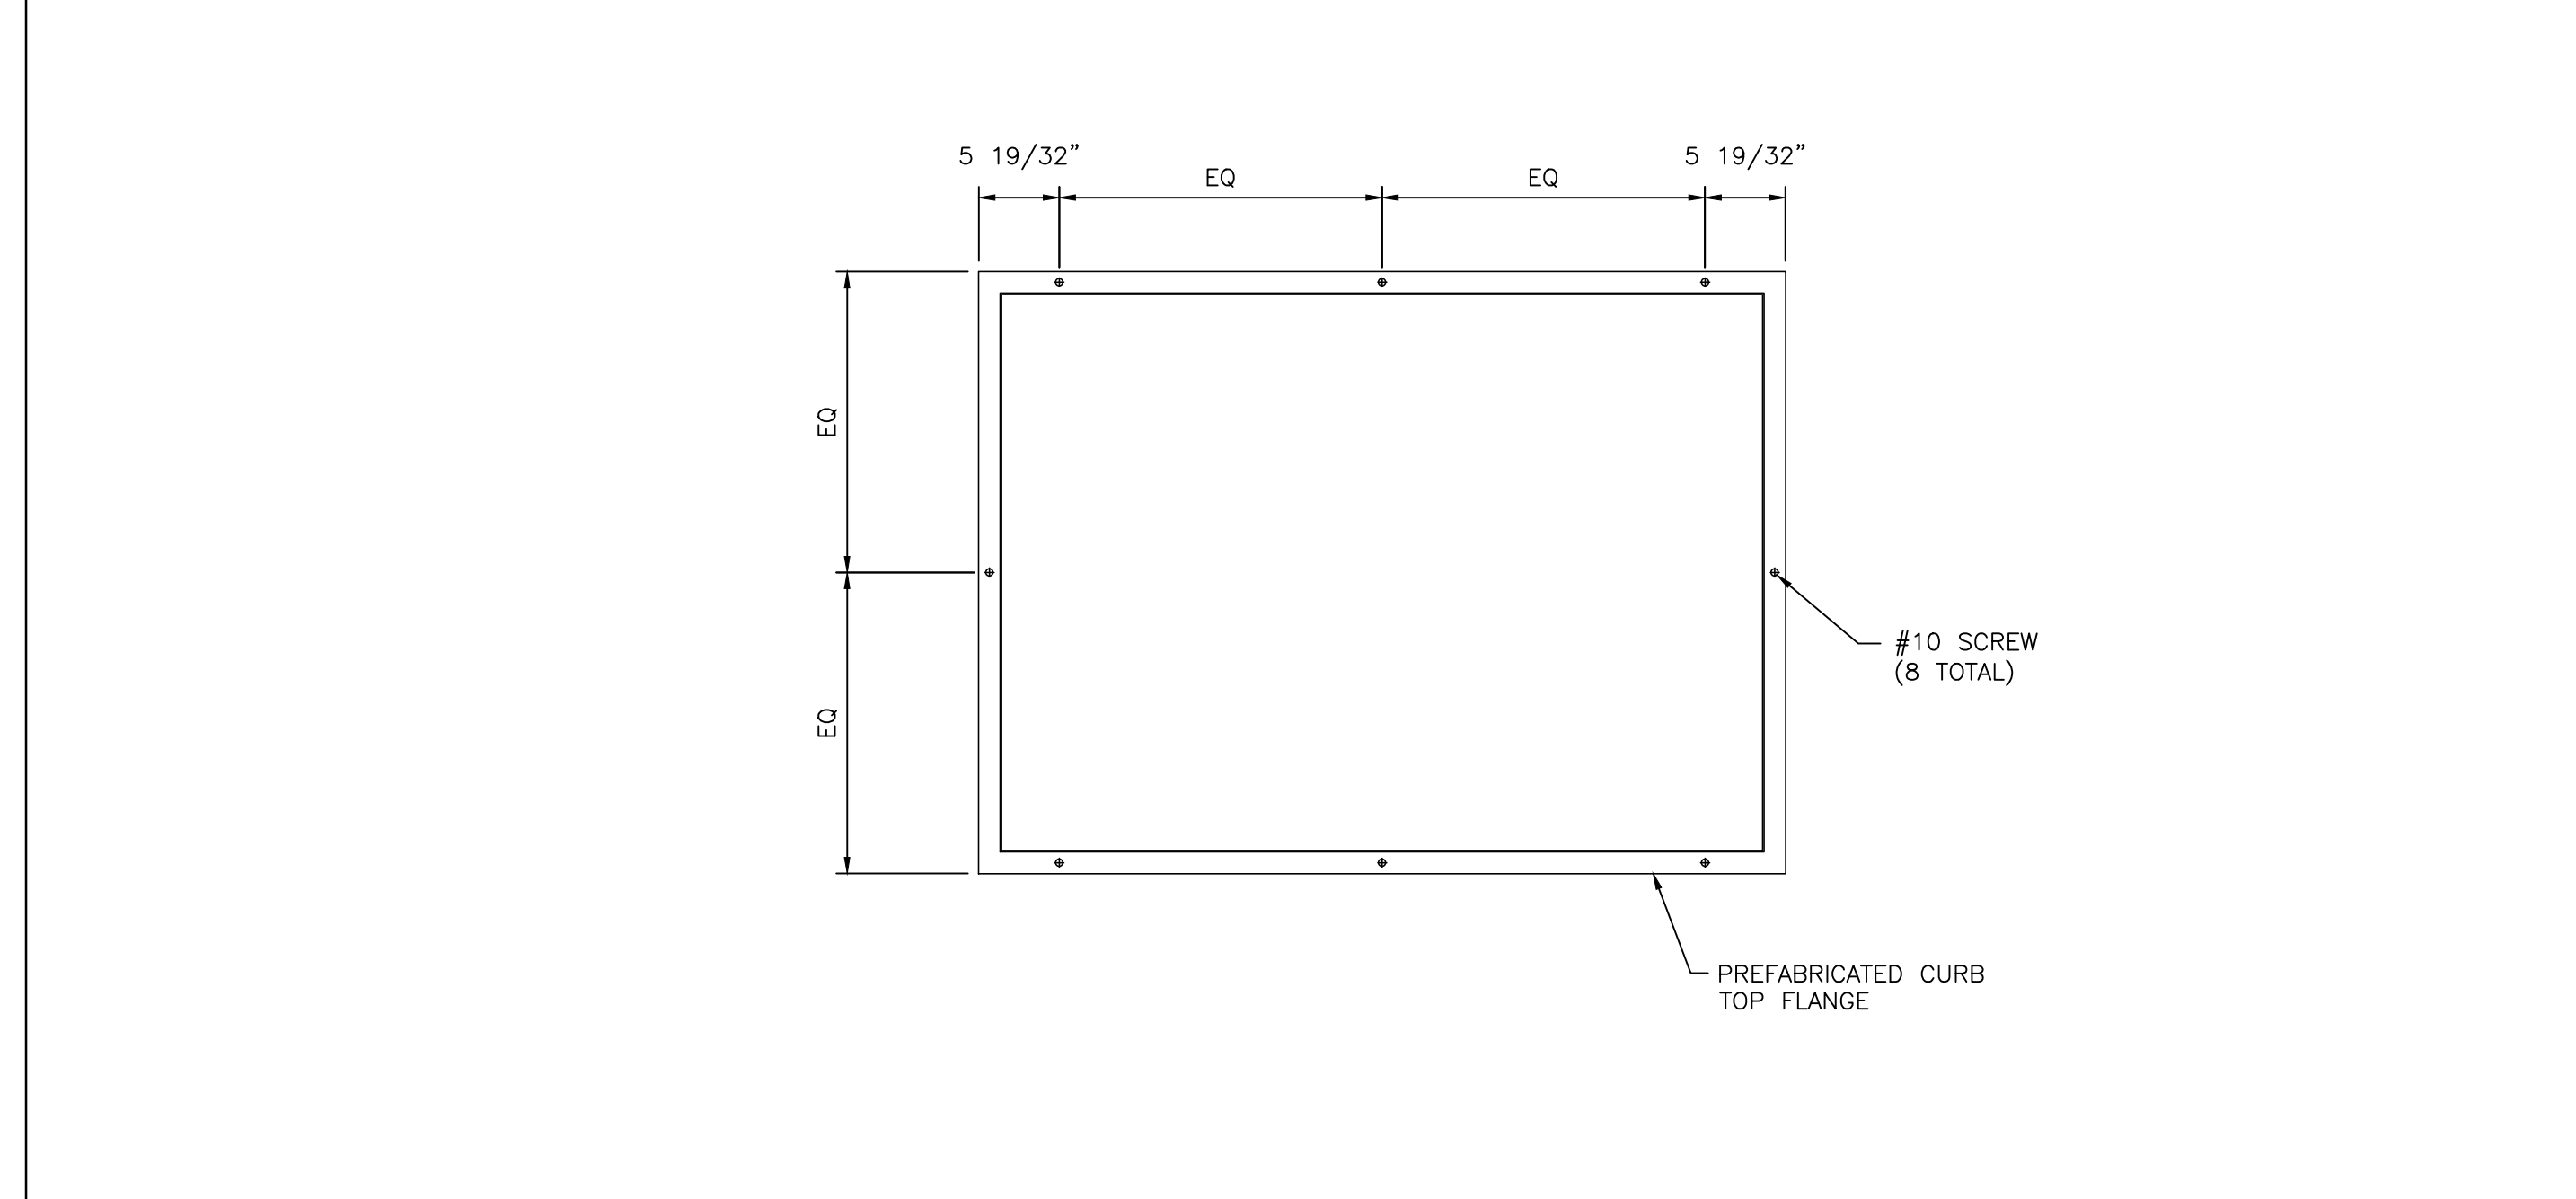


CURB TOP ANCHOR LAYOUT


HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221



MICROLLAM CONNECTION

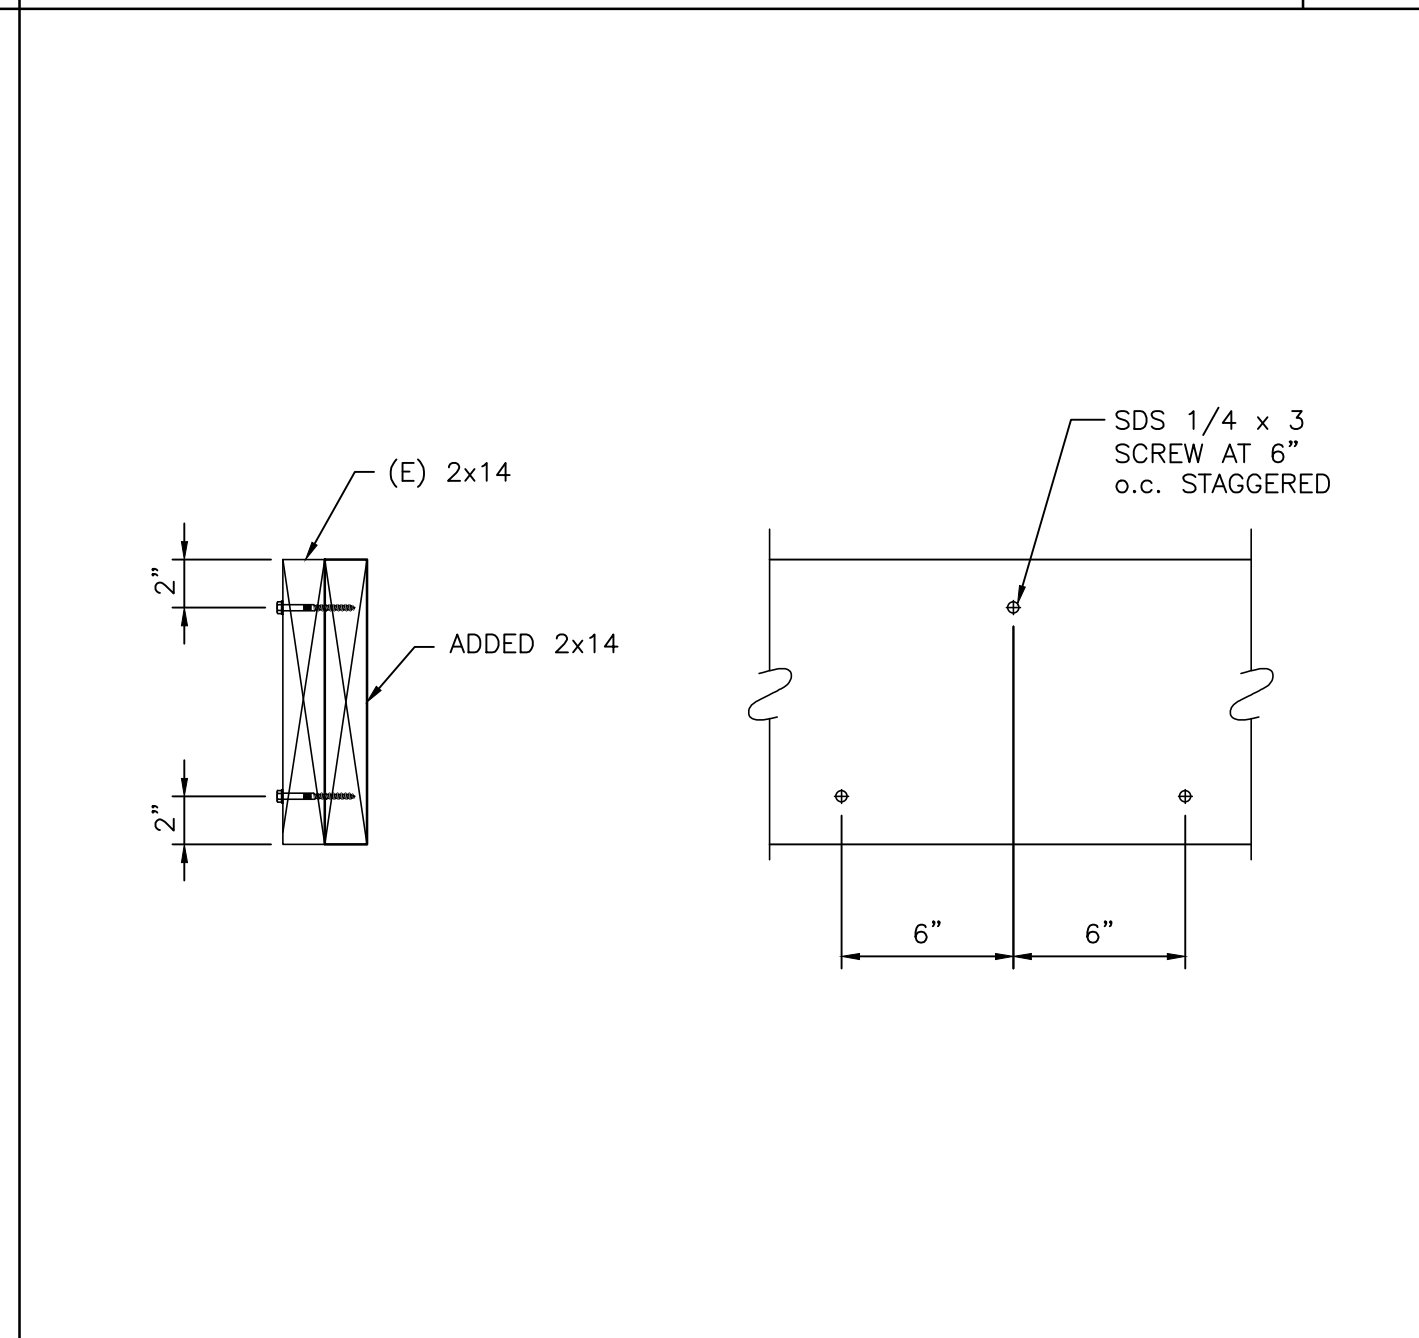

CURB BOTTOM ANCHOR LAYOUT

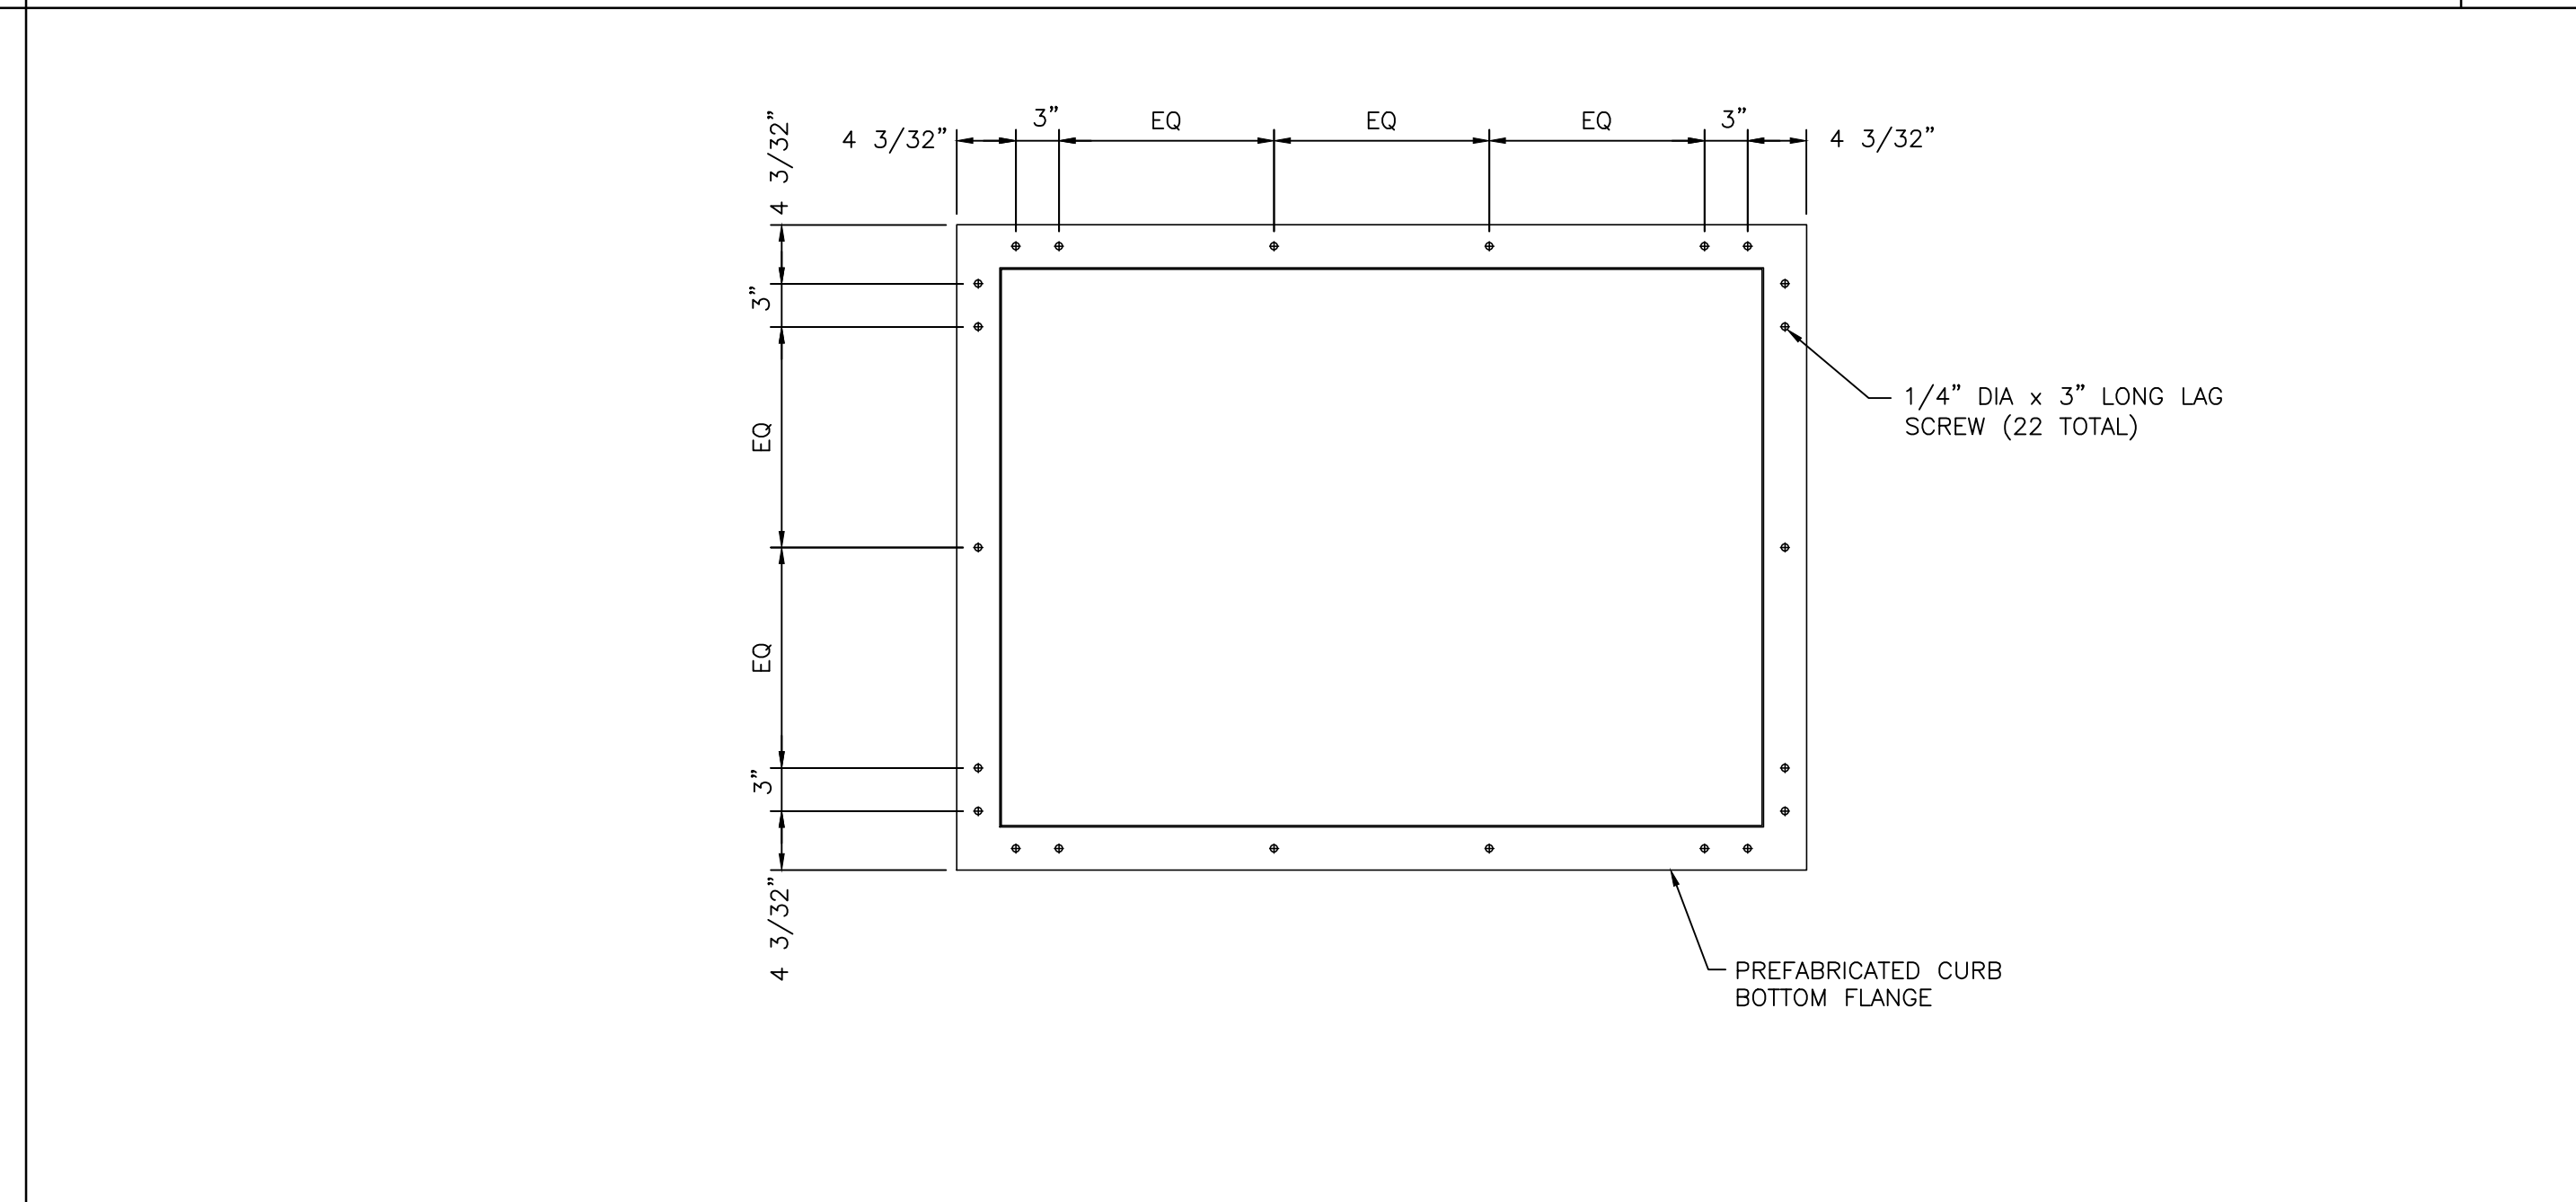

CURB BOTTOM ANCHOR LAYOUT

△	02/25/19	SB	100% CD
△			
△			
△			
NO	DATE	BY	DESCRIPTION

REVISIONS

DRAWN: GMB	CHECKED: SB
DATE: 02/25/19	SCALE: AS NOTED
PROJECT NUMBER: 17-301	

CONSTRUCTION DETAILS

DRAWING NUMBER : **S-3**