

HVAC ADDITIONS TO CAFETERIA BUILDING

COMPTON COLLEGE

1111 E. ARTESIA BLVD., COMPTON, CA. 90221

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019



2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
next step
 DESIGN, INC
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 REG. # 09-38



DRAWING INDEX

| | |
|-------|---------------------------------------|
| T0.0 | TITLE SHEET |
| E0.1 | GENERAL NOTES, SYMBOLS LIST & DETAILS |
| E0.2 | SINGLE LINE DIAGRAM & PANEL SCHEDULES |
| E1.0 | SITE PLAN |
| E1.1 | ELECTRICAL FLOOR PLAN |
| E2.1 | FIRE ALARM FLOOR PLAN |
| E2.2 | FIRE ALARM SUBMITTAL |
| M0.1 | MECHANICAL GENERAL NOTES & LEGEND |
| M0.2 | MECHANICAL SCHEDULES |
| M0.3 | BUILDING 'Q' TITLE-24 COMPLIANCE |
| M0.4 | BUILDING 'Q' TITLE-24 COMPLIANCE |
| M1.1 | MECHANICAL FLOOR PLAN |
| M2.1 | MECHANICAL DETAILS |
| P0.1 | PLUMBING GENERAL NOTES & LEGEND |
| P1.1 | PLUMBING FLOOR PLAN |
| P2.1 | PLUMBING DETAILS |
| S-1 | ROOF FRAMING PLAN |
| S-2 | CONSTRUCTION DETAILS |
| S-3 | CONSTRUCTION DETAILS |
| TOTAL | 19 SHEETS |

APPLICABLE CODES

2016 CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE
 CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 1

2016 CALIFORNIA BUILDING CODE (CBC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 2 (2015 INTERNATIONAL BUILDING CODE (IBC) VOLUMES 1-2 W/ 2016 CALIFORNIA AMENDMENTS)

2016 CALIFORNIA ELECTRICAL CODE (CEC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 3 (2014 NATIONAL ELECTRIC CODE (NEC) W/ 2016 CALIFORNIA AMENDMENTS)

2016 CALIFORNIA MECHANICAL CODE (CMC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 4 (2015 UNIFORM MECHANICAL CODE (CMC) W/ 2016 CALIFORNIA AMENDMENTS)

2016 CALIFORNIA PLUMBING CODE (CPC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 5 (2015 UNIFORM PLUMBING CODE (CPC) 2016 W/ CALIFORNIA AMENDMENTS)

2013 ASME A17.1(w/A17.1a/CSA B44a-08 ADDENDA) SAFETY CODE FOR ESCALATORS AND ELEVATORS

2016 CALIFORNIA FIRE CODE (CFC) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 9 (2015 INTERNATIONAL FIRE CODE (IFC) W/ 2016 CALIFORNIA AMENDMENTS)

2016 CALIFORNIA REFERENCED STANDARDS CODE CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 12

AMERICANS WITH DISABILITIES ACT (ADA) ACCESSIBILITY GUIDELINES FOR BUILDINGS AND FACILITIES (ADAAG)

CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, CALIFORNIA STATE ACCESSIBILITY STANDARDS STATE FIRE MARSHAL REGULATIONS (AS AMENDED TO DATE) CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 19, 2016 EDITION

2016 CALIFORNIA ENERGY CODE (CEC) (CCR) TITLE 24, PART 6

2016 CALIFORNIA GREEN BUILDING STANDARDS CODE (CCR) TITLE 24, PART 11

APPLICABLE NFPA STANDARDS

- NFPA 13 - AUTOMATIC SPRINKLER SYSTEMS, 2016 EDITION
- NFPA 14 - STANDPIPE SYSTEMS, 2013 EDITION
- NFPA 17 - DRY CHEMICAL SYSTEMS, 2013 EDITION
- NFPA 17a - WET CHEMICAL SYSTEMS, 2013 EDITION
- NFPA 24 - PRIVATE FIRE MAINS, 2016 EDITION
- NFPA 70E - STANDARD FOR ELECTRICAL SAFETY IN THE WORKPLACE, 2015 EDITION
- NFPA 72 - NATIONAL FIRE ALARM CODE WITH CALIFORNIA AMENDMENTS, 2016 EDITION SEE UL STD. 1971 FOR "VISUAL DEVICES"
- NFPA 80 - FIRE DOOR AND OTHER OPENING PROTECTIVES, 2016 EDITION
- NFPA 92 - STANDARD FOR SMOKE CONTROL SYSTEMS, 2015 EDITION
- NFPA 253 - CRITICAL RADIANT FLUX OF FLOOR COVERING SYSTEMS, 2015 EDITION
- NFPA 2001 - CLEAN AGENT FIRE EXTINGUISHING SYSTEMS, 2015 EDITION
- UL464 - AUDIBLE SIGNAL APPLIANCES, 2003 EDITION
- UL521 - HEAT DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS, 1999 EDITION

REFERENCE CODE SECTION FOR NFPA STANDARDS - 2016 CBC (SFM). SEE CHAPTER 35 FOR STATE OF CALIFORNIA AMENDMENTS TO NFPA STANDARDS

PROJECT TEAM

PROJECT ADDRESS
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

OWNER
 COMPTON COMMUNITY COLLEGE DISTRICT
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221
 (310) 900-1600 Ext. 2606
 lowens@compton.edu


ELECTRICAL ENGINEER
 R.F. HAWKINS CONSULTING
 2357 NAPLES AVENUE
 MENTONE, CA 92359
 (909) 522-4518
 design@rfhawkinsconsulting.com

MECHANICAL ENGINEER
 PAIS CONSULTING GROUP
 18 PINE HILL
 LADERA RANCH, CA 92694
 (949) 610-9675
 illepais@gmail.com

STRUCTURAL ENGINEER
 NEXT STEP DESIGN
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 (949) 215-3339
 scott@NSD.biz

TYPE OF CONSTRUCTION

BUILDING "Q" TYPE B B OCCUPANCY NON FIRE SPRINKLERED

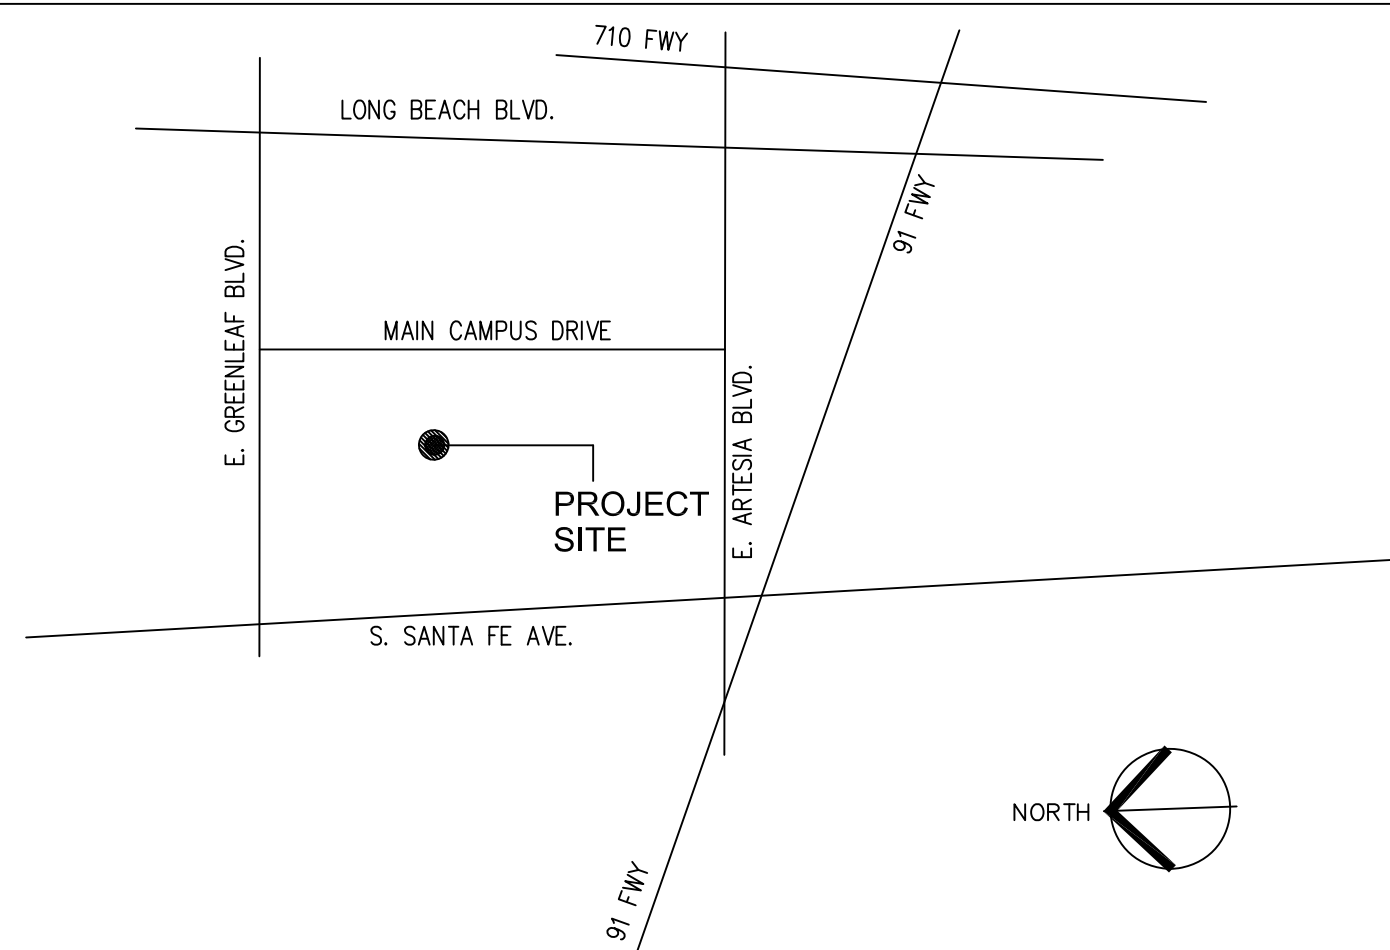

VICINITY MAP

SCOPE OF WORK

THE SCOPE OF THE WORK AS STATED BELOW IS FOR DSA PLAN REVIEW PURPOSES ONLY AND DOES NOT CONSTITUTE A DETAILED AND FULL EXPLANATION OF THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

SELECTIVE DEMOLITION OF EXISTING HVAC EQUIPMENT AND THE INSTALLATION OF NEW HVAC EQUIPMENT.

SELECTIVE DEMOLITION OF EXISTING ELECTRICAL RELATED TO THE HVAC EQUIPMENT AND INSTALLATION OF NEW DUCTS, CONDUIT, CABLING AS REQUIRED TO RESTORE OPERATION OF THE HVAC SYSTEM.

ANY REPAIRS OR NEW INSTALLATION AND PENETRATIONS TO ROOF SHALL BE PER SPECIFICATIONS AND ADHERE TO ALL REQUIREMENTS OF THE DISTRICT STANDARD ROOFING SYSTEM.

INSTALLATION OF NEW AUTOMATIC FIRE ALARM SYSTEM.

DSA APPROVAL OF THESE PLANS SHALL NOT BE CONSTRUED AS THE CERTIFICATION OF COMPLIANCE FOR THE FOLLOWING BUILDINGS AS REQUIRED BY THE FIELD ACT, EDUCATION CODE SECTION 17280-17316 AND SECTIONS 81130-81147. REFER TO E1.0 SITE PLAN.

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

| △ | | | |
|-----------|------|----|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| NO | DATE | BY | DESCRIPTION |
| REVISIONS | | | |

DRAWN: JC CHECKED: RFH
 DATE: 8/31/2018 SCALE: AS NOTED
 PROJECT NUMBER: 17-301



TITLE SHEET

DRAWING NUMBER : **T0.0**


GENERAL NOTES:

- VERIFY EXISTING SITE CONDITIONS, SERVICE REQUIREMENTS (ELECTRICAL, INTEGRATED COMMUNICATIONS AND FIRE ALARM) AND EXACT LOCATIONS OF SERVICE FACILITIES BEFORE SUBMITTING BID. SUBMITTAL OF BID INDICATES CONTRACTOR IS COGNIZANT OF ALL JOB SITE CONDITIONS, ACTUAL PHYSICAL LOCATIONS, AND WORK TO BE PERFORMED.
- CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS, INSURANCE, EQUIPMENT, INSTALLATION, CONSTRUCTION TOOLS, TRANSPORTATION, ETC. FOR A COMPLETE AND PROPERLY OPERATING ELECTRICAL SYSTEM.
- CONSTRUCTION TERMINOLOGY, AND THE STANDARDS AND ACCEPTABLE METHODS OF INSTALLATION REQUIRED BY THESE CONTRACT DOCUMENTS ARE BASED ON PUBLISHED STANDARDS OF N.E.C.A. (NATIONAL ELECTRICAL CONTRACTORS ASSOCIATION), NATIONAL ELECTRICAL SAFETY CODE, AMERICAN NATIONAL STANDARDS INSTITUTE DOCUMENTS, NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION, UNDERWRITERS LABORATORIES, AND THE CALIFORNIA ELECTRICAL CODE. SUBMITTAL OF BID INDICATES THE CONTRACTOR IS COGNIZANT OF THESE STANDARDS AND THE REQUIREMENTS NECESSARY TO PERFORM ALL THE WORK AS SET FORTH IN THESE CONTRACT DOCUMENTS.
- ALL WORK THAT REQUIRES SERVICE INTERRUPTION TO ANY BUILDING ON THE CAMPUS SHALL BE COORDINATED WITH THE DISTRICT A MINIMUM OF 7 DAYS IN ADVANCE AND SHALL NOT OCCUR DURING SCHOOL HOURS. WORK FOR THIS PROJECT SHALL NOT BE PERFORMED DURING SCHOOL HOURS, INCLUDING AFTER HOURS PROGRAMS AND/OR EVENTS, INCLUDE ALL COSTS FOR SHIFT DIFFERENTIAL, WEEKEND, OVERTIME, OR HOLIDAYS, IN BASE BID FOR THIS PROJECT. C.C.D. WILL NOT BE RESPONSIBLE FOR ANY PREMIUM PAY FOR THIS PROJECT.
- THESE PLANS ARE DIAGRAMMATIC ONLY, FOLLOW AS CLOSELY AS POSSIBLE AND REFER TO ARCHITECTURAL DRAWINGS FOR DETAILS. STRUCTURAL DETAILS, EXACT EQUIPMENT AND OUTLET LOCATIONS. ALTHOUGH NOT SHOWN, CONTRACTOR SHALL PROVIDE ALL J-BOXES, PULL BOXES, ELLS, OFFSETS ETC., FOR A COMPLETE CODE APPROVED INSTALLATION. FOOTAGE SHOWN ON ELECTRICAL SINGLE LINES AND RISER DIAGRAMS ARE FOR CALCULATION PURPOSES ONLY AND ARE NOT FOR BIDDING PURPOSES OR MATERIAL TAKEOFF. ALL LOCATIONS OF EVERY OUTLET SHALL BE VERIFIED PRIOR TO ROUGH-IN.
- THE CONNECTION METHOD SHOWN IS FOR BIDDING PURPOSES. THIS CONTRACTOR SHALL COORDINATE AND PROVIDE, FROM ACTUAL BUILDING SHOP DRAWINGS, THE CONNECTION SHOWN ON THOSE DRAWINGS.
- EACH CONDUCTOR OF EVERY SYSTEM SHALL BE PERMANENTLY TAGGED IN COMPLIANCE WITH OSHA.
- ALL MATERIALS SHALL BE NEW, AND OF THE SAME MANUFACTURER FOR EACH CLASS OR GROUP OF EQUIPMENT. MATERIALS SHALL BE LISTED AND APPROVED BY UNDERWRITERS LABORATORIES FOR THE USE AND ENVIRONMENT, AND SHALL BEAR THE INSPECTION LABEL WHERE SUBJECT TO SUCH APPROVAL. MATERIALS SHALL MEET WITH THE APPROVAL OF THE DIVISION OF INDUSTRIAL SAFETY, AND ALL GOVERNING BODIES HAVING JURISDICTION. MATERIALS SHALL BE MANUFACTURED IN ACCORDANCE WITH APPLICABLE STANDARDS ESTABLISHED BY A.N.S.I., U.L., N.E.M.A. AND N.B.F.U. INSTALL PER MANUFACTURERS' RECOMMENDATIONS. ALL EXTERIOR EQUIPMENT SHALL BE WEATHERPROOF.
- SUBSTITUTIONS OF SPECIFIED MATERIALS ARE IN ACCORDANCE WITH THE GENERAL CONDITIONS. APPROVAL OF EQUAL MATERIALS PRIOR TO BID ARE BY WRITTEN ADDENDUM ONLY OR AS STATED ON THE PLANS.
- SUBMIT SHOP DRAWINGS FOR ALL MAJOR PIECES OF ELECTRICAL EQUIPMENT INCLUDING BUT NOT LIMITED TO: ELECTRICAL COMPONENTS.
- CONTRACTOR SHALL PERFORM HIS WORK IN ACCORDANCE WITH ALL GOVERNING STATE, COUNTY, LOCAL CODES, O.S.H.A. AND THE 2016 CALIFORNIA ELECTRICAL CODE (CEC).
- THE COMPLETE ELECTRICAL SYSTEM SHALL BE GROUNDED IN ACCORDANCE WITH THE 2016 CALIFORNIA ELECTRICAL CODE (C.E.C.), ART. #250, AND AS SHOWN ON THE DRAWINGS. AT THE REQUEST OF AND IN THE PRESENCE OF THE AUTHORIZED INSPECTOR, THE CONTRACTOR SHALL PROVIDE SYSTEM RESISTANCE READINGS.
- PENETRATIONS TO FIRE-RATED MATERIALS SHALL BE RESTORED TO EQUAL RATING AS REQUIRED BY THE STATE FIRE MARSHAL.
- CONDUCTORS SHALL BE CODE GRADE, 600 VOLT CLASS, COPPER, MARKED 24" ALONG ITS LENGTH SHOWING MANUFACTURER'S NAME, MAXIMUM ALLOWABLE VOLTAGE AND SIZE. CONDUCTORS SHALL BE TYPE "THWN" (WET) OR "THHN" (DRY), DELIVER THE WIRE TO THE SITE IN UNBROKEN PACKAGES.
- CONDUIT SHOWN AS EXPOSED OR APPROVED FOR EXPOSED INSTALLATION SHALL BE INTERMEDIATE METALLIC CONDUIT (I.M.C.), OR RIGID GALVANIZED STEEL (RGS), SECURED WITH TWO HOLE MALLEABLE PIPE STRAPS AND SCREWS. ALL BOXES AND FITTINGS SHALL BE SUPPORTED AND SECURED IN COMPLIANCE WITH THE 2016 CALIFORNIA ELECTRICAL CODE (C.E.C.) ART. #370.
- P.V.C. CONDUIT, WITH CODE SIZED GROUND, SHALL BE USED UNDERGROUND ONLY, IF APPROVED BY LOCAL CODE. INSTALL PER LOCAL CODE REQUIREMENTS. ALL CONDUIT SWEEPS AND RISERS SHALL BE I.M.C. OR RGS, WITH HALF-LAPPED TAPE COVERING OR FACTORY APPLIED PVC COATING. ROUTE UNDERGROUND CONDUITS AROUND PROPOSED BUILDING LOCATIONS.
- ALL CONDUIT ONLY (C.O.) SHALL HAVE A 1/4" PULL WIRE OR ROPE.
- USE ONLY COMPETENT AND SKILLED PERSONNEL AND PERFORM ALL WORK, INCLUDING AESTHETIC AS WELL AS ELECTRICAL AND MECHANICAL ASPECTS TO STANDARDS CONSISTENT WITH THE BEST PRACTICES OF THE TRADE.
- UNLESS SPECIFICALLY SHOWN ON THESE PLANS NO STRUCTURAL MEMBER SHALL BE CUT, DRILLED NOR NOTCHED WITHOUT PRIOR WRITTEN AUTHORIZATION FROM THE STRUCTURAL ENGINEER AND THE DISTRICT STRUCTURAL ENGINEER FROM THE DIVISION OF THE STATE ARCHITECT.
- THE SEISMIC ANCHORAGE OF MECHANICAL AND ELECTRICAL EQUIPMENT SHALL CONFORM TO C.C.R. TITLE 24, 2013 C.B.C. SECTION 1832A AND ASCE 7-10. ANCHORAGE DETAILS FOR ROOF/FLOOR MOUNTED EQUIPMENT SHALL BE SHOWN ON PLANS.
- WHERE IT BECOMES NECESSARY TO DRILL INTO OR CUT THROUGH ANY EXISTING FLOORS, WALLS OR CEILINGS TO PERMIT THE INSTALLATION OF ANY WORK UNDER THIS CONTRACT, OR TO REPAIR ANY DEFECTS THAT MAY APPEAR TO THE EXPIRATION OF THE WARRANTY, SUCH CUTTING AND PATCHING SHALL BE PERFORMED BY TRADESMEN EXPERIENCED IN THE WORK REQUIRED. CONTRACTOR SHALL PAY FOR ALL COSTS REQUIRED FOR CUTTING OR REPAIRING. ALL FINISHES SHALL MATCH EXISTING OR NEW ADJACENT SURFACES. THIS WILL INCLUDE REPLACING SEAM TO SEAM OR COMPLETE SURFACE REPLACEMENT TO MATCH EXISTING OR NEW SURFACES.
- ALL MECHANICAL, PLUMBING, AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE DSA APPROVED CONSTRUCTION DOCUMENTS, WHERE NO DETAIL IS INDICATED. THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRACED TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2016 CBC, SECTIONS 1616A.1.18 THRU 1616A.1.26 AND ASCE 7-10 CHAPTER 13, 26 AND 30.
 - ALL PERMANENT EQUIPMENT AND COMPONENTS.
 - TEMPORARY OR MOVABLE EQUIPMENT THAT IS PERMANENTLY ATTACHED (e.g. HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR WATER.
 - MOVABLE EQUIPMENT WHICH IS STATIONED IN ONE PLACE FOR MORE THAN 8 HOURS AND HEAVIER THAN 400 POUNDS ARE REQUIRED TO BE ANCHORED WITH TEMPORARY ATTACHMENTS. THE ATTACHMENT OF THE FOLLOWING MECHANICAL AND ELECTRICAL EQUIPMENT SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE, BUT NEED NOT BE DETAILD ON THE PLANS. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING AND CONDUIT.
 - COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVE A CENTER OF MASS LOADED 4 FEET OR LESS ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT.
 - COMPONENTS WEIGHING LESS THAN 20 POUNDS, OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.


FOR THOSE ELEMENTS THAT DO NOT REQUIRE DETAILS ON THE APPROVED DRAWINGS, THE INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE STRUCTURAL ENGINEER OF RECORD AND THE DSA DISTRICT STRUCTURAL ENGINEER. THE PROJECT INSPECTOR WILL VERIFY THAT ALL COMPONENTS AND EQUIPMENT HAVE BEEN ANCHORED IN ACCORDANCE WITH ABOVE REQUIREMENTS.
- PIPING, DUCTWORK AND ELECTRICAL DISTRIBUTION SYSTEMS SHALL BE BRACED TO COMPLY WITH THE FORCES AND DISPLACEMENTS PRESCRIBED IN ASCE 7-10 SECTION 13.3 AS DEFINED IN ASCE 7-10. THE BRACING AND ATTACHMENTS TO THE STRUCTURE SHALL BE DETAILED ON THE APPROVED DRAWINGS OR THEY SHALL COMPLY WITH ONE OF THE OSHD PRE-APPROVALS (OPM) AS MODIFIED TO SATISFY ANCHORAGE REQUIREMENTS OF ACI 318, APPENDIX D. COPIES OF THE MANUAL SHALL BE AVAILABLE ON THE JOBSITE PRIOR TO THE START OF HANGING AND BRACING OF PIPE, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS. THE STRUCTURAL ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.
- PROVIDE ENGRAVED PLASTIC NAMEPLATES FOR ALL ELECTRICAL PANELS, INTERIOR & EXTERIOR JUNCTION BOXES EXISTING AND NEW. PLATES SHALL BE 3 PLY, OR PERMANENT ADHESIVE TAPE ONLY AS MANUFACTURED BY 3M IS PERMITTED.
- PROVIDE THE OWNER WITH THREE (3) SETS OF COMPLETE ELECTRICAL "AS-BUILT" REPRODUCIBLE DRAWINGS AT THE COMPLETION OF THE JOB. SHOWING ACTUAL DEPTHS OF UNDERGROUND RUNS AND ALL LOCATIONS. ALL BROCHURES, OPERATING MANUALS, CATALOGS, SHOP DRAWINGS, ETC. SHALL BE TURNED OVER TO THE OWNER AT PROJECT COMPLETION. DRAWINGS SHALL BE IN CAD & PDF FORMAT. REFER TO SPECIFICATIONS. "AS-BUILT" DRAWINGS SHALL BE AVAILABLE ON SITE AND ALL CHANGES DOCUMENTED AND "RED LINED" DIALY FOR REVIEW. I.O.R. SHALL BE NOTIFIED OF ANY CHANGES PRIOR TO INSTALLATIONS.
- COMPLETE JOB SHALL BE GUARANTEED FOR A PERIOD OF ONE (1) YEAR AFTER DATE OF ACCEPTANCE BY OWNER. ANY WORK, MATERIAL OR EQUIPMENT FOUND TO BE FAULTY DURING THAT PERIOD SHALL BE CORRECTED AT ONCE, UPON WRITTEN NOTIFICATION, AT THE EXPENSE OF THE ELECTRICAL CONTRACTOR.
- WHERE A CONFLICT OCCURS BETWEEN THESE NOTES AND ELECTRICAL SPECIFICATION ISSUED AS A PART OF THESE DOCUMENTS, THE MORE STRINGENT REQUIREMENT SHALL PREVAIL.
- ALL LOW VOLTAGE ELECTRONIC SYSTEMS CONDUCTORS AND EQUIPMENT SHALL BE PROVIDED BY AN ELECTRONIC SYSTEMS CONTRACTOR WHO HOLDS A VALID C-7 LICENSE. EQUIPMENT SHALL MATCH EXISTING AND SHALL BE INSTALLED IN ACCORDANCE WITH SPECIFICATIONS PROVIDED BY THE FACTORY AUTHORIZED DISTRIBUTOR OF THE EXISTING SYSTEM. NEW COMPONENTS INSTALLED ON EXISTING SYSTEM SHALL BE COVERED BY FULL WRITTEN WARRANTY, FOR ALL PARTS AND INSTALLATION, FOR ENTIRE SYSTEM. CABLE SPLICES IN UNDERGROUND PULL BOXES ARE ABSOLUTELY PROHIBITED. SYSTEMS APPLICABLE TO THIS SECTION ARE AS NOTED: INTERCOM PUBLIC ADDRESS, TELEPHONE, CLOCK, ENERGY MANAGEMENT, INTRUSION ALARM, FIRE ALARM, TELEVISION, AND DATA.
- ALL UNDERGROUND CONDUITS TO HAVE FULL ENCASEMENT WITH SLURRY MIX, 3" AROUND WITH 2" SEPARATION BETWEEN CONDUITS. MAINTAIN 12" SEPARATION BETWEEN POWER AND SYSTEMS CONDUITS. PROVIDE 24" NATIVE COVER ABOVE ENCASEMENT IN NON-TRAFFIC AREAS. PROVIDE SLURRY ENCASEMENT TO SUB-GRADE IN CONCRETE OR ASPHALT AREAS.
- PROVIDE 12" OF 3/4" ROCK BELOW UNDERGROUND PULL BOXES.
- ALL EXISTING SERVICES INTERRUPTED DURING AND NOT PART OF DEMOLITION SHALL BE RESTORED TO NORMAL CONDITION.
- THESE DRAWINGS DO NOT CONTAIN THE NECESSARY COMPONENTS FOR CONSTRUCTION SAFETY.
- CONTRACTOR SHALL NOT SCALE DRAWINGS. ALL MEASUREMENTS SHALL BE FIELD VERIFIED.
- ALL WORK SHOWN ON THESE DRAWINGS SHALL COMPLY WITH THE REQUIREMENTS OF TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR).
- CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY ADDENDA OR A CONSTRUCTION CHANGE DOCUMENT (CCD) APPROVED BY THE DIVISION OF THE STATE ARCHITECT, AS REQUIRED BY TITLE 24, CCR, PART 1, SECTION 4-338.
- LOCATIONS OF ALL UTILITIES SHOWN ARE APPROXIMATE AND CONTRACTOR SHALL EXERCISE EXTREME CAUTION IN EXCAVATING AND TRENCHING ON THIS SITE TO AVOID INTERCEPTING EXISTING PIPING OR CONDUITS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO LOCATE ALL EXISTING UTILITIES WHETHER SHOWN HEREON OR NOT AND TO PROTECT THEM FROM DAMAGE. THE ENGINEER IS NOT RESPONSIBLE FOR THE LOCATION OF UNDERGROUND UTILITIES OR STRUCTURES WHETHER OR NOT SHOWN OR DETAILED AND INSTALLED BY ANY OTHER CONTRACT. THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ENGINEER SHOULD ANY UNIDENTIFIED CONDITIONS BE DISCOVERED. THE CONTRACTOR SHALL BEAR ALL EXPENSE OF REPAIR OR REPLACEMENT OF UTILITIES OR OTHER PROPERTY DAMAGED BY OPERATIONS IN CONJUNCTION WITH THE PROSECUTION OF THIS WORK.
- CONTRACTOR TO NOTIFY CONSTRUCTION MANAGER PRIOR TO ANY EXCAVATION.
- THESE DOCUMENTS AND THE IDEAS AND DESIGNS INCORPORATED HERERIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, ARE THE PROPERTY OF R. F. HAWKINS CONSULTING, AND ARE NOT TO BE USED, IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF R. F. HAWKINS CONSULTING.
- THE WORK SHOWN ON THESE DRAWINGS AS EXISTING AS EXISTING CONDITIONS WAS PREPARED FROM INFORMATION FURNISHED BY THE OWNER. WHILE THIS INFORMATION IS BELIEVED TO BE RELIABLE, R. F. HAWKINS CONSULTING, IS NOT RESPONSIBLE FOR THE ACCURACY OR ADEQUACY OF ANY WORK SHOWN AS EXISTING NOR IS R. F. HAWKINS CONSULTING RESPONSIBLE FOR ANY ERRORS OR EMISSIONS WHICH MAY HAVE BEEN INCORPORATED INTO THESE DRAWINGS AS A RESULT.
- EACH BIDDER SHALL POSSESS AT THE TIME OF BID A CLASS B, LICENSE PER PUBLIC CONTRACT CODE SECTION 3300 AND BUSINESS AND PROFESSIONS CODE SECTION 7028.15. THE SUCCESSFUL BIDDER MUST MAINTAIN THE LICENSE THROUGHOUT THE DURATION OF THE CONTRACT. THE BIDDER SHALL COMPLY WITH SENATE BILL 854 FOR LABOR COMPLIANCE.
- FIRE SAFETY DURING CONSTRUCTION
 - GENERAL: FIRE SAFETY DURING CONSTRUCTION SHALL COMPLY WITH 2016 CALIFORNIA FIRE CODE (CFC), 2016 CALIFORNIA CODE OF REGULATIONS (CCR) TITLE 24, PART 9, CHAPTER 33.
 - ACCESS ROADS: FIRE DEPARTMENT ACCESS ROADS SHALL BE ESTABLISHED AND MAINTAINED IN ACCORDANCE WITH ARTICLE 9, SECTION 902.
 - WATER SUPPLY: WATER MAINS AND HYDRANTS SHALL BE OPERATIONAL IN ACCORDANCE WITH ARTICLE 9, SECTION 903.
 - BUILDING ACCESS: ACCESS TO BUILDINGS FOR THE PURPOSE OF FIREFIGHTING SHALL PURPOSE OF FIREFIGHTING SHALL BE PROVIDED. CONSTRUCTION MATERIAL SHALL NOT BLOCK ACCESS TO BUILDINGS, HYDRANTS OR FIRE APPLIANCES.
 - FIRE WATCH: MAINTAIN FIRE WATCH AT ALL TIMES WHEN EXISTING FIRE PROTECTION SYSTEMS ARE SHUT DOWN FOR ALTERATIONS AND UPGRADES. FIRE WATCH SHALL REMAIN IN EFFECT UNTIL EXISTING FIRE PROTECTION SYSTEMS ARE RETURNED TO SERVICE. FIRE WATCH TO BE PROVIDED BY M.V.U.S.D. FOR DURATION OF SCHEDULE AS NOTED IN GENERAL CONDITIONS. VERIFY WITH LOCAL FIRE AUTHORITY FOR ANY ADDITIONAL REQUIREMENTS.
- PENETRATIONS TO FIRE RATED MATERIALS OR ASSEMBLIES SHALL BE RESTORED TO SHALL BE RESTORED TO EQUAL RATING. FIRE STOP SYSTEMS AS LISTED BY UNDERWRITERS LABORATORIES SHALL BE INSTALLED PER FIRE RESISTANCE DIRECTORY. FIRE STOP SYSTEMS SHALL BE AS SPECIFIED.
- INSPECTOR OF RECORD REQUIREMENTS
 - ONE OR MORE INSPECTORS EMPLOYED BY THE DISTRICT (OWNER) IN ACCORDANCE WITH THE REQUIREMENTS OF TITLE 24 OF THE CALIFORNIA CODE OF REGULATIONS WILL BE ASSIGNED AND SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE INSPECTOR DUTIES ARE SPECIFICALLY DEFINED IN SECTION 4-342 OF SAID TITLE 24, PART 1 AND IN ADDITION SHALL BE STIPULATED IN INTERPRETATION OF REGULATION DOCUMENT IR-A-8.
 - INSPECTOR SHALL BE CERTIFIED AS A CLASS [2] INSPECTOR THROUGH THE DIVISION OF THE STATE ARCHITECT INSPECTOR EXAMINATION PROGRAM. INSPECTOR SHALL ALSO BE SPECIFICALLY APPROVED BY THE DIVISION OF THE STATE ARCHITECT FOR THIS PROJECT AT LEAST 10 DAYS PRIOR TO THE START OF ANY WORK FOR THIS PROJECT.
- EXACT LOCATION OF EQUIPMENT/DEVICES SHALL BE COORDINATED IN FIELD PRIOR TO INSTALLATION TO AVOID INTERFERENCE WITH EXISTING EQUIPMENT.
- ALL ELECTRICAL EQUIPMENT PANELS, AND CONDUCTORS SHALL BE INSTALLED AS INDICATED IN PLANS AND SHALL BE IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS. PROVIDE ACCESS PANELS AS REQUIRED IN HARD CEILINGS OR WALLS AND PATCH CEILINGS TO MATCH EXISTING MATERIAL AND FINISH. ACCESS PANELS SHALL BE KARP MODEL KDSC-24/M FOR GENERAL PURPOSE, MODEL #KRP-150/R FOR FIRE RATED CONDITIONS, OR EQUAL. SIZE TO BE 24"x24" MINIMUM.
- WHERE EXISTING SUSPENDED CEILINGS ARE REQUIRED TO BE REMOVED, REPLACE THE CEILING TO MEET CURRENT CODE REQUIREMENTS.
- CONDUIT SUPPORTED BY SUSPENDED CEILING WIRES SHALL HAVE NEW CEILING WIRES INSTALLED, INDEPENDANT OF CEILING OR FIXTURE SUPPORTS, PER CODE.
- EXPOSED CONDUIT IF REQUIRED ON INTERIOR OF BUILDING TO BE WIREMOLD WITH ALL NECESSARY FITTINGS AND STRAPS. VERIFY LOCATION WITH ENGINEER PRIOR TO INSTALL.
- REMOVE ALL CONSTRUCTION DEBRIS ON A DAILY BASIS. PROVIDE NECESSARY CONTAINERS TO DISPOSE OF DEBRIS. KEEP ALL CONSTRUCTION AREAS CLEAN.
- ALL EXISTING FURNITURE, EQUIPMENT, CEILING TILES ETC. MOVED DURING OFF TIME HOURS SHALL BE PROTECTED AND PLACED BACK (CLEAN) IN ORIGINAL LOCATION PRIOR TO NEXT DAY OF SCHOOL.
- INSTALLATION OF THE ELECTRICAL SYSTEM SHALL NOT START UNTIL PLANS AND SPECIFICATIONS ARE APPROVED BY THE DIVISION OF THE STATE ARCHITECT.
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- COMPLY WITH ALL REQUIREMENTS OF NFPA 72 E.

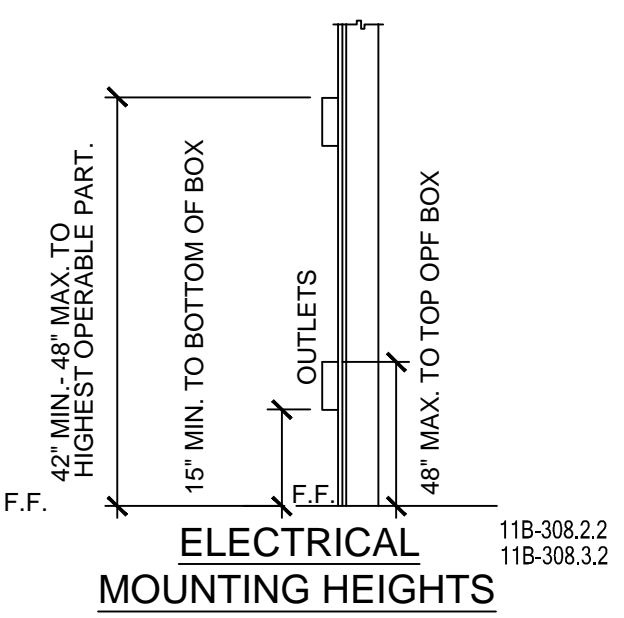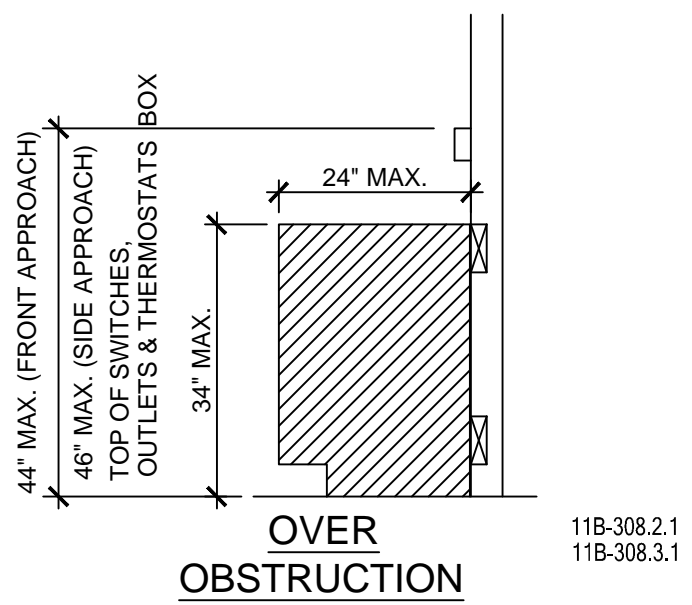

MTG. HT DET. SCALE N.T.S. 1

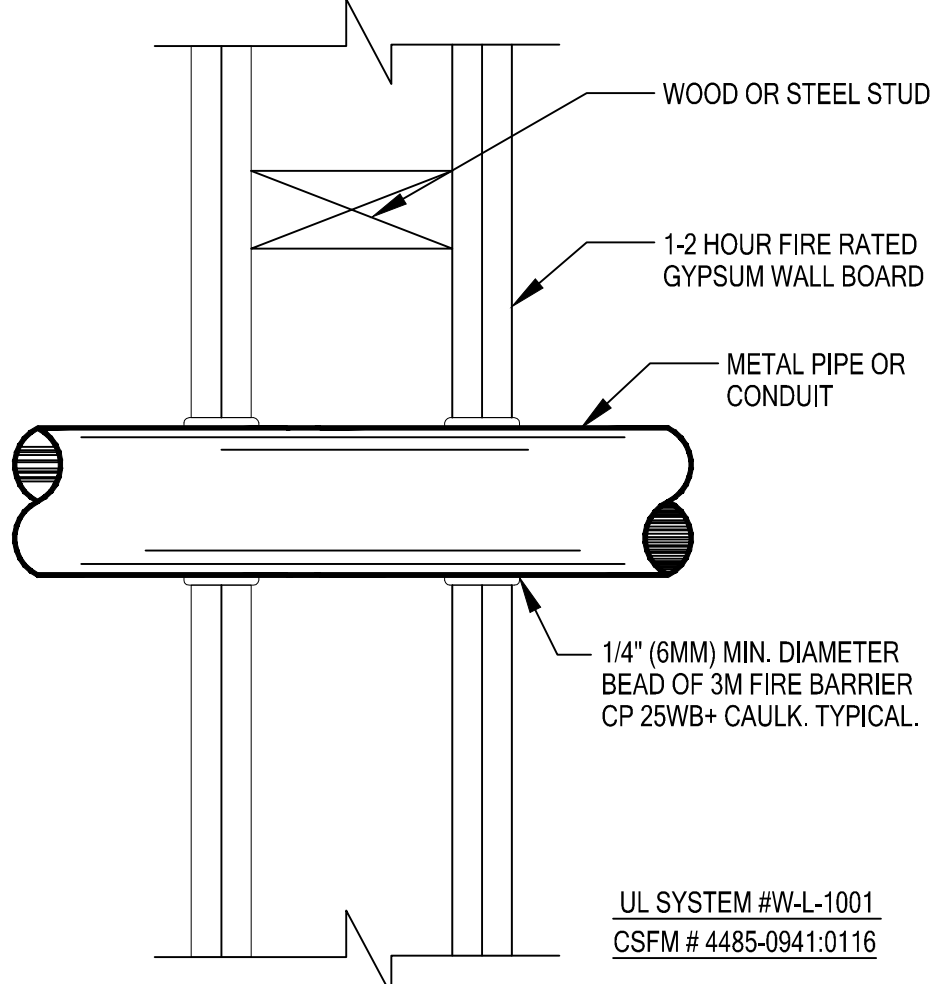

FIRESTOP DET. SCALE N.T.S. 2

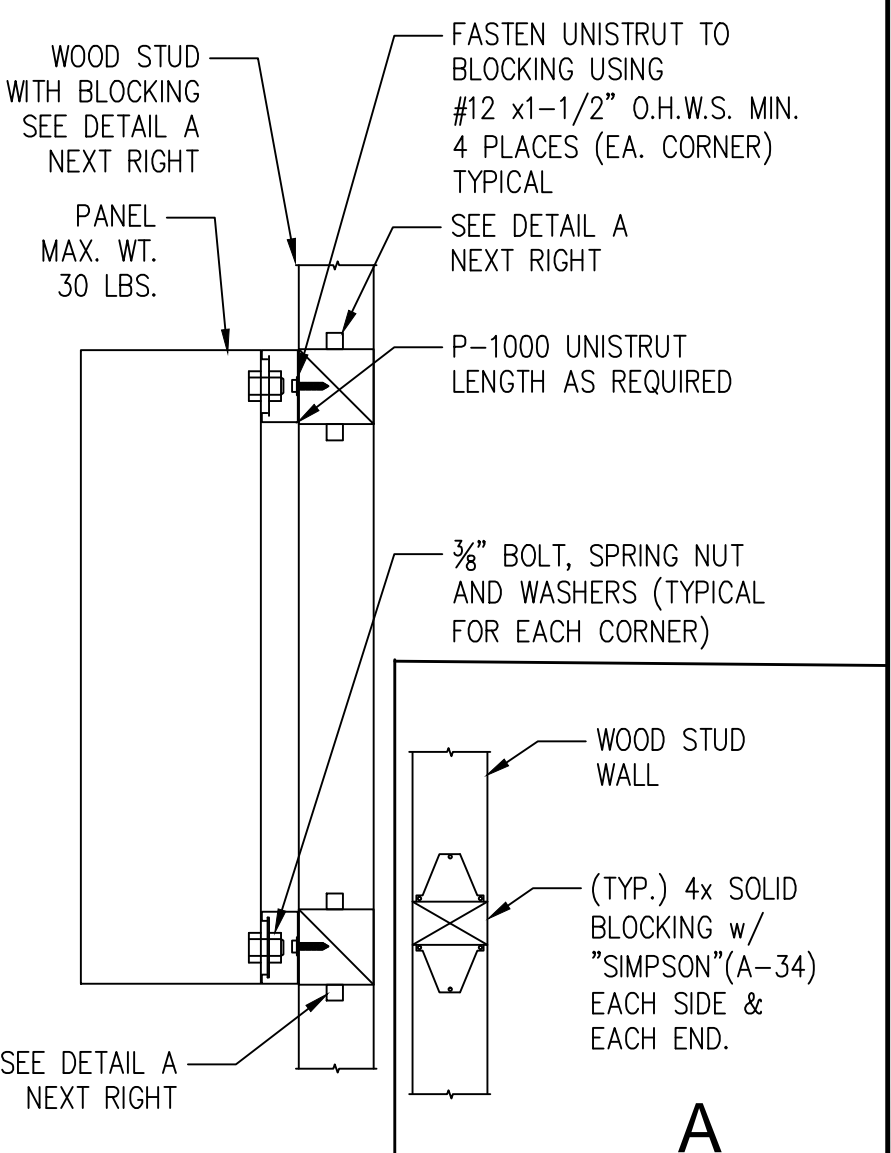

SURFACE PNL. MTG. SCALE N.T.S. 4

ELECTRICAL SYMBOLS LIST:

- [Symbol] MAIN SWITCHBOARD REFER TO SINGLE LINE DIAGRAM.
- [Symbol] DISTRIBUTION PANEL REFER TO SINGLE LINE DIAGRAM.
- [Symbol] FLUSH MOUNTED ELECTRICAL PANELBOARD. REFER TO PANEL SCHEDULE.
- [Symbol] SURFACE MOUNTED ELECTRICAL PANELBOARD. REFER TO PANEL SCHEDULE.
- [Symbol] DUAPLEX RECEPTACLE, WALL MOUNTED + 15\"/>
- [Symbol] QUADPLEX RECEPTACLE, WALL MOUNTED + 15\"/>
- [Symbol] FUSED DISCONNECT, SIZE AND NEMA RATING AS NOTED ON PLANS.
- [Symbol] PULLBOX, SIZED PER N.E.C. OR AS NOTED, CONCRETE WITH BOLT DOWN COVER.
- [Symbol] JUNCTION BOX, ACCESSIBLE AND MOUNTED FOR THE APPLICATION DENOTED ON PLANS.
- [Symbol] HOME RUN TO PANEL, LETTER DESIGNATES FLOOR, NUMBER INDICATES CIRCUITS.
- [Symbol] CONDUIT RUN CONCEALED, IN WALLS, FLOOR, OR ABOVE CEILING.
- [Symbol] CONDUIT RUN CONCEALED BELOW GRADE, 3/4\"/>
- [Symbol] CONDUIT RUN EXPOSED
- [Symbol] CONDUIT STUB OUT, CAP & MARK.
- [Symbol] BRANCH CIRCUIT WIRING, 2 #12 IN 1/2\"/>
- [Symbol] 1/2\"/>
- [Symbol] 3/4\"/>
- [Symbol] 3/4\"/>
- [Symbol] 3/4\"/>
- [Symbol] SURFACE MOUNTED LOCKABLE TERMINAL CABINET W/ TERMINAL STRIPS AS REQUIRED.
- [Symbol] TELEPHONE TERMINAL BACKBOARD SIZED AS NOTED
- [Symbol] MECHANICAL EQUIPMENT CALLOUT. "AH" INDICATES UNIT TYPE AND "2" INDICATES UNIT NUMBER. REFER TO MECHANICAL DRAWINGS FOR EXACT LOCATION AND FULL RATING.
- [Symbol] DETAIL CALLOUT, "3" INDICATES DETAIL NUMBER "E0.1" INDICATES SHEET NUMBER.
- [Symbol] PLAN NOTE REFERENCE.
- [Symbol] REVISION REFERENCE.
- [Symbol] MOUNTING HEIGHT
- [Symbol] WEATHERPROOF, NEMA 3R
- [Symbol] FURNISH, INSTALLED AND CONNECTED, COMPLETE.
- [Symbol] GFCI GROUND FAULT CIRCUIT INTERRUPTER
- [Symbol] EM EMERGENCY
- [Symbol] C CONDUIT
- [Symbol] E/G EQUIPMENT GROUND (GREEN)
- [Symbol] I.C.S. INTEGRATED COMMUNICATIONS SYSTEM RACK
- [Symbol] ICD COMMUNICATIONS WALL DISPLAY
- [Symbol] (E) EXISTING TO REMAIN
- [Symbol] (ER) EXISTING, TO BE REMOVED.
- [Symbol] (ERR) EXISTING, TO BE REMOVED AND RELOCATED.
- [Symbol] UG UNDERGROUND
- [Symbol] GEC GROUNDING ELECTRODE CONDUCTOR
- [Symbol] C.E.C. CALIFORNIA ELECTRICAL CODE
- [Symbol] U.O.N. UNLESS OTHERWISE NOTED

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 03-119661 INC. REVIEWED FOR
SS FL5 ACS
DATE: 10/25/2019

RFHC
RF Hawkins Consulting
2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rhwkinsconsulting.com

CONSULTANT
next step DESIGN, INC
26170 ENTERPRISE WAY SUITE 400
LAKE FOREST, CA 92650
PHONE: (949) 215-3339
FAX: (949) 215-9375
REG. NO. F 08-38

REGISTERED PROFESSIONAL ENGINEER
SCOTT BEANQUADRE
S.E. 4296
REGISTERED PROFESSIONAL ENGINEER
RALPH STOUT
NO. E001754
EXPIRES 08/28/2018

HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221

GENERAL DEMOLITION NOTES:

- THE CONTRACTOR SHALL COORDINATE WITH THE OWNER, PRIOR TO REMOVAL OF EXISTING EQUIPMENT, PANELS, CONDUCTORS/CABLING AND TURN OVER REMOVED ITEMS THAT THE OWNER REQUESTS IN AS FOUND CONDITION. ITEMS ARE TO BE BOXED AND IDENTIFIED.
- ALL EXISTING CONDUIT AS SHOWN ON PLANS WERE TAKEN FROM OWNERS RECORD DRAWINGS. THE CONTRACTOR IS RESPONSIBLE TO VERIFY EXISTING LOCATION AND ROUTING OF CONDUITS.
- REMOVE EXISTING CABLING/CONDUCTORS FROM EXISTING FEEDER CONDUIT. CLEAN EXISTING UNDERGROUND CONDUIT AND MANHOLE TO INSURE INTEGRITY, WITNESSED BY I.O.R. FOR FUTURE USE. SEAL ALL ENDS OF CONDUITS.
- PROVIDE BLANK COVERS ON ALL EXISTING OUTLETS NOT BEING REUSED. MATCH EXISTING COVERS IN TYPE AND COLOR.
- WHERE EXISTING EQUIPMENT, BOXES, CONDUIT ETC. IS REMOVED, REPAIR EXISTING SURFACES TO MATCH SURROUNDING AREA.

SERVICE INTERRUPTION NOTES:

- THE CONTRACTOR SHALL PROVIDE CONTINUOUS ELECTRICAL SERVICE TO CAMPUS AS REQUIRED. PROVIDE ALL COSTS FOR BACK-UP POWER IN BID. CONTRACTOR WILL PROVIDE A SCHEDULE FOR ANY SERVICE INTERRUPTION AND NOTIFY THE DISTRICT 7 DAYS IN ADVANCE PRIOR TO SHUT-DOWN.
- NON ESSENTIAL ELECTRICAL SERVICE MAY BE SCHEDULED FOR INTERRUPTION OF UN-OCCUPIED BUILDINGS WITH PRIOR APPROVAL OF DISTRICT.

| NO | DATE | BY | DESCRIPTION |
|----|------|----|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

REVISIONS

| DRAWN: | CHECKED: |
|--------|----------|
| JC | RFH |

DATE: 8/31/2018 SCALE: AS NOTED

PROJECT NUMBER: 17-301

GENERAL NOTES, SYMBOLS LIST & DETAILS



DRAWING NUMBER: **E0.1**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
 RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
next step
 DESIGN, INC.
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 909 49 09-28

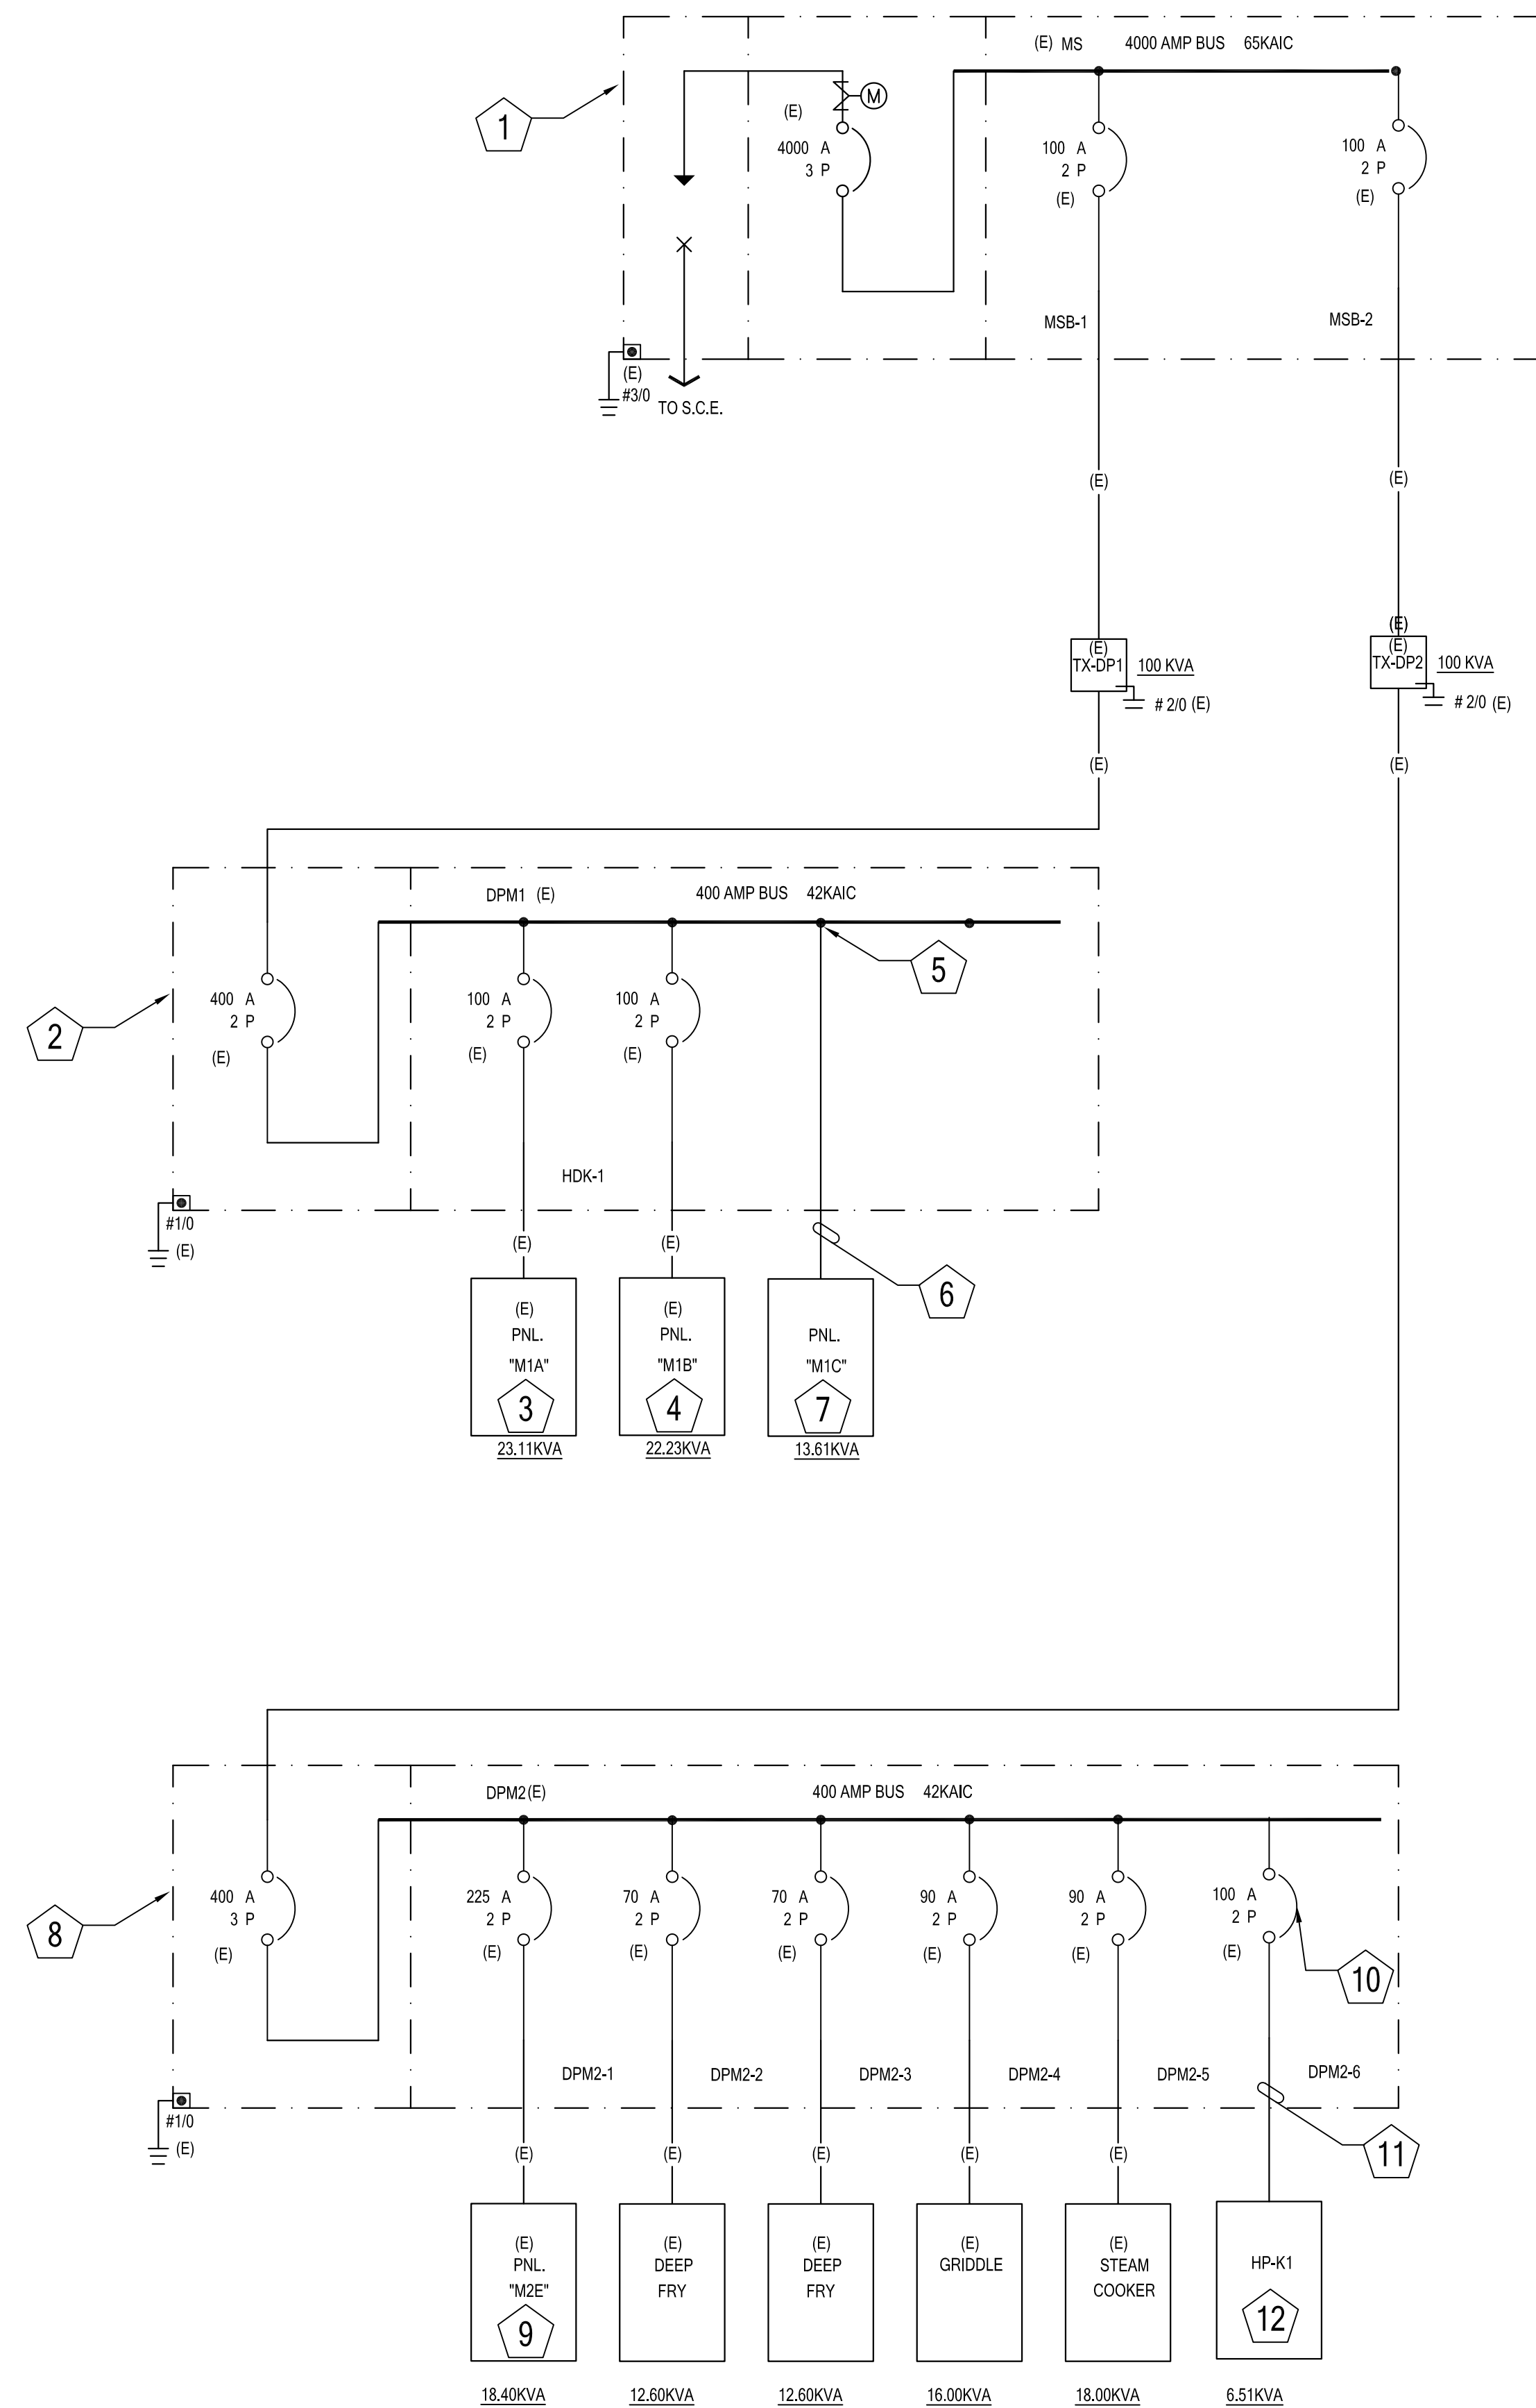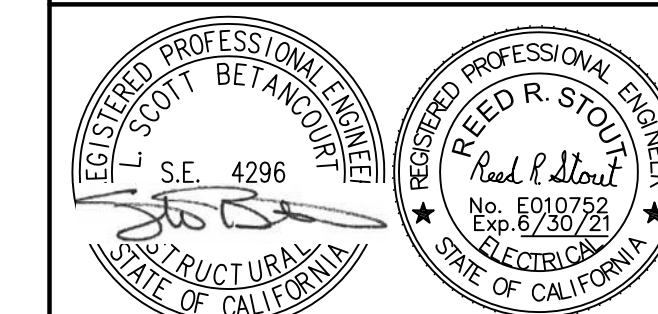

SINGLE LINE DIAGRAM NOTES:

- 1 EXISTING MAIN SWITCH BOARD "MS" NEMA 3R, 12 KV 3 PHASE 4 WIRE 4000 AMP 65000 AIC NEMA 3R.
- 2 EXISTING DISTRIBUTION PANELBOARD "DPM1" NEMA 1, 120/240 VOLT 1 PHASE 3 WIRE 400 AMP 42000 AIC NEMA 1.
- 3 EXISTING PANELBOARD "M1A", NEMA 1 SURFACE 120/240 VOLT 1 PHASE 3 WIRE 100 AMP 10000 AIC NEMA 1.
- 4 EXISTING PANELBOARD "M1B", NEMA 1 SURFACE 120/240 VOLT 1 PHASE 3 WIRE 100 AMP 10000 AIC NEMA 1.
- 5 TAP EXISTING BUSS FOR NEW PANEL "M1C", PROVIDE (3) # 1 & (1) #6 E/G.
- 6 1-1/2" C. w/ (3) #1 & (1) #6 E/G.
- 7 PANELBOARD "M1C", NEMA 1 SURFACE 120/240 VOLT 1 PHASE 3 WIRE 100 AMP 10000 AIC NEMA 1.
- 8 EXISTING DISTRIBUTION PANELBOARD "DPM2" NEMA 1, 120/240 VOLT 1 PHASE 3 WIRE 400 AMP 42000 AIC NEMA 1.
- 9 PANELBOARD "M2E", NEMA 1 SURFACE 120/240 VOLT 1 PHASE 3 WIRE 100 AMP 10000 AIC NEMA 1.
- 10 REMOVE EXISTING 100A 2/P BREAKER AND REPLACE WITH 50A 2/P BREAKER, MATCH NEW BREAKER IN MAKE, MODEL AND ALL CHARECTERISTICS.
- 11 3/4" C. w/ (2) #6 & (1) #10 E/G.
- 12 HVAC HP-K1. REFER TO E1.1 ROOF PLAN.

SCHEDULE FOR PANEL: "M1C"

BUSSING AMPS: 100 VOLTAGE: 120/240 PHASE: 1Ø WIRE: 3W NEMA: 1
 MAINS: 100 MCB MOUNTING: SURFACE AIC RATING: 10,000

REMARKS: *PROVIDE LOCK-ON DEVICE.
 *PAINT BREAKER HANDLE "RED"

| LOAD DESCRIPTION | V/A | AMP | PHASE | AMP | V/A | LOAD DESCRIPTION | |
|-------------------|------|------|-------|-----|---------|--------------------------|-----|
| 1 HP-K2 | 3253 | 50 | A | 20 | 600 | FIRE ALARM CONTROL PANEL | 2 * |
| 3 " | 3253 | 2/P | B | 20 | 600 | FIRE ALARM POWER SUPPLY | 4 * |
| 5 HP-K3 | 3253 | 50 | A | * | A | SPACE | 6 |
| 7 " | 3253 | 2/P | B | * | B | SPACE | 8 |
| 9 ROOF RECEPTACLE | 600 | 20 | A | * | A | SPACE | 10 |
| 11 SPACE | B | * | B | * | B | SPACE | 12 |
| 13 SPACE | A | * | A | * | A | SPACE | 14 |
| 15 SPACE | B | * | B | * | B | SPACE | 16 |
| V/A SUB-TOTAL: | | 7106 | 6506 | | 600 600 | V/A SUB-TOTAL: | |

VOLTAMPS: PHASE A: 7706 PHASE B: 7706 TOTAL CONNECTED VA: 15412
 (CONTINUOUS VA (15412) x 1.25 : 19265)+ (REMAINDER x 1.00) = TOTAL DEMAND VA: 19265 TL AMPS: 80.2

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

| NO | DATE | BY | DESCRIPTION |
|----|------|----|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

REVISIONS
 DRAWN: JC CHECKED: RFH
 DATE: 8/31/2018 SCALE: AS NOTED
 PROJECT NUMBER: 17-301

SINGLE LINE DIAGRAM & PANEL SCHEDULE

DRAWING NUMBER : **E0.2**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
 RF Hawkins Consulting


2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
next step
 DESIGN, INC
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 602.09 P. 08-208



BUILDING A#'s

- BLDG. A A#9728
- BLDG. A A#17886
- BLDG. B A#9728
- BLDG. C A#2999
- BLDG. C A#9728
- BLDG. D A#9728
- BLDG. E A#2454
- BLDG. E A#9728
- BLDG. F A#9728
- BLDG. G A#9728
- BLDG. Q A#3139
- BLDG. R A#4703
- BLDG. U A#27842
- BLDG. W A#
- BLDG. X A#4713
- BLDG. X A#20290
- BLDG. Y A#16578
- BLDG. Y A#108986
- ALLIED HEALTH A#
- CENTRAL PLANT A#113210
- CHILD DEV. CTR. A#42100
- CHILD DEV. CTR. A#104777
- INFANT, TODDLER LEARNING RES. A#10517
- MS A#69120
- MIS A#69120
- SSC A#105117
- STADIUM A#32362

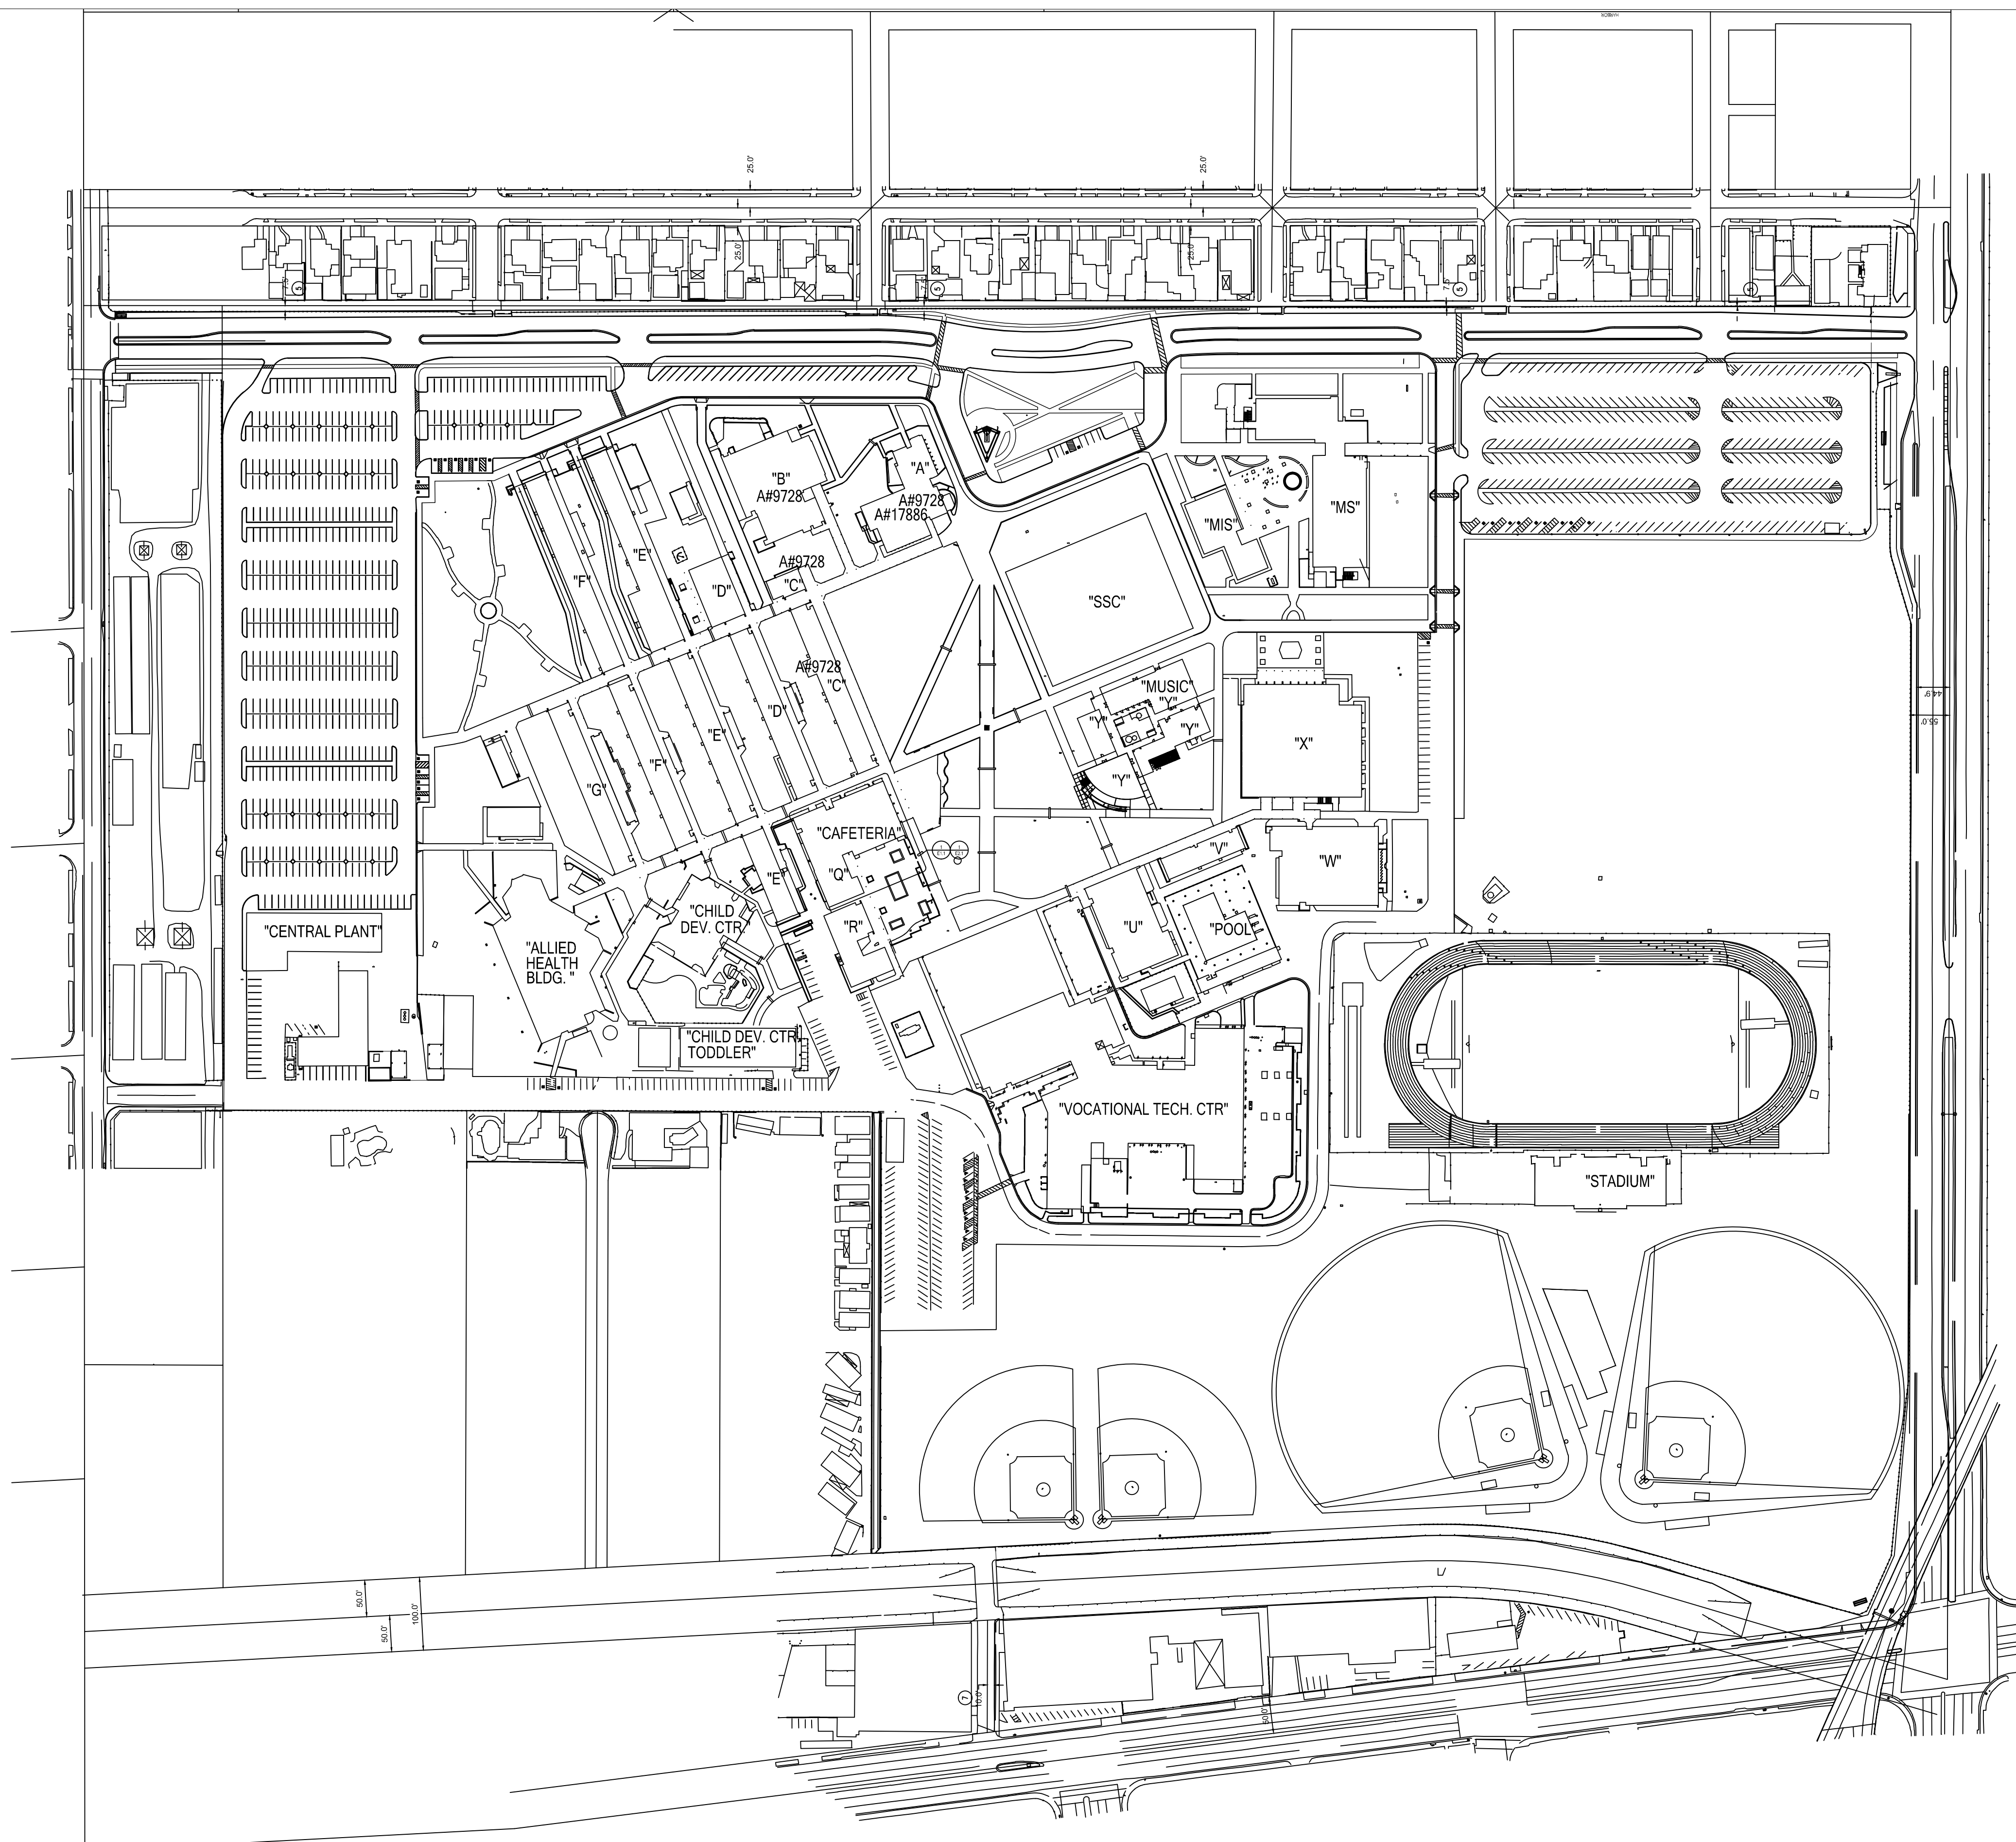

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

| NO | DATE | BY | DESCRIPTION |
|----|------|----|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

REVISIONS

| | |
|-----------------|-----------------|
| DRAWN: JC | CHECKED: RFH |
| DATE: 8/31/2018 | SCALE: AS NOTED |
| PROJECT NUMBER: | 17-301 |

SITE PLAN



DRAWING NUMBER : **E1.0**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com


CONSULTANT
next step
DESIGN, INC
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 REG. 09 FEB 08-28

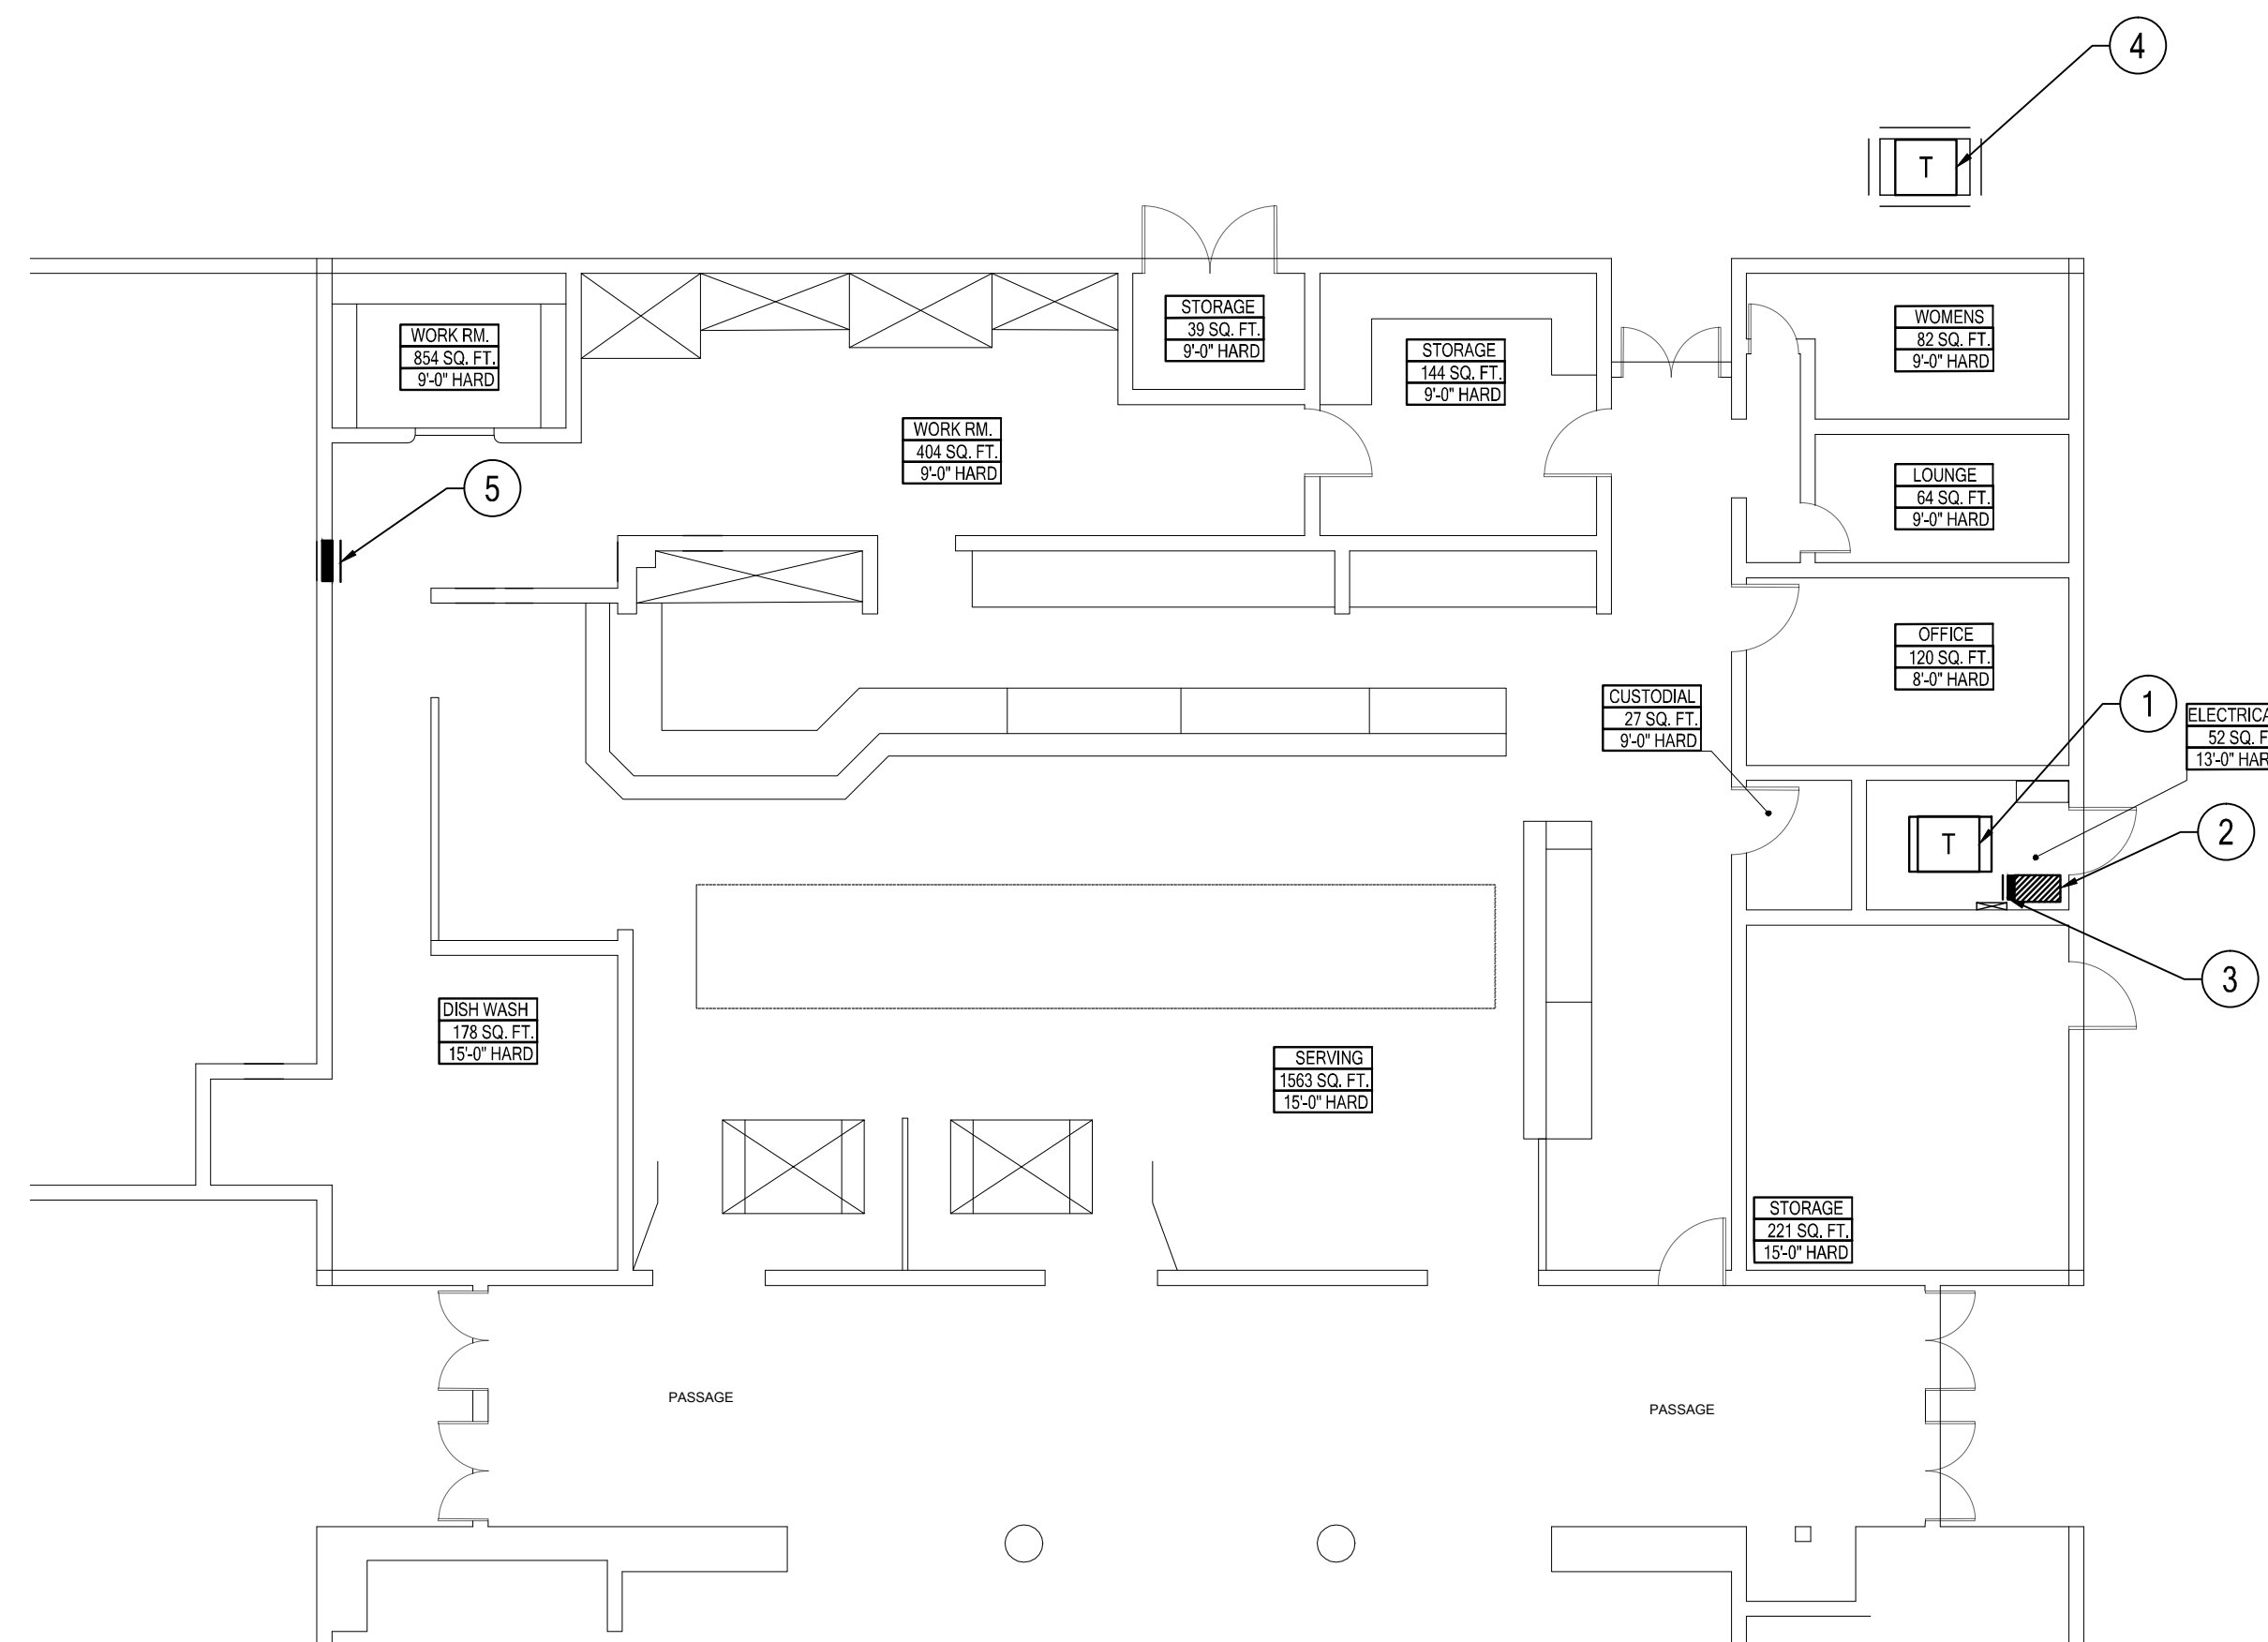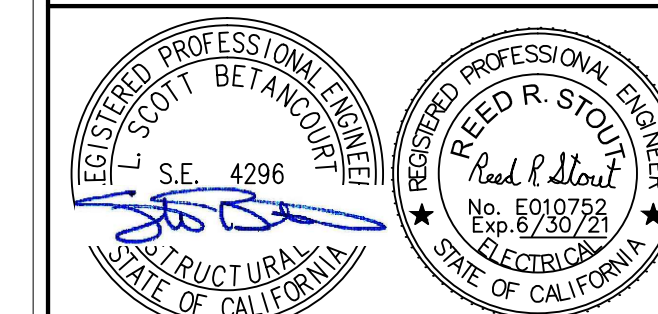

ELECTRICAL FLOOR PLAN NOTES:

- ① EXISTING TRANSFORMER "TX-DP1" 12KV/240V 100KVA 1 PHASE 3 WIRE.
- ② EXISTING DISTRIBUTION PANEL "DPM-1" 400A 120/240V 1 PHASE 3 WIRE.
- ③ PANEL "M1C" 100A 120/240V 1 PHASE 3 WIRE. REFER TO SINGLE LINE DIAGRAM.
- ④ EXISTING TRANSFORMER "TX-DP2" 12KV/240V 100KVA 1 PHASE 3 WIRE.
- ⑤ EXISTING DISTRIBUTION PANEL "DPM2" 400A 120/240V 1 PHASE 3 WIRE.


ELECTRICAL FLOOR PLAN BUILDING "CAFETERIA" 1/8"=1'-0"

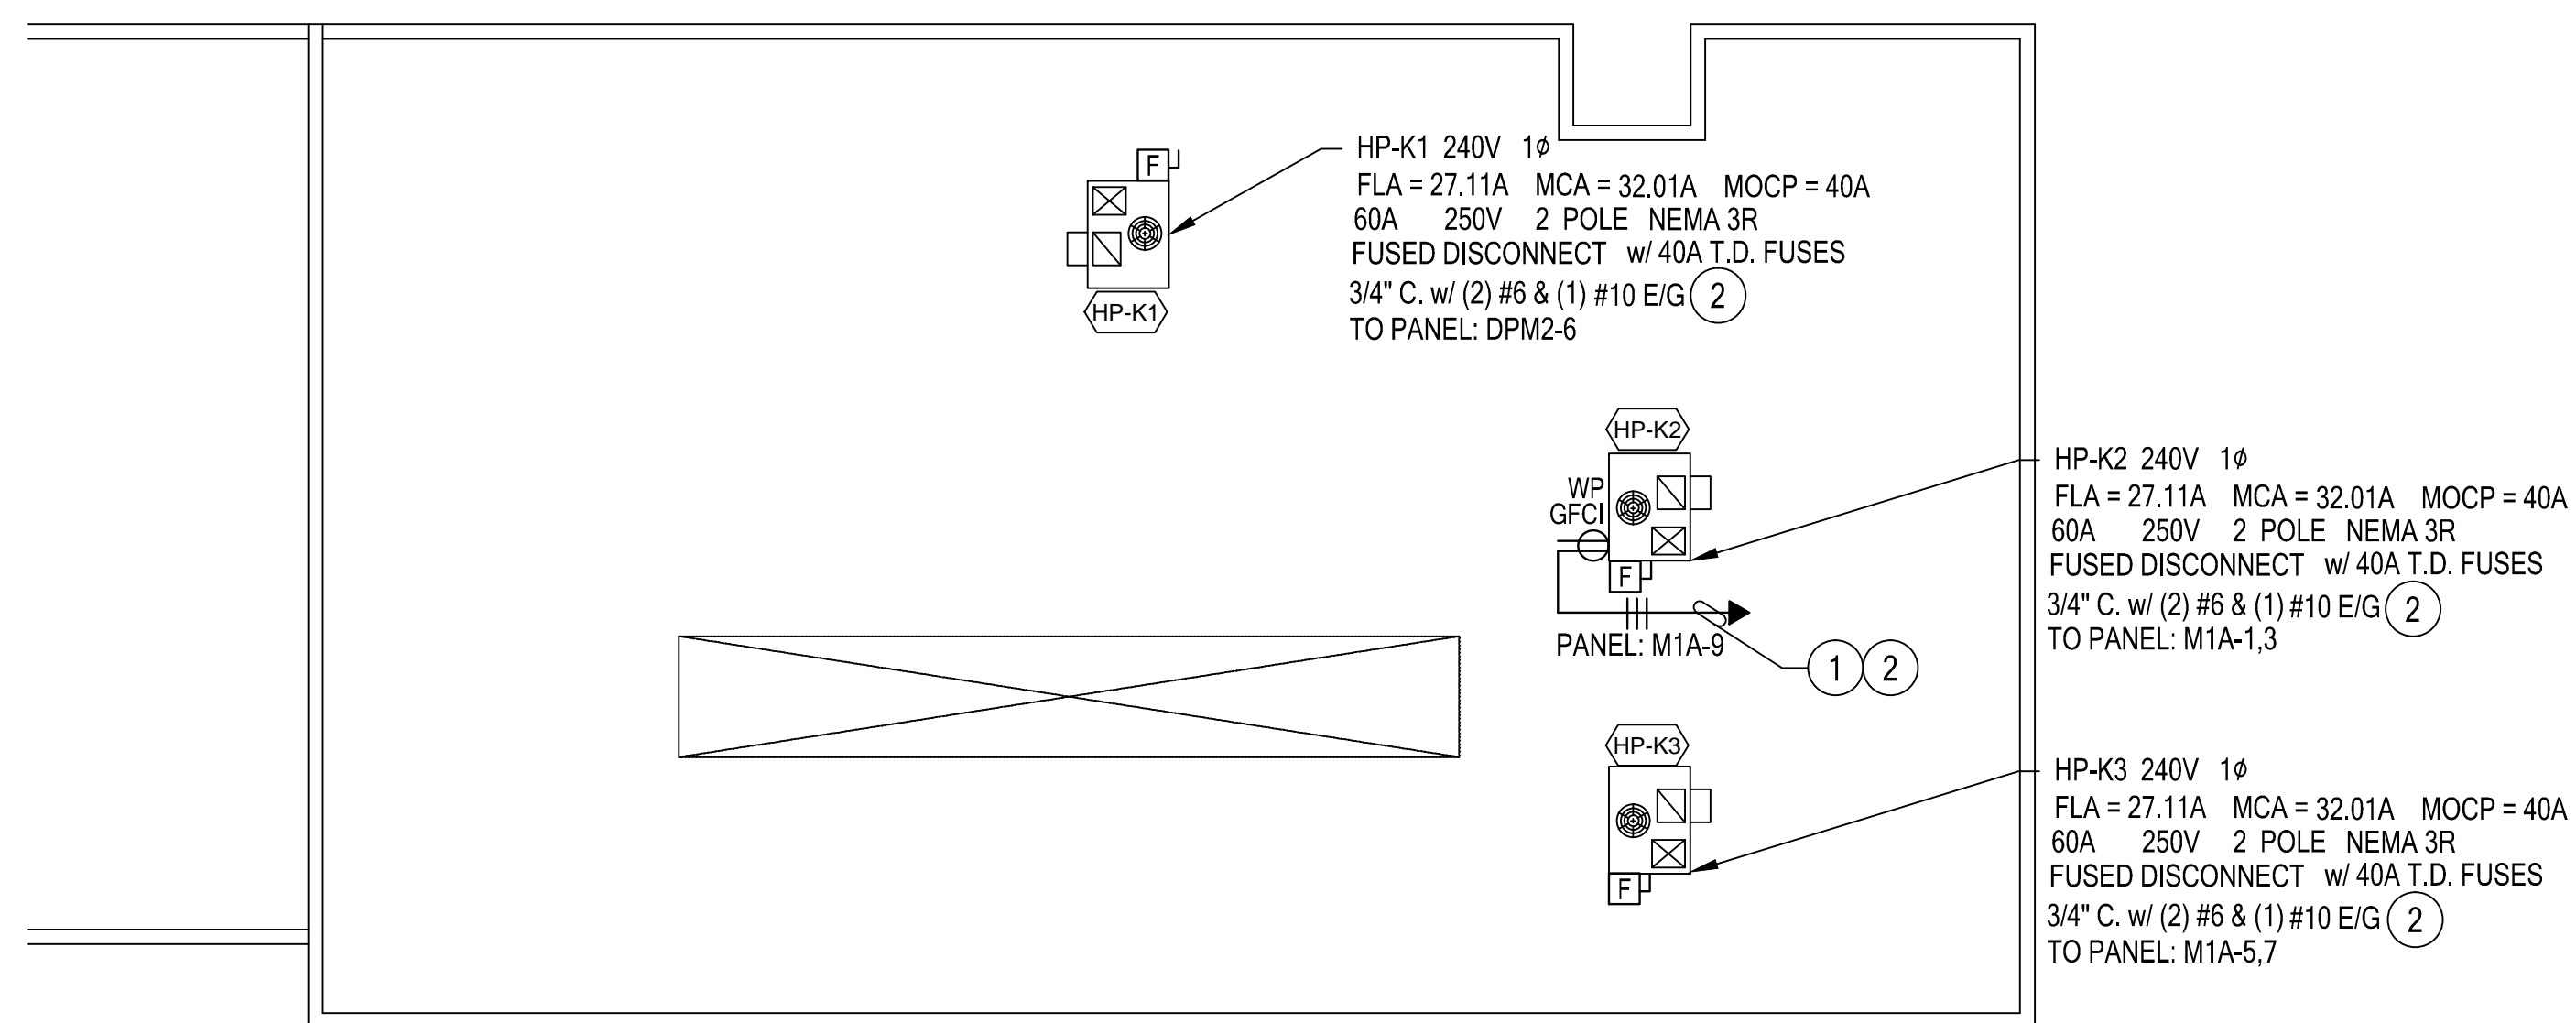

ELECTRICAL ROOF PLAN NOTES:

- ① 3/4" C. w/ (2) #12 & (1) #12 E/G TO PANEL M1A-9.
- ② ROUTE CONDUIT DOWN THRU ATTIC TO PANELS. REFER TO FLOOR PLAN.

ELECTRICAL ROOF PLAN BUILDING "CAFETERIA" 1/8"=1'-0"

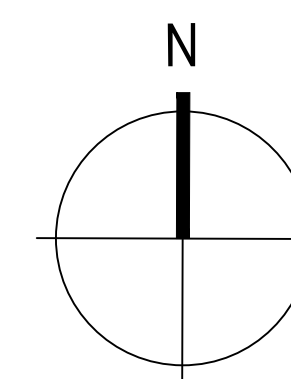

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

| NO | DATE | BY | DESCRIPTION |
|-----------------|-----------|----------|-------------|
| | | | |
| | | | |
| | | | |
| | | | |
| REVISIONS | | | |
| DRAWN: | JC | CHECKED: | RFH |
| DATE: | 8/31/2018 | SCALE: | AS NOTED |
| PROJECT NUMBER: | 17-301 | | |


**ELECTRICAL
 FLOOR & ROOF
 PLANS**

DRAWING NUMBER : **E1.1**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

FIRE ALARM FLOOR PLAN NOTES:


- 1 FIRE ALARM CONTROL PANEL. REFER TO FIRE ALARM SUBMITTAL. PROVIDE 1/2c. w/ (2) #12 & (1) #12 E/G TO PANEL "M1C-2". PROVIDE LOCK-ON DEVICE AND PAINT BREAKER HANDLE RED.
- 2 FIRE ALARM CONTROL POWER SUPPLY. REFER TO FIRE ALARM SUBMITTAL. PROVIDE 1/2c. w/ (2) #12 & (1) #12 E/G TO PANEL "M1C-4". PROVIDE LOCK-ON DEVICE AND PAINT BREAKER HANDLE RED.
- 3 PANEL "M1C" 100A 120/240V 1 PHASE 3 WIRE. REFER TO SINGLE LINE DIAGRAM.
- 4 1/2" C. w/ (2) #14 TO HVAC UNIT ON ROOF FOR SHUTDOWN UPON FIRE ALARM ACTIVATION. REFER TO MECH. DRAWINGS.
- 5 EXISTING A/C UNIT FOR STUDENT LOUNGE.
- 6 FIRE ALARM ANNUNCIATOR PANEL. REFER TO FIRE ALARM SUBMITTAL. PROVIDE 3/4"C. w/ (1) 4/C #16 & (1) #12 SPEAKER CABLE TO FACP.

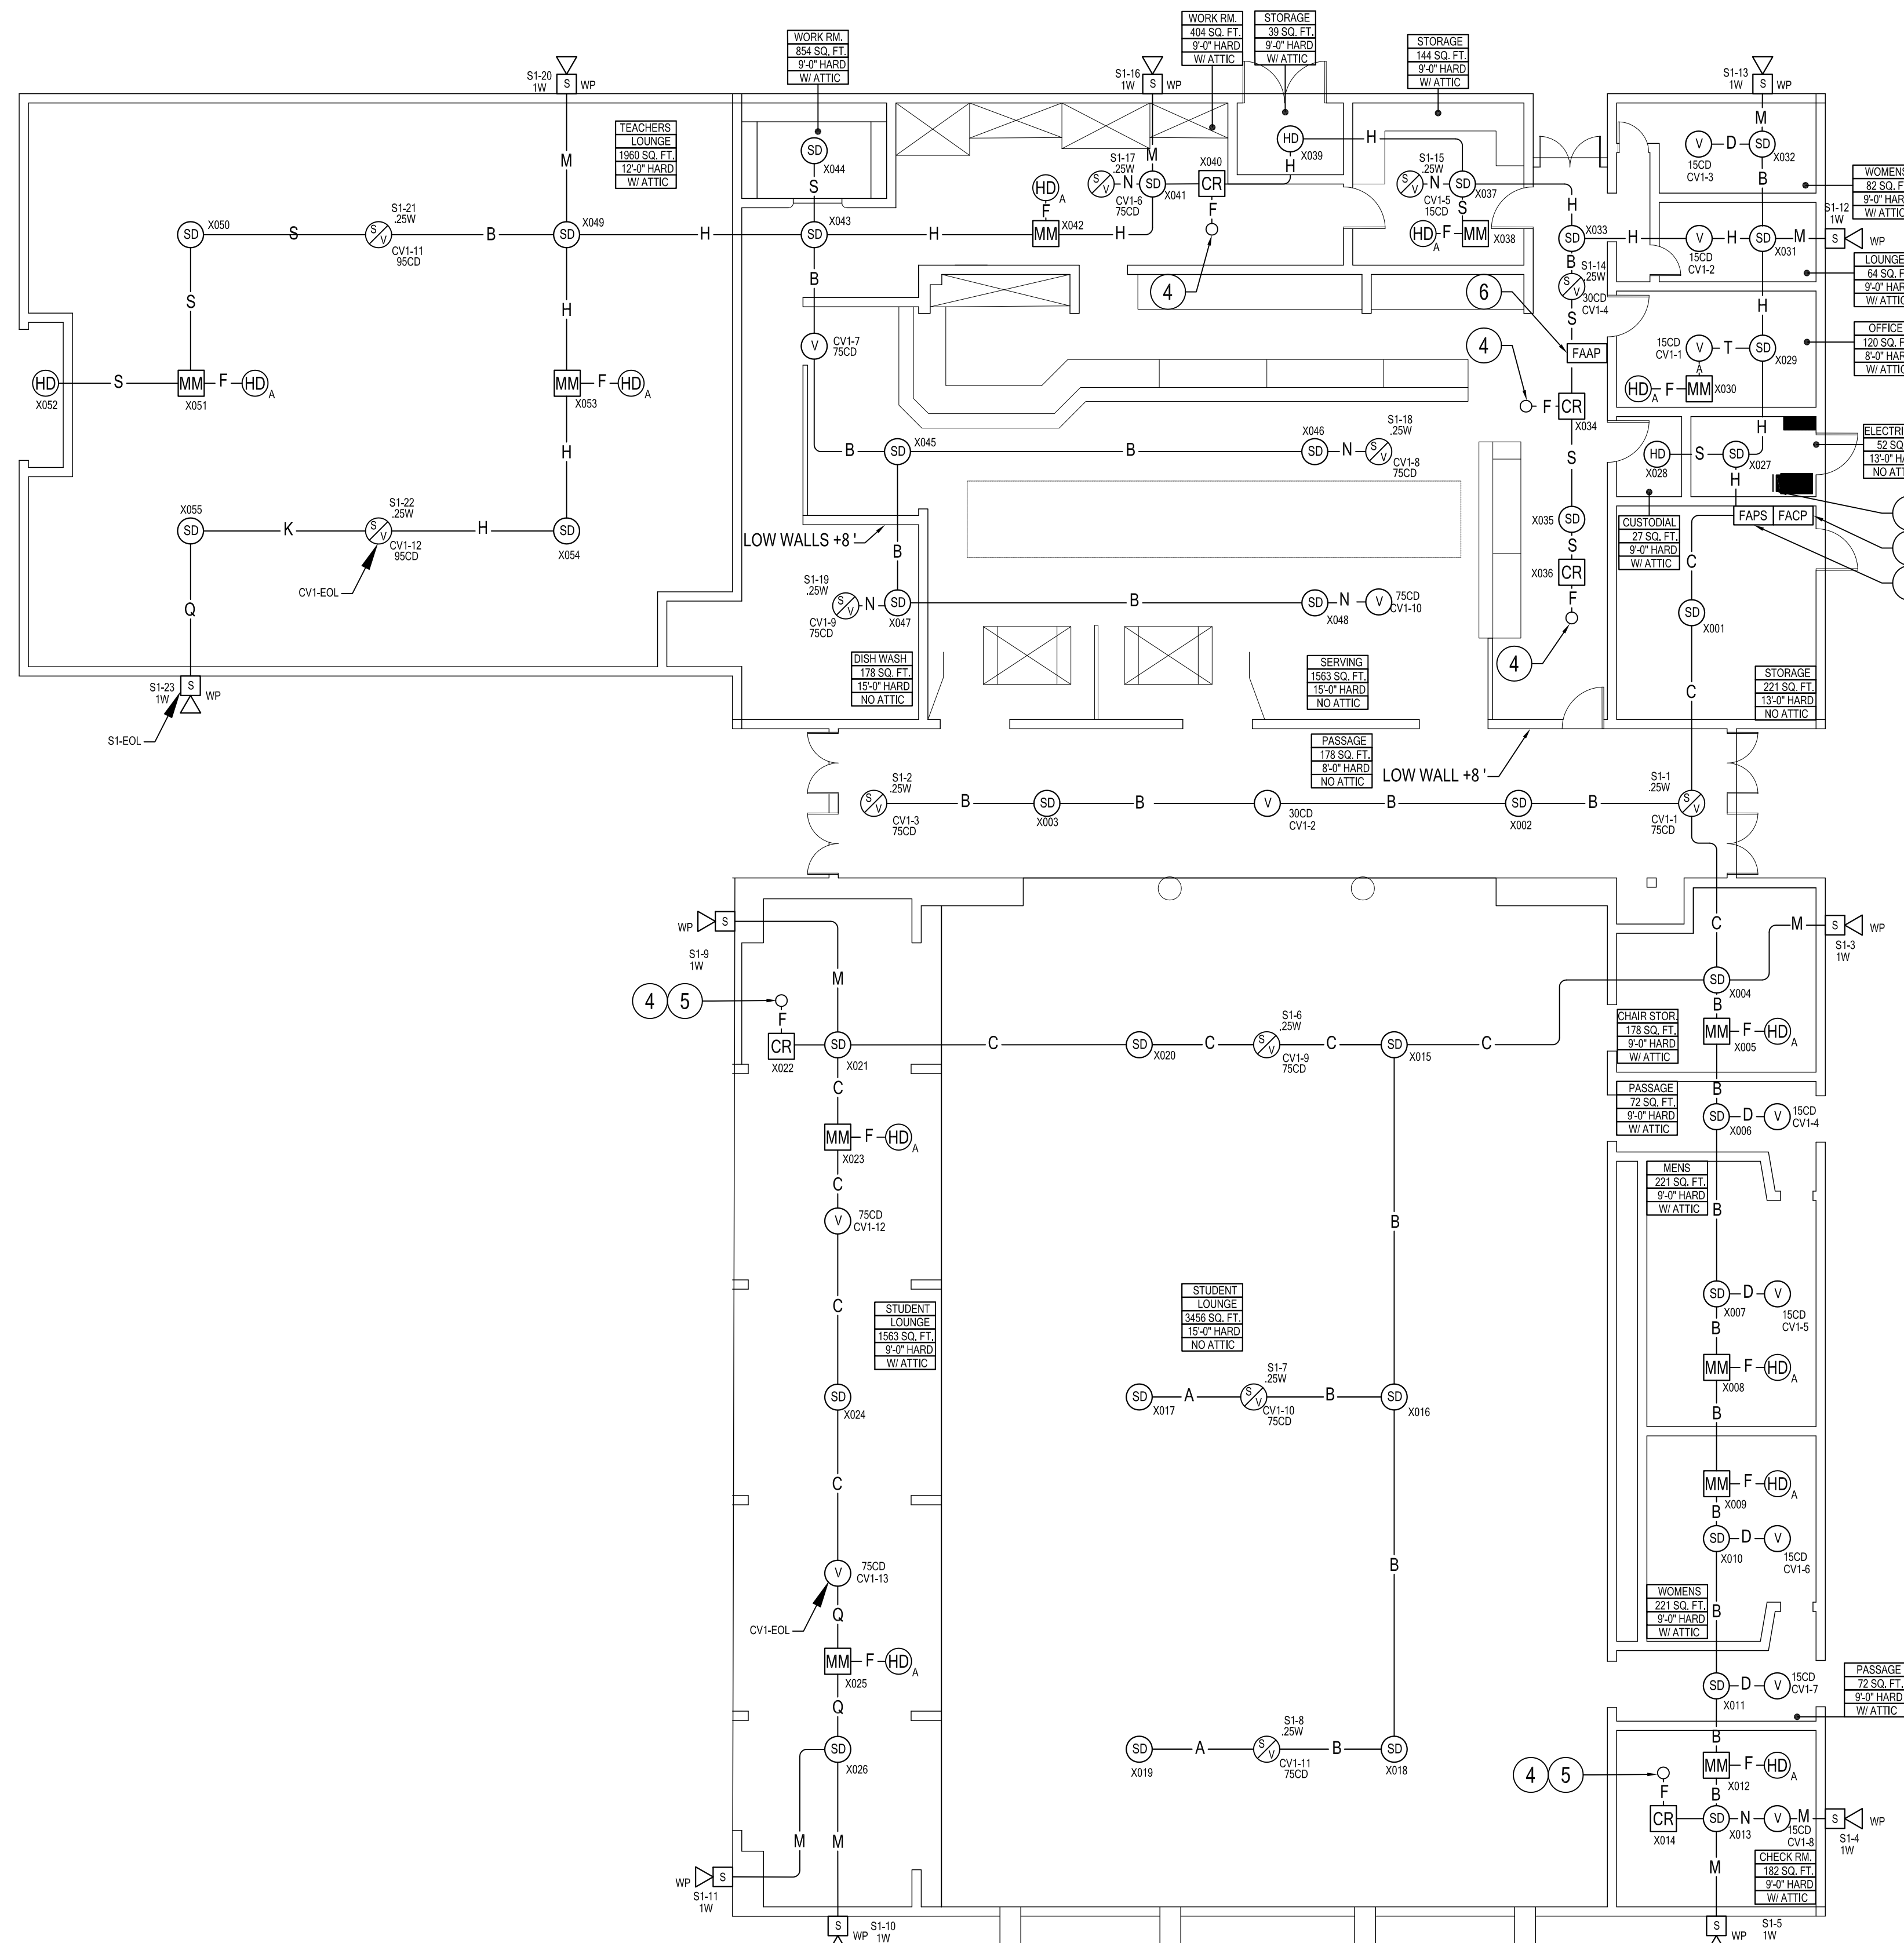

FIRE ALARM WIRING LEGEND

| SYMBOL | (3/4" CONDUIT U.O.N.) |
|--------|--------------------------------------|
| —A— | (1) #16 T.P. |
| —B— | (2) #16 T.P., (2) #16/2 S. & (4) #12 |
| —C— | (2) #16 T.P., (2) #16/2 S. & (2) #12 |
| —D— | (4) #12 |
| —E— | (2) #12 |
| —F— | (2) #14 |
| —G— | (1) #16 T.P., (2) #14 |
| —H— | (1) #16 T.P., (1) #16/2 S. & (2) #12 |
| —J— | (1) #16 T.P. & (2) #12 |
| —K— | (1) #16 T.P., (1) #16/2 S. |
| —L— | (1) #16 T.P., (4) #12 |
| —M— | (2) #16/2 S. |
| —N— | (2) #16/2 S. & (4) #12 |
| —P— | (2) #12/2 & (2) #12 |
| —Q— | (2) #16/2 S. & (2) #16 T.P. |
| —R— | (1) #16/2 S. |
| —S— | (2) #16 T.P. |
| —T— | (2) #16 T.P. & (4) #12 |

FIRE ALARM FLOOR PLAN BUILDING "CAFETERIA" 1/8"=1'-0"

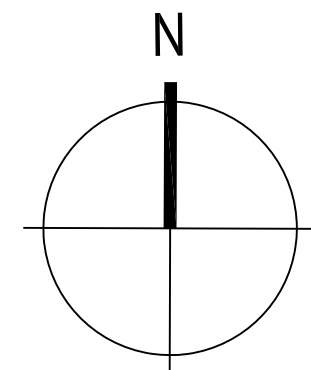

RFHC
 RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
next step
 DESIGN, INC.
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92650
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 905 09 # 09-28



**HVAC ADDITIONS TO
 CAFETERIA BLDG.**
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221




| NO | DATE | BY | DESCRIPTION |
|----|------|----|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

REVISIONS

| | |
|------------------------|-----------------|
| DRAWN: JC | CHECKED: RFH |
| DATE: 8/31/2018 | SCALE: AS NOTED |
| PROJECT NUMBER: 17-301 | |

**FIRE ALARM
 FLOOR PLAN**

DRAWING NUMBER : **E2.1**

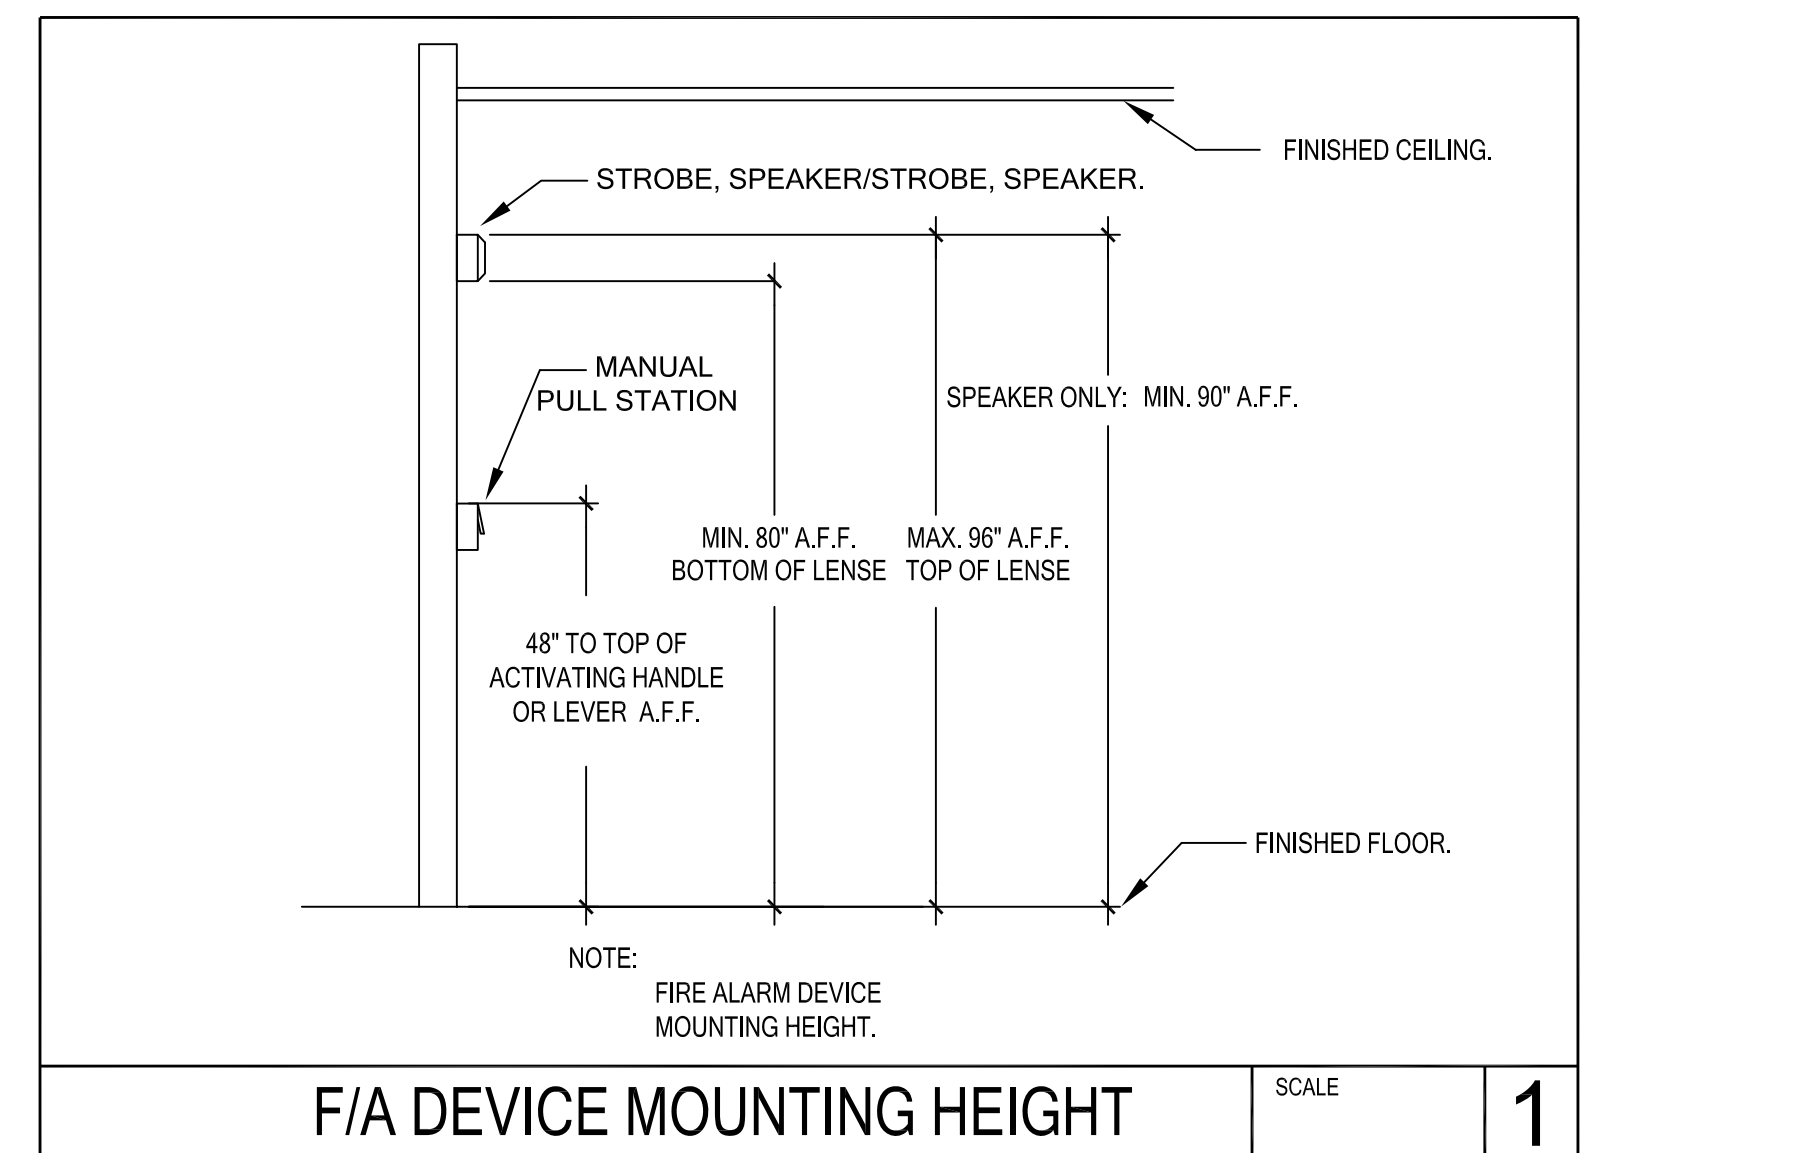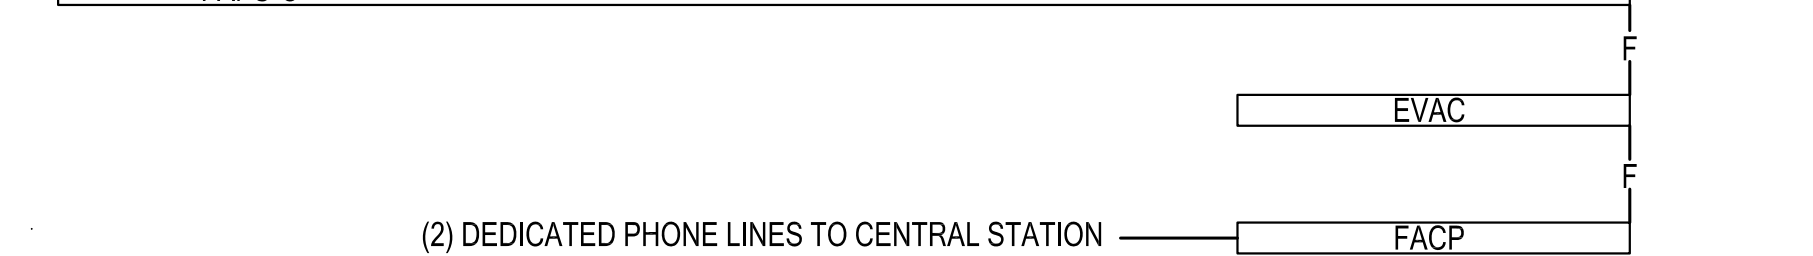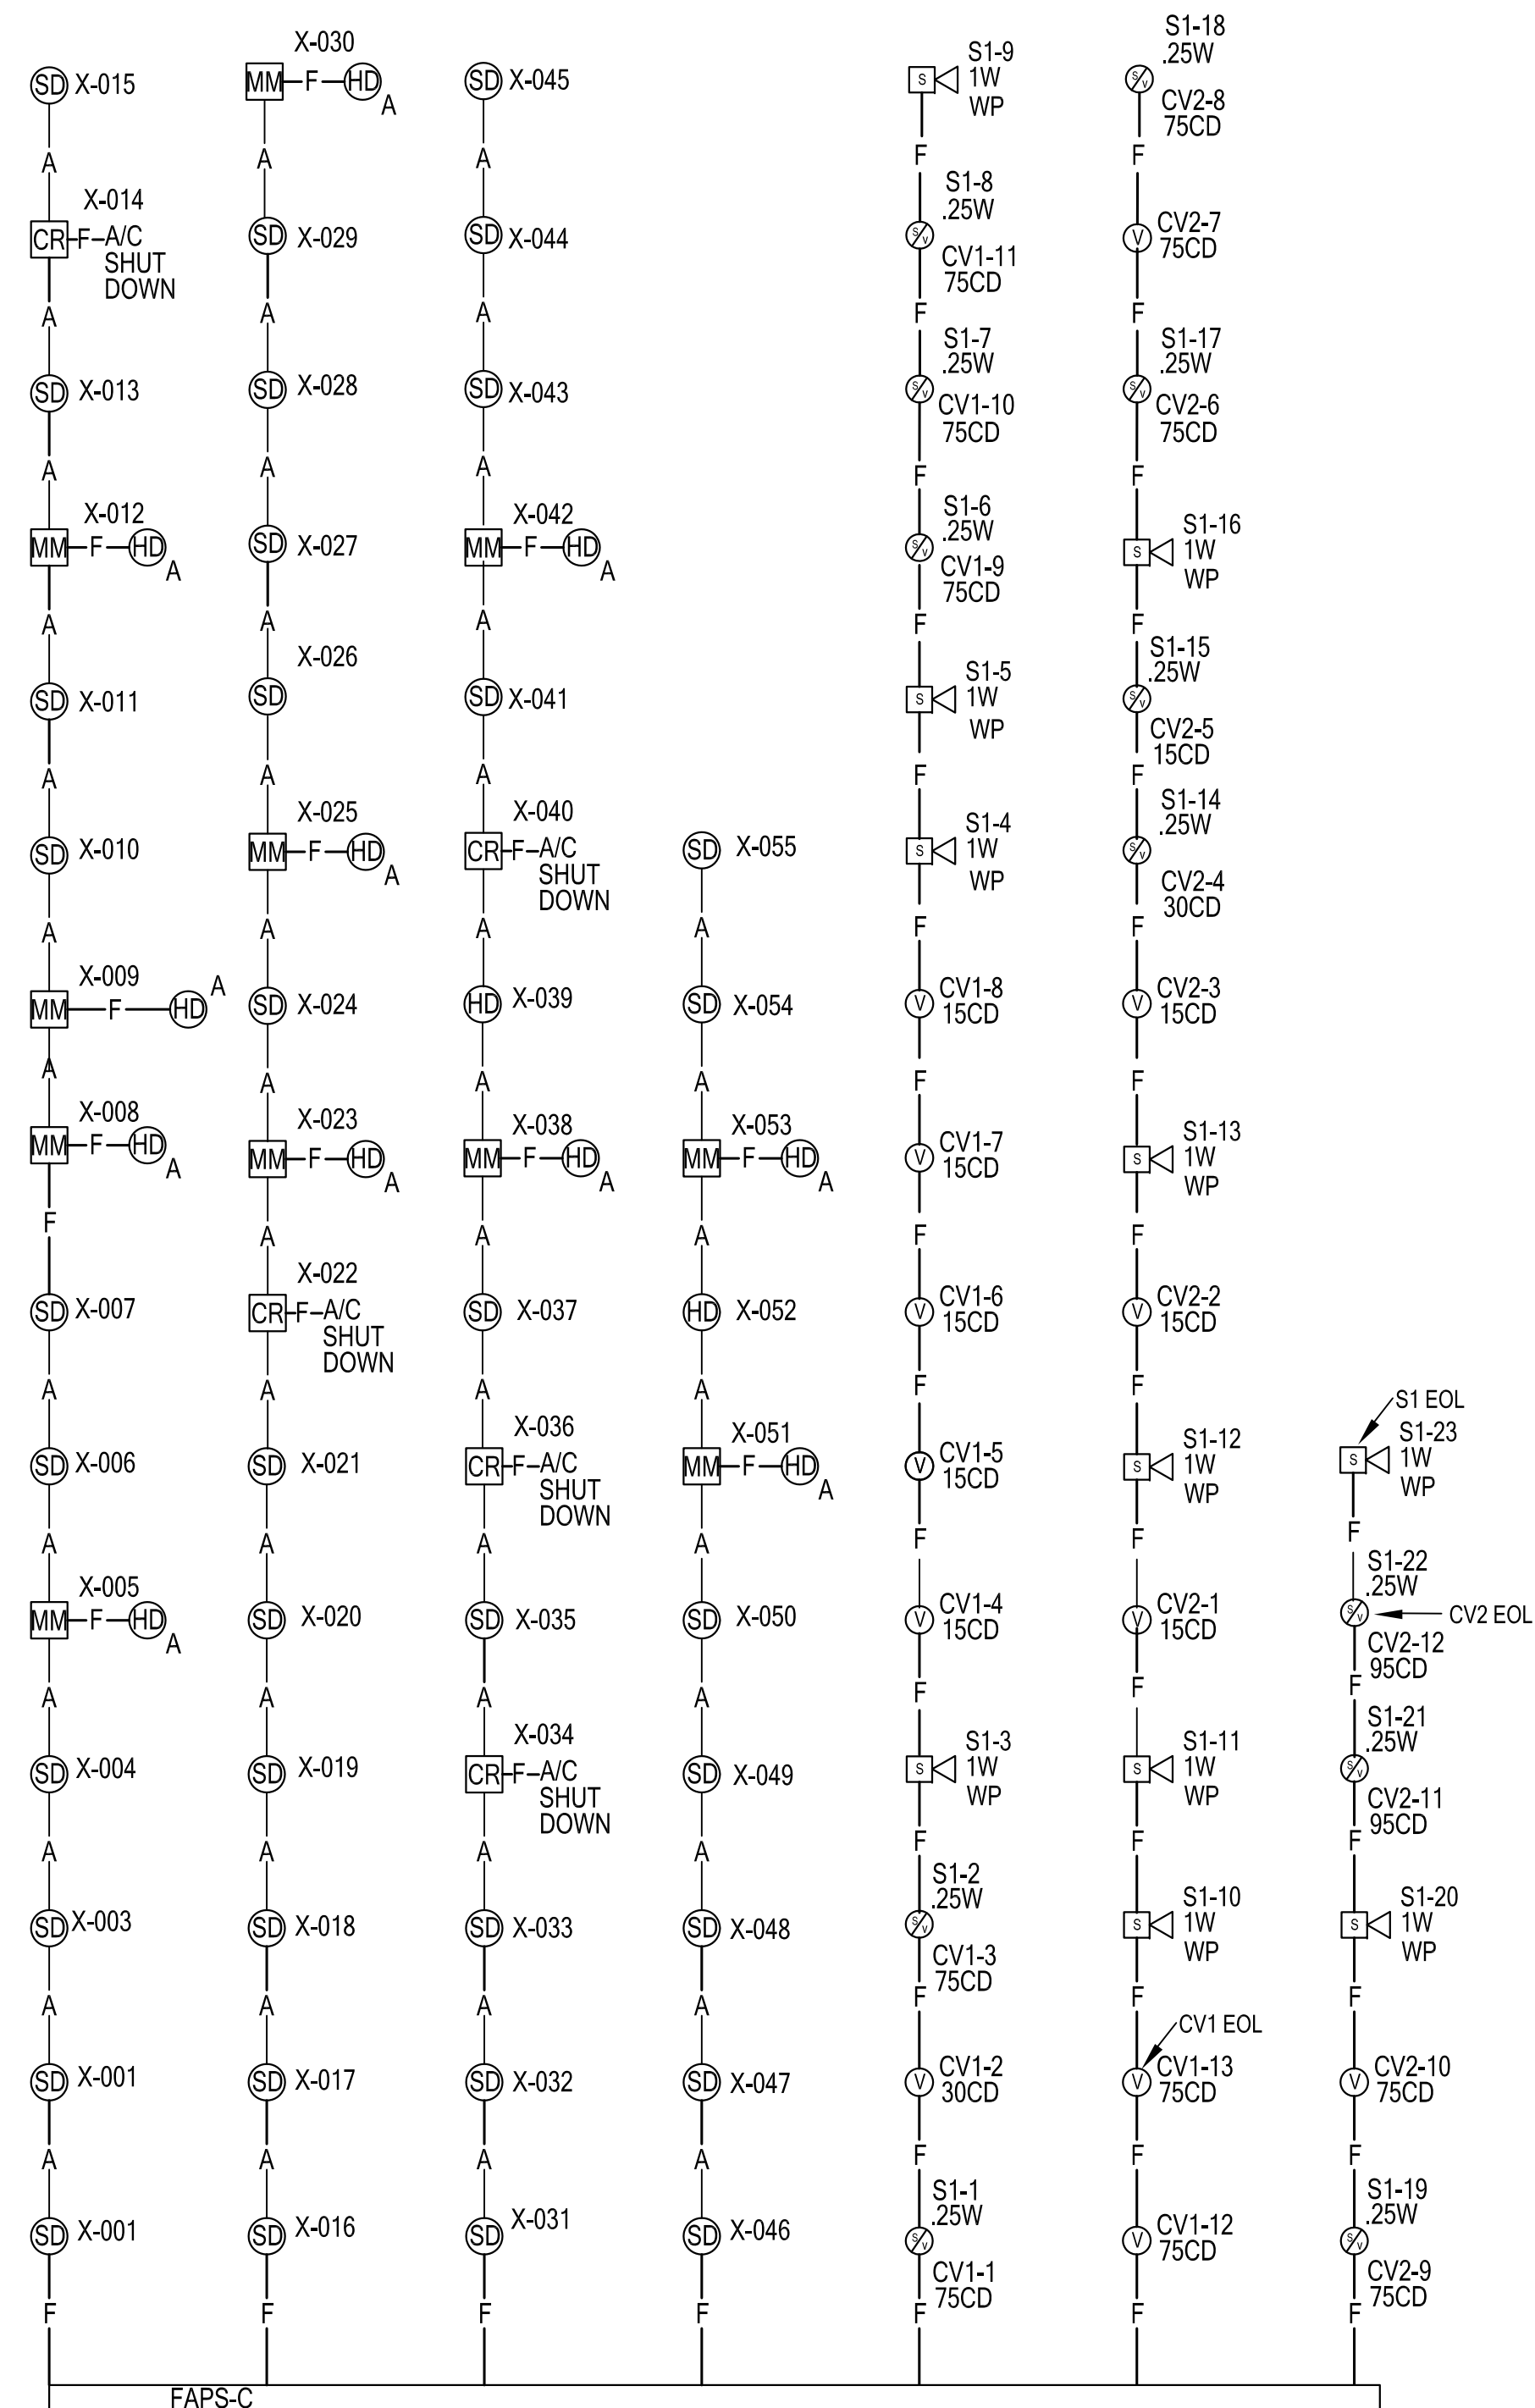

FACP "C" BATTERY CALCULATIONS

1. POWER FAILURE CONDITION (STANDBY FOR 24 HOURS)

| ITEM | DESCRIPTION | QTY. | AMPS | TOTAL AMPS |
|--------------------|---------------------------------------|------|-------|-------------|
| A. | 4100 FIRE ALARM CONTROL CIRCUIT BOARD | 1 | .4450 | .4450 |
| B. | 4100 UDACT | 1 | .0400 | .0400 |
| C. | 4003 EVAC CONTROL PANEL | 1 | .130 | .1300 |
| D. | FIRE ALARM ANNUNCIATOR PANEL | 1 | .300 | .3000 |
| E. | ADDRESSABLE SMOKE DETECTOR | 37 | .0008 | .0296 |
| F. | ADDRESSABLE HEAT DETECTOR | 2 | .0008 | .0016 |
| G. | MONITOR MODULES | 11 | .0008 | .0088 |
| H. | CONTROL MODULES | 5 | .0008 | .0040 |
| I. | | | | |
| J. | | | | |
| K. | | | | |
| L. | | | | |
| M. | | | | |
| N. | | | | |
| STANDBY AMPS TOTAL | | | | .9590 A |
| 24 HR. STANDBY | | | | X 24 HR |
| STAND BY AHR TOTAL | | | | 23.0160 AHR |

2. ALARM CONDITION DURING POWER FAILURE FOR 5 MINUTES (.083)

| ITEM | DESCRIPTION | QTY. | AMPS | TOTAL AMPS |
|--|--|------|-------|-------------|
| A. | 4100 FIRE ALARM CONTROL CIRCUIT BOARD | 1 | .5000 | .5000 |
| B. | 4100 UDACT | 1 | .0400 | .0400 |
| C. | 4003 EVAC CONTROL PANEL | 1 | .1300 | .1300 |
| D. | FIRE ALARM ANNUNCIATOR PANEL | 1 | .3000 | .3000 |
| E. | ADDRESSABLE SMOKE DETECTOR | 37 | .0010 | .0370 |
| F. | ADDRESSABLE HEAT DETECTOR | 2 | .0010 | .0020 |
| G. | MONITOR MODULES | 11 | .0010 | .0110 |
| H. | CONTROL RELAY | 5 | .0010 | .0050 |
| I. | SPEAKERS 25W | 12 | .0038 | .0456 |
| J. | SPEAKERS 1W | 11 | .0070 | .0770 |
| K. | STROBES (REFER TO FAPS-C CALCS.) | | | |
| L. | STROBES/STROBES (REFER TO FAPS-C CALCS.) | | | |
| M. | | | | |
| ALARM CONDITION TOTAL AMPS | | | | 1.2404 |
| 15 MINUTE OPERATION x .25 HR | | | | |
| SUB TOTAL | | | | .3101 AHR |
| GRAND TOTAL (STAND BY & ALARM) | | | | 23.3261 AHR |
| (2) BAT-12650 BATTERY USED 50AHR @ 80% | | | | 40.0000 AHR |
| SPARE CAPACITY | | | | 16.6739 AHR |

FAPS-C BLDG. "C"

BATTERY CALCULATIONS

| | | |
|---------------------------------------|------------------|-------------------|
| (8) CEILING STROBES | 15 CD (8x .040) | = .320 A |
| (1) CEILING STROBE | 30 CD (1x .053) | = .053 A |
| (1) CEILING STROBE | 75 CD (4x .155) | = .620 A |
| (1) CEILING SPEAKER/STROBE | 15 CD (1x .040) | = .040 A |
| (1) CEILING SPEAKER/STROBE | 30 CD (1x .053) | = .053 A |
| (8) CEILING SPEAKER/STROBES | 75 CD (8x .155) | = 1.240 A |
| (2) CEILING SPEAKER/STROBES | 95 CD (2x .248) | = .496 A |
| TOTAL = 2.822 A | | |
| NAC ALARM (15 MIN.) | 2.822 A x .249HR | = .702 AHR |
| NAC STANDBY (24 HOURS) | .070 A x 24HR | = 1.6800 AHR |
| NAC TOTAL STANDBY & ALARM = 5.204 AHR | | |
| (2 X 12.0AHR USED) 12.0 AHR @ 80% | | = 9.6000 AHR |
| 9.6000 AHR - 5.2040 AHR | | = 4.396 AHR SPARE |

FAPS-C BLDG. "C"

VOLTAGE DROP (V) ZONE (CV1)

| | | |
|-------------------------------------|-----------------|-------------|
| V = IR | | |
| I = (5) CEILING STROBES | 15 CD (5x .040) | = .200 A |
| I = (1) CEILING STROBE | 30 CD (1x .053) | = .053 A |
| I = (2) CEILING STROBES | 75 CD (2x .155) | = .310 A |
| I = (5) CEILING SPEAKER/STROBES | 75 CD (5x .155) | = .775 A |
| TOTAL = 1.338 A | | |
| R = $\frac{2.05}{1000} \times 300'$ | | = .615 Ω |
| VD = 1.338A x .615 Ω = .883 V | ÷ 24 V | = .037 % VD |

FAPS-C BLDG. "C"

VOLTAGE DROP (V) ZONE (CV2)

| | | |
|-------------------------------------|-----------------|-------------|
| V = IR | | |
| I = (3) CEILING STROBES | 15 CD (3x .040) | = .120 A |
| I = (2) CEILING STROBES | 75 CD (2x .155) | = .310 A |
| I = (1) CEILING SPEAKER/STROBE | 15 CD (1x .040) | = .040 A |
| I = (1) CEILING SPEAKER/STROBE | 30 CD (1x .053) | = .053 A |
| I = (3) CEILING SPEAKER/STROBES | 75 CD (3x .155) | = .775 A |
| I = (2) CEILING SPEAKER/STROBES | 95 CD (2x .248) | = .496 A |
| TOTAL = 1.794 A | | |
| R = $\frac{2.05}{1000} \times 385'$ | | = 1.304 Ω |
| VD = 1.794A x 1.304 Ω = 2.339 V | ÷ 24 V | = .097 % VD |

AMP BLDG. "C" (BLDG. C NAC CIRCUIT)

VOLTAGE DROP (V) ZONE (S1)

| | | |
|--------------------------------------|-------------------|-------------|
| V = IR | | |
| I = (12) SPEAKER/STROBE | .25W (12 x .0036) | = .0432 A |
| (11) SPEAKER WP | 1.0W (11 x .007) | = .0770 A |
| TOTAL = .1202 A | | |
| R = $\frac{4.016}{1000} \times 985'$ | | = 3.956 Ω |
| V = .1202A x 3.956 Ω = .4755 V | ÷ 70 V | = .007 % VD |

FIRE ALARM GENERAL NOTES:

- NEWSYSTEM IS A SIMPLEX 4100, AUTOMATIC ACTIVATED, ADDRESSABLE POWER LIMITED, 24V DC, SUPERVISED FIRE ALARM SYSTEM WITH SUPPLEMENTAL MANUAL PROTECTION IN COMPLIANCE WITH CALIFORNIA BUILDING CODE SECTION 907, THE 2016 CALIFORNIA ELECTRICAL CODE, 2016 NFPA 72 AND 2016 CALIFORNIA FIRE CODE. INCLUDE ALL PROGRAMMING.
- FIRE ALARM CABLE SPLICES IN UNDERGROUND PULL BOXES ARE ABSOLUTELY PROHIBITED.
- ALL FIRE ALARM CONDUIT SHALL BE 3/4" C. UNLESS NOTED OTHERWISE. ALL FIRE ALARM CONDUCTORS SHALL BE INSTALLED IN AN APPROVED RACEWAY.
- ALL CONDUCTORS SHALL BE #12 THWN 600V FOR ALL ALARM AND FA DEVICE POWER CIRCUITS UNLESS NOTED OTHERWISE.
- ALL CONDUCTORS SHALL BE #18 T.S.P. 600 VOLT FOR ALL INITIATING CIRCUITS UNLESS NOTED OTHERWISE.
- CONTRACTOR SHALL FIELD VERIFY NEW DEVICES AND MATCH EXISTING PRIOR TO ROUGH-IN.
- COLOR CODING OF CONDUCTORS AS RECOMMENDED BY MANUFACTURERS REPRESENTATIVE AND AS INDICATED BELOW:
FIRE ALARM PULL STATIONS - (1) DARK BLUE (NEG.), (1) ORANGE (POS.)
FIRE ALARM SMOKE - (1) LT. BLUE (NEG.), (1) YELLOW (POS.)
FIRE ALARM AUDIBLE - (1) BLACK (NEG.), (1) RED (POS.)
FIRE ALARM VISUALS - (1) GRAY (NEG.), (1) PINK (POS.)
- UPON COMPLETION OF THE FIRE ALARM SYSTEM INSTALLATION, THE SYSTEM SHALL BE TESTED IN THE PRESENCE OF AND IN A MANNER ACCEPTABLE TO THE DSA/PROJECT INSPECTOR OF RECORD (IOR). THE LOCAL FIRE AUTHORITY SHALL BE NOTIFIED OF DATE AND TIME OF FINAL FIRE ALARM TESTING AND SHALL ASSIST/WITNESS SUCH TESTING WHEN ABLE.
- FIRE ALARM CONTRACTOR SHALL SUPPLY ALL NECESSARY TEST EQUIPMENT TO PERFORM REQUIRED TESTING INCLUDING A "SOUND LEVEL METER" TO CHECK THE ACCEPTABLE LEVELS OF AUDIBLE DEVICES. ALL NORMALLY OCCUPIED AREAS SHALL BE PROVIDED WITH A FIRE ALARM AUDIBLE LEVEL AT 15dbA ABOVE AMBIENT NOISE LEVELS. PROVIDE INTELLIGIBILITY TEST FOR ALL AREAS OF COVERAGE.
- FIRE ALARM CONTRACTOR SHALL PERFORM AN "END OF LINE RESISTANCE" TEST IN THE PRESENCE OF THE "IOR" FOR EACH CIRCUIT AND IT SHALL NOT EXCEED 10% OF THE 24 VOLT SYSTEM. EACH COMPONENT IN THE SYSTEM SHALL NOT EXCEED THE LISTED MANUFACTURER'S MINIMUM OPERATING VOLTAGE. THE LOOP RESISTANCE TEST INCLUDES ALL INITIATING AND INDICATING (NOTIFICATION APPLIANCE) CIRCUITS.
- IOR SHALL VERIFY THAT ALL STROBE APPLIANCES FLASH AT A RATE OF NOT EXCEEDING TWO FLASHES PER SECOND, NOR BE LESS THAN ONE FLASH PER SECOND.
- FIRE ALARM CONTRACTOR SHALL PROVIDE ALL TEST RESULTS AND A "RECORD OF COMPLETION" TO THE IOR AFTER COMPLETION OF OPERATIONAL ACCEPTANCE TESTS (2016 NFPA 72, SECTION 10.4.1, SECTION 1-7.2.2 & FIGURE 1-7.2.1) TO THE ARCHITECT, ENGINEER, DSA, PROJECT INSPECTOR (IOR), OWNER AND TO THE LOCAL FIRE AUTHORITY HAVING JURISDICTION.
- EVERY NEW FIRE ALARM SYSTEM SHALL PROVIDE A DOCUMENTATION CABINET, INSTALLED AT THE SYSTEM CONTROL PANEL OR OTHER APPROVED LOCATION. THE DOCUMENTATION CABINET SHALL BE PROMINENTLY LABELED "SYSTEM RECORD DOCUMENTS". ALL RECORD AND TESTING DOCUMENTATION SHALL BE STORED IN THE CABINET. CONTENTS SHALL BE ACCESSIBLE BY AUTHORIZED PERSONNEL ONLY. WHERE CABINET IS INSTALLED IN A LOCATION OTHER THAN THE SYSTEM CONTROL UNIT, ITS LOCATION SHALL BE IDENTIFIED AT THE SYSTEM CONTROL UNIT. SYSTEM DOCUMENTS AS APPLICABLE:
RECORD DRAWINGS/AS-BUILTS, EQUIPMENT CUT SHEETS AND CSFM LISTINGS
ALTERNATIVE MEANS AND METHODS, PERFORMANCE BASED DESIGN DOCUMENTATION
SYSTEM RECORD OF COMPLETION & ANY SUPPLEMENTAL INSPECTION AND TESTING DOCUMENTATION, EMERGENCY RESPONSE PLAN, EVALUATION DOCUMENTATION
RISK ANALYSIS DOCUMENTATION, SOFTWARE & FIRMWARE CONTROL DOCUMENTATION

SEQUENCE OF OPERATIONS

| ACTION | DEVICE | AREA SMOKE DETECTOR | AREA HEAT DETECTOR | A/C POWER FAILURE | LOW BATTERY |
|--|--------|---------------------|--------------------|-------------------|-------------|
| SOUND ALARM THROUGHOUT BLDG. | | YES | YES | NO | NO |
| REPORT TO CENTRAL STATION | | YES | YES | YES | YES |
| ANNUNCIATE AT PANEL AND ANNUNCIATOR | | YES | YES | YES | YES |
| CLOSE SMOKE FIRE DAMPERS HVAC SHUTDOWN | | YES | YES | YES | YES |
| tone FOLLOWED BY VOICE EVACUATION | | YES | YES | NO | NO |
| SOUND TROUBLE BUZZER | | ON WIRING FAULT | ON WIRING FAULT | YES | YES |

EQUIPMENT LISTING

| SYMBOL | MANUFACTURER & MODEL # | DESCRIPTION | CSFM # |
|---------------------|---|---|----------------------------------|
| [FACP] | SIMPLEX 4100-9114 | FIRE ALARM CONTROL PANEL W/ 2 SLC LOOP CARDS, W/ DIGITAL ALARM COMMUNICATOR TRANSMITTER | 7165-0026:0251 |
| [EVAC] | SIMPLEX 4003EC | FIRE ALARM VOICE EVAC AMPLIFIER PANEL | 6911-0026:0332 |
| [FAPS] | SIMPLEX 4009 | FIRE ALARM POWER SUPPLY | 7300-0026:0368 |
| [SD] | SIMPLEX 4098-9714 (BASE) 4098-9792 | FIRE ALARM PHOTOELECTRIC SMOKE DETECTOR SURFACE CEILING | 7272-0026:0218 7300-0026:0217 |
| [HD] | SIMPLEX 4098-9733 (BASE) 4098-9792 | FIRE ALARM HEAT DETECTOR DETECTOR SURFACE CEILING | 7272-0026:0216 7300-0026:0217 |
| [HD A] | SYSTEM SENSOR 5602 | FIRE ALARM HEAT DETECTOR 194 DEG. FIXED "A" INDICATES MOUNTED IN ATTIC | 7270-1653:0167 |
| [MM] | IAM 4090-9001 | FIRE ALARM MONITOR MODULE SURFACE CEILING | 7300-0026:0223 |
| [CR] | IAM 4090-9002 | FIRE ALARM CONTROL MODULE SURFACE CEILING | 7300-0026:0223 |
| [V] ₁₅ | EXCEDER LSTRC3 CANDELA AS NOTED | FIRE ALARM STROBE CEILING MOUNTED | 7125-0785:0169 |
| [25W] ₇₅ | EXCEDER LSPSTRC3 CANDELA & WATTS AS NOTED | FIRE ALARM SPEAKER/STROBE CEILING MOUNT | 7125-0785:0175 |
| [1W] _{WP} | WHEELLOCK ET1010 W/ WBB BACKBOX | FIRE ALARM WEATHERPROOF SPEAKER | 7320-0785:0105 |

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 03-119661 INC.
REVIEWED FOR
SS FLS ACS
DATE: 10/25/2019

RFHC
RF Hawkins Consulting
2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rfhawkinsconsulting.com

CONSULTANT
next step
DESIGN, INC.
26170 ENTERPRISE WAY, SUITE 400
LAKE FOREST, CA 92630
PHONE: (949) 215-3339
FAX: (949) 457-9375
REG # 09-338

REGISTERED PROFESSIONAL ENGINEER
SCOTT B. ANCOUR
No. E007792
EXPIRES 12/31/2020
REGISTERED PROFESSIONAL ENGINEER
ANDREW R. STOUT
No. E007792
EXPIRES 12/31/2020

HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221

| NO | DATE | BY | DESCRIPTION |
|-----------------|-----------|----------|-------------|
| REVISIONS | | | |
| DRAWN: | JC | CHECKED: | RFH |
| DATE: | 8/31/2018 | SCALE: | AS NOTED |
| PROJECT NUMBER: | | 17-301 | |

FIRE ALARM SUBMITTAL

DRAWING NUMBER : **E2.2**

| LEGEND | | |
|--------|--------|--|
| SYMBOL | ABBR. | DESCRIPTION |
| | - | SUPPLY AIR RISER |
| | - | RETURN AIR RISER |
| | - | EXHAUST AIR RISER |
| | SAG | SUPPLY AIR GRILLE |
| | RAG | RETURN AIR GRILLE |
| | EAG | EXHAUST AIR GRILLE |
| | SWR | SIDEWALL REGISTER |
| | (L) | LINED DUCTWORK |
| | - | FLEXIBLE CONNECTION |
| | FC | FLEXIBLE CONNECTION |
| | - | NEW DUCT (SEE PLAN) |
| | MVD | MANUAL VOLUME DAMPER |
| | BDD | BACKDRAFT DAMPER |
| | UC | UNDERCUT DOOR 3/4" |
| | SFD | SMOKE / FIRE DAMPER |
| | FD | FIRE DAMPER |
| | T-STAT | THERMOSTAT |
| | S | SWITCH |
| | W | WITH |
| | SM | SHEET METAL |
| | G.C. | GENERAL CONTRACTOR |
| | VTR | VENT THRU ROOF |
| | O/C | ON CENTER |
| | E | ITEMS FURNISHED AND INSTALLED BY THE ELECTRICAL CONTRACTOR AS SPECIFIED ON THE ELECTRICAL CONTRACT DOCUMENTS |
| | M | ITEMS FURNISHED AND INSTALLED BY THE MECHANICAL CONTRACTOR AS SPECIFIED ON THE MECHANICAL CONTRACT DOCUMENTS |
| | EM | ITEMS FURNISHED BY ELECTRICAL CONTRACTOR AND INSTALLED BY MECHANICAL CONTRACTOR |
| | ME | ITEMS FURNISHED BY MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR |

GENERAL NOTES

- ENTIRE INSTALLATION SHALL CONFORM TO THE REQUIREMENTS OF THE 2016 CALIFORNIA MECHANICAL CODE, 2016 CALIFORNIA BUILDING CODE, AND ALL OTHER APPLICABLE CODES AND REGULATIONS, INCLUDING 2016 CALIFORNIA ENERGY CONSERVATION STANDARDS DIVISION T-24.
- COORDINATE ENTIRE INSTALLATION OF THE HVAC SYSTEM WITH THE WORK OF ALL OTHER TRADES PRIOR TO ANY FABRICATION OR INSTALLATION. PROVIDE ALL FITTINGS, OFFSETS, AND TRANSITIONS AS REQUIRED FOR A COMPLETE WORKABLE INSTALLATION. THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE ITEMS TO BE PROVIDED BY OTHER TRADES WHERE MENTIONED IN THE CONTRACT DOCUMENTS PRIOR TO BID - NO EXCEPTIONS.
- COORDINATE THE LOCATIONS OF ALL CEILING DIFFUSERS, REGISTERS AND GRILLES WITH THE ARCHITECTURAL REFLECTIVE CEILING PLAN, ELECTRICAL LIGHTING LAYOUT AND ARCHITECTURAL ROOM ELEVATIONS. THE ARCHITECT AND ENGINEER SHALL BE IMMEDIATELY NOTIFIED OF ANY CONFLICTS PRIOR TO FABRICATION AND INSTALLATION.
- ALL EQUIPMENT, DUCTS, PIPING, AND OTHER DEVICES AND MATERIALS INSTALLED OUTSIDE OF THE BUILDING OR OTHERWISE EXPOSED TO THE WEATHER SHALL BE COMPLETELY WEATHER-PROOFED AND PAINTED TO MATCH, COORDINATE WITH ARCHITECT PRIOR TO PAINTING.
- ALL DIMENSIONS SHOWN ON THESE PLANS ARE APPROXIMATE AND MUST BE CONFIRMED ON SITE.
- PRIOR TO OCCUPANCY, THE ENTIRE H.V.A.C. SYSTEMS SHALL BE BALANCED IN ACCORDANCE WITH "AABC" OR "NEEB" STANDARDS BY AN INDEPENDENT THIRD PARTY AIR BALANCE CONTRACTOR MEMBER OF "AABC" OR "NEEB". CERTIFICATION SHALL BE PROVIDED BY THE CONTRACTOR FOR AIR AND HYDRONIC AS APPLICABLE. SYSTEMS SHALL BE BALANCED AS INDICATED ON PLANS INCLUDING FRESH AIR VENTILATION. WHERE THERE IS A CONFLICT WITH THE MECHANICAL PLANS, THE AIR BALANCE CONTRACTOR SHALL NOTIFY THE ENGINEER PRIOR TO BALANCING SYSTEM. IF NOT THE AIR BALANCE CONTRACTOR SHALL BEAR ALL COSTS INCURRED FOR WORK THAT MUST BE RE-BALANCED DUE TO CONFLICTS ON CONTRACT DOCUMENTS. CONTRACTOR SHALL PROVIDE THREE COPIES OF THE AIR BALANCE REPORT TO THE ENGINEER FOR APPROVAL.
- FOR INACCESSIBLE AREAS THE CONTRACTOR SHALL PROVIDE ACCESS PANELS TO ALL DAMPERS, EQUIPMENT, SMOKE DETECTORS, AND CONTROL DEVICES. THESE PANELS SHALL MATCH THE RATING OF THE WALL AND/OR CEILING THAT THEY ARE LOCATED IN. MINIMUM ACCESS PANEL SIZES SHALL BE AS FOLLOWS:
 - HAND ACCESS: 12"x12".
 - BODY ACCESS: 30"x30" MIN. WHERE A LARGER ACCESS SIZE IS REQUIRED DUE TO INSTALLATION CONSTRAINTS, THE CONTRACTOR SHALL DO SO AT NO ADDITIONAL COST AND SHALL NOTIFY THE ARCHITECT AND ENGINEER OF DEVIATIONS PRIOR TO INSTALLATION.
- COORDINATE THE LOCATION OF ALL ROOF OPENINGS AND THE LOCATION OF ALL ROOF MOUNTED EQUIPMENT WITH THE STRUCTURAL AND ARCHITECTURAL PLANS PRIOR TO ANY INSTALLATION.
- PLATFORMS, CURBS, AND FLASHINGS FOR MECHANICAL EQUIPMENT SHALL BE AS INDICATED ON THE STRUCTURAL AND ARCHITECTURAL PLANS, UNLESS NOTED OTHERWISE. WHERE THERE IS A CONFLICT WITH THE MECHANICAL PLANS, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT AND ENGINEER PRIOR TO FABRICATION AND INSTALLATION.
- ALL EQUIPMENT, ACCESSORIES, AND RELATED PIPING SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE EQUIPMENT MANUFACTURER'S RECOMMENDATIONS. PROVIDE ALL FITTINGS, TRANSITIONS, DAMPERS, VALVES, AND OTHER DEVICES REQUIRED FOR A COMPLETE WORKABLE INSTALLATION.
- MAINTENANCE LABEL SHALL BE AFFIXED TO ALL MECHANICAL EQUIPMENT AND A MAINTENANCE MANUAL SHALL BE PROVIDED FOR THE OWNER'S USE.
- PROVIDE MERV 13 MIN. EFFICIENCY THROWAWAY FILTERS FOR ALL AIR CONDITIONING UNITS. SEE EQUIPMENT SCHEDULE AND SPECIFICATIONS FOR TYPE. SIZES SHALL BE AS RECOMMENDED BY THE MANUFACTURER, UNLESS OTHERWISE SPECIFIED.
- AIR FILTERS SHALL BE STATE FIRE MARSHALL APPROVED AND LISTED. PREFORMED FILTERS HAVING COMBUSTIBLE FRAMING SHALL BE TESTED AS A COMPLETE ASSEMBLY. AIR FILTERS SHALL BE ACCESSIBLE FOR CLEANING OR REPLACEMENT.
- ALL EQUIPMENT WITH MOVING PARTS SHALL BE PROVIDED WITH FLEXIBLE DUCT AND PIPE CONNECTION.
- ALL HVAC EQUIPMENT SHALL BE CERTIFIED BY THE CALIFORNIA ENERGY COMMISSION TO COMPLY WITH LATEST EFFICIENCY STANDARDS.
- AC UNITS PROVIDED WITH ECONOMY CYCLE DAMPERS SHALL HAVE DAMPERS SET UP TO CLOSE AUTOMATICALLY ON FAN SHUTDOWN.
- PROVIDE MANUAL VOLUME DAMPERS AND BACKDRAFT DAMPERS FOR FRESH AIR INTAKES ON ALL AIR HANDLING EQUIPMENT AND EXHAUST FANS SERVING CONDITIONED SPACES. EXCEPTION: EQUIPMENT WITH FACTORY ECONOMIZERS.
- ALL FRESH AIR INTAKES SHALL MEET CODE REQUIRED CLEARANCES FROM EXHAUST, FLUE, FUEL BURNING APPLIANCE AND PLUMBING VENT OUTLETS. FOR GAS/ELECTRIC AIR CONDITIONING UNITS WHERE THE CODE REQUIRED CLEARANCES ARE NOT MET, A FACTORY FLUE GAS DEFLECTOR AND EXTENSION SHALL BE USED TO MINIMIZE THESE CLEARANCES. CONTRACTOR SHALL DETERMINE LOCATIONS WHERE REQUIRED PRIOR TO BID. THIS SHALL BE PROVIDED AT NO ADDITIONAL COST.
- ALL AIR HANDLING EQUIPMENT SERVING CONDITIONED SPACES SHALL PROVIDE CONTINUOUS FRESH AIR TO SPACES IN OCCUPIED MODE.
- CONTRACTOR SHALL VERIFY ALL CLEARANCES AND AVAILABLE SPACE FOR DUCTWORK PRIOR TO ORDERING AND / OR FABRICATING MATERIAL.
- CONTRACTOR TO SUBMIT ALL EQUIPMENT, DUCTWORK, AIR DISTRIBUTION DEVICES, AND OTHER ACCESSORIES TO THE ENGINEER FOR APPROVAL PRIOR TO ANY ANY ORDERING OF SUCH ITEMS.
- CONTRACTOR SHALL BE RESPONSIBLE FOR COMMISSIONING OF EQUIPMENT AS STIPULATED ON MECH-1-C FORM ON PLANS UNLESS NOTED OTHERWISE.
- PAINT EXPOSED SURFACE, WHETHER OR NOT COLORS ARE DESIGNATED IN SCHEDULES, EXCEPT WHERE A SURFACE OR MATERIAL IS SPECIFICALLY INDICATED NOT TO BE PAINTED OR IS TO REMAIN NATURAL WHERE AN ITEM OR SURFACE IS NOT SPECIFICALLY MENTIONED. PAINT THE SAME AS SIMILAR ADJACENT MATERIALS OR SURFACES. IF COLOR OR FINISH IS NOT DESIGNATED, THE OWNER'S REPRESENTATIVE WILL SELECT FROM STANDARD COLORS OR FINISHES AVAILABLE.

1. PAINTING INCLUDES FIELD PAINTING EXPOSED BARE AND COVERED PIPES AND DUCTS (INCLUDING COLOR CODING), HANGERS, EXPOSED STEEL AND IRON WORK, AND PRIMED METAL SURFACES OF MECHANICAL AND ELECTRICAL EQUIPMENT.
- NOT USED.
- ALL LINE AND LOW VOLTAGE WIRING SHALL BE INSTALLED IN CONDUIT. ALL LINE VOLTAGE CONDUIT AND WIRING, INCLUDING FINAL CONNECTIONS, SHALL BE FURNISHED AND INSTALLED BY THE ELECTRICAL CONTRACTOR AS INDICATED ON THE ELECTRICAL DRAWINGS OR SPECIFIED IN THE ELECTRICAL SECTION OF THE SPECIFICATIONS. ALL ELECTRICAL WORK SHALL BE INSTALLED IN ACCORDANCE WITH ALL APPLICABLE CODES AND REGULATIONS OF ALL GOVERNING BODIES HAVING JURISDICTION THEREOF.
- ALL LOW VOLTAGE CONDUIT AND WIRING AS APPLICABLE, INCLUDING FINAL CONNECTIONS, SHALL BE FURNISHED AND INSTALLED BY THE MECHANICAL CONTRACTOR AS INDICATED ON MECHANICAL DRAWINGS OR SPECIFIED IN THE MECHANICAL SECTION OF THE SPECIFICATIONS.
 - ALL LOW VOLTAGE WIRING SHALL BE INSTALLED IN CONDUIT.
 - WHERE THE CONTROLS CONTRACTOR IS RETAINED THEY SHALL BE RESPONSIBLE FOR THE FOLLOWING:
 - FURNISH AND INSTALL ALL DEVICES, WIRING, AND TERMINATIONS REQUIRED FOR A COMPLETE AND FUNCTIONAL INSTALLATION.
 - COORDINATE ALL WORK AND REQUIREMENTS WITH OTHER TRADES INCLUDING GENERAL, MECHANICAL, AND ELECTRICAL CONTRACTORS PRIOR TO BID.
 - CONTRACTOR SHALL FOLLOW ALL SUBMITTAL REQUIREMENTS PER DRAWINGS AND SPECIFICATIONS
 - ALL CONTROL WIRING SHALL BE INSTALLED IN MIN. 3/4" CONDUIT.
- ELECTRICAL CONTRACTOR SHALL PROVIDE REQUIRED RELAY ACCESSORIES FOR CONNECTION OF 120 VOLT, 1 PHASE VENTILATING EQUIPMENT TO 277 VOLT, 1 PHASE LIGHTING AS APPLICABLE.
- NOT USED.
- NOTES:
 - THERMOSTATS THAT ARE PART OF ANY ENERGY MANAGEMENT SYSTEM SHALL FOLLOW CONTROL SPECIFICATIONS AND DRAWING REQUIREMENTS.
 - SHOULD THE LOCATION OF THE THERMOSTAT NOT MEET THE ADA HEIGHT REQUIREMENTS DUE TO OBSTRUCTIONS, THEN AN ALTERNATE LOCATION SHALL BE PROPOSED OR REQUESTED BY CONTRACTOR THAT SHALL BE APPROVED BY THE ENGINEER AND ARCHITECT.
- LINE VOLTAGE THERMOSTATS SHALL BE FURNISHED BY THE MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR.
- CONTROLS CONTRACTOR AND AIR BALANCE CONTRACTOR SHALL COORDINATE WORK AND PERFORM NECESSARY TASKS AS REQUIRED TO OBTAIN AIR AND WATER FLOW QUANTITIES FOR SYSTEMS SHOWN HEREIN.
- CONTROLS SHALL BE PROVIDED TO PROVIDE THE MINIMUM RATE OF OUTDOOR AIR REQUIRED BY THE STATE ENERGY REGULATIONS.

AIR DISTRIBUTION

- ALL DUCTWORK SHALL BE SHEET METAL CONSTRUCTED OR SPIRAL, ERECTED, AND TESTED IN ACCORDANCE WITH THE MOST RESTRICTIVE OF LOCAL REGULATIONS, PROCEDURES DETAILED IN THE ASHRAE HANDBOOK OF FUNDAMENTALS, CHAPTER 6 OF UNIFORM MECHANICAL CODE, OR THE APPLICABLE STANDARDS ADOPTED BY THE SHEET METAL AND AIR CONDITIONING CONTRACTORS NATIONAL ASSOCIATION.
- ALL FLEXIBLE DUCTWORK SHALL NOT EXCEED FIVE FEET IN LENGTH TO RESPECTIVE DIFFUSERS, GRILLES, AND REGISTERS, OR OTHER AIR DEVICES.
- PROVIDE SEISMIC RESTRAINTS TO ALL DUCTWORK, PIPE, AND EQUIPMENT SUPPORTS IN ACCORDANCE WITH THE LATEST SMACNA GUIDELINES FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS. SUSPENDED EQUIPMENT SHALL BE PROVIDED WITH SEISMIC ANCHORAGE AND ISOLATION SUPPORTS.
- ALL DUCTS TURNS IN SUPPLY, RETURN, AND EXHAUST DUCTS SHALL HAVE TURNING VANES UNLESS OTHERWISE NOTED.
- ALL INSULATION SHALL HAVE A FLAME SPREAD OF NOT MORE THAN 25 AND A SMOKE DENSITY NOT EXCEEDING 50.
- MANUAL VOLUME DAMPERS SHALL BE PROVIDED IN ALL DUCT BRANCHES TO INDIVIDUAL DIFFUSERS, GRILLES AND REGISTERS, AS WELL AS FRESH AIR INTAKE DUCTS. DAMPERS SHALL BE LOCATED AT THE BRANCH DUCT LOCATIONS. THE MECHANICAL CONTRACTOR SHALL COORDINATE LOCATIONS OF DAMPERS WITH THE AIR BALANCE CONTRACTOR PRIOR TO BID, SO THEY ARE ACCESSIBLE PRIOR TO INSTALLATION. IN LOCATIONS WHERE THESE DAMPERS ARE INACCESSIBLE, CABLE OPERATED ADJUSTMENT CONTROLS SHALL BE PROVIDED AT NO ADDITIONAL COST. OPPOSED BLADE DAMPERS SHALL NOT BE PERMITTED UNLESS NOTED OTHERWISE.
- DUCTWORK HANDLING CONDITIONED AIR SHALL BE INSULATED OR LINED AS INDICATED ON DRAWINGS. SUPPLY AND RETURN DUCT INSULATION SHALL BE MIN 3" THICK, 3/4 LB./CUBIC FT. DENSITY AND HAVE A MIN VALUE OF R-8 WHERE LOCATED IN ONE OR MORE OF THE FOLLOWING SPACES:
 - OUTDOORS, OR
 - IN A SPACE BETWEEN THE ROOF AND AN INSULATED CEILING, OR
 - IN A SPACE DIRECTLY UNDER A ROOF WITH FIXED VENTS OR OPENINGS TO THE OUTSIDE OR UNCONDITIONED SPACES, OR
 - IN AN UNCONDITIONED CRAWLSPACE, OR
 - IN OTHER UNCONDITIONED SPACES

PER 2016 C.E.C., OTHERWISE PROVIDE R-8.0 WHEN LOCATED IN CONDITIONED ATTIC SPACES ABOVE CEILING. ALL DUCTWORK EXPOSED ON ROOF SHALL BE INTERNALLY LINED WITH 1/2" THICK, 1.5 LB./CUBIC FT. DENSITY DUCT LINER UNLESS OTHERWISE INDICATED OR SPECIFIED. ALL DUCT SIZES ARE SHEET METAL SIZES. ALL DUCT JOINTS SHALL BE SEALED PER C.M.C. CHAPTER 6 REQUIREMENTS. PROVIDE PIPING AND DUCT INSULATION IN ACCORDANCE WITH THE LATEST STANDARDS OF THE CALIFORNIA ENERGY COMMISSION.
- AUTOMATIC FIRE DAMPER REQUIREMENTS ARE AS FOLLOWS:
 - PROVIDE AUTOMATIC FIRE DAMPERS AT ALL PENETRATIONS OF FIRE-RATED CEILINGS AND WALLS THROUGHOUT. CONTRACTOR SHALL COORDINATE FIRE-RATED AREAS WITH THE ARCHITECTURAL DRAWINGS AND OTHER TRADES PRIOR TO INSTALL AND SHALL NOTIFY PERTINENT PARTIES PRIOR TO ANY WORK PERFORMED IN THESE AREAS. IN ADDITION, CONTRACTOR SHALL BE RESPONSIBLE TO PROVIDE PROPER ACCESS FOR DAMPERS INSTALLED. THE DAMPER FIRE RATING SHALL BE COMPATIBLE WITH THE CEILING/WALL RATING.
 - LOCATION OF FIRE-RATED CEILINGS AND WALLS ARE AS INDICATED ON THE ARCHITECTURAL DRAWINGS.
 - FIRE AND / OR SMOKE DAMPER(S) SHALL BE PROVIDED AS REQUIRED BY THE LATEST CALIFORNIA BUILDING CODE.
 - CONTRACTOR SHALL FURNISH FLUSH MOUNTED FIRE AND / OR SMOKE DAMPERS, SO THAT THAT DAMPER DO NOT EXTEND PASS WALLS, FOR AREAS WITHOUT CEILINGS FOR QUALITY WORKMANSHIP.
- NOT USED.
- ALL DUCT WORK PASSING THROUGH FIRE RATED CORRIDORS AND LOBBIES SHALL BE MIN. 26 GAGE SHEET METAL CONSTRUCTION.
- ALL DUCTWORK, PIPING, CONDUIT, & ETC. PENETRATING FIRE RATED CONSTRUCTION SHALL HAVE APPROVED FIRE STOPPING.
- CONTRACTOR SHALL STUDY COMPLETELY AND THOROUGHLY THE DESIGN OF THE ENTIRE AIR CONDITIONING SYSTEM, AND VERIFY THE CONSTRUCTABILITY WITH OTHER TRADES PRIOR TO BID. NOTIFY THE ARCHITECT AND ENGINEER IMMEDIATELY IF THERE IS A CONFLICT. ALL CONSTRUCTABILITY ISSUES ARISE AFTER BID SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. NO EXCEPTION.
- UNLESS SPECIFICALLY SHOWN ON THESE PLANS NO STRUCTURAL MEMBERS SHALL BE CUT, DRILLED NOR NOTCHED WITHOUT PRIOR WRITTEN AUTHORIZATION FROM THE STRUCTURAL ENGINEER AND THE DISTRICT STRUCTURAL ENGINEER FROM THE DIVISION OF THE STATE ARCHITECT.

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019



2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rhhawkinsconsulting.com

CONSULTANT

pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675



HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

| NO | DATE | BY | DESCRIPTION |
|----|------|----|-------------|

| REVISIONS | |
|-----------------|-----------------|
| DRAWN: IZ | CHECKED: IP |
| DATE: 8/31/2018 | SCALE: AS NOTED |
| PROJECT NUMBER: | 17-302 |

MECHANICAL GENERAL
 NOTES, LEGEND

DRAWING NUMBER : **M0.1**

PACKAGED HEAT PUMP UNIT SCHEDULE (ROOF TOP) - CAFETERIA BUILDING



| SYMBOL | MANUFACTURER & MODEL | LOCATION | AREA SERVED | NOMINAL TONAGE | CFM | EXT. S.P. | SUPPLY FAN BHP | OSA CFM | COOLING | | | HEATING | | ELECTRICAL | | | | | | | | WEIGHT | | NOTES | ANCHORAGE DETAIL |
|---------|----------------------------------|---------------|-------------|----------------|-------|-----------|----------------|---------|-------------|----------------|------|----------------|------|------------|----|----|-----|------|------|-----|------|--------|-----|---------------------|------------------|
| | | | | | | | | | TOTAL (mbh) | SENSIBLE (mbh) | SEER | CAPACITY (mbh) | HSPF | V | PH | HZ | MCA | MCCP | FLA | LRA | CURB | TOTAL | | | |
| (HP-K1) | TRANE 4WCC3048A3000B (NEW) | ROOF BUILDING | KITCHEN | 4 | 1,600 | 0.8 | 0.93 | 450 | 46.0 | 44.5 | 13.0 | 43.5 | 7.70 | 208 | 1 | 60 | 28 | 40 | 19.1 | 116 | 450 | 110 | 560 | 1, 2, 3, 4, 5, 6, 7 | |
| (HP-K2) | TRANE 4WCC3048A3000B (NEW) | ROOF BUILDING | KITCHEN | 4 | 1,600 | 0.8 | 0.93 | 450 | 46.0 | 44.5 | 13.0 | 43.5 | 7.70 | 208 | 1 | 60 | 28 | 40 | 19.1 | 116 | 450 | 110 | 560 | 1, 2, 3, 4, 5, 6, 7 | |
| (HP-K3) | TRANE 4WCC3048A3000B (NEW) | ROOF BUILDING | KITCHEN | 4 | 1,600 | 0.8 | 0.93 | 450 | 46.0 | 44.5 | 13.0 | 43.5 | 7.70 | 208 | 1 | 60 | 28 | 40 | 19.1 | 116 | 450 | 110 | 560 | 1, 2, 3, 4, 5, 6, 7 | |

NOTES:

- VERTICAL DISCHARGE ROOFTOP HEAT PUMP WITH OUTSIDE AIR AND BAROMETRIC RELIEF HOOD, TIME GUARD II CONTROL CIRCUIT, LOW AMBIENT KIT AND CRANKCASE HEATER
- PROVIDE WITH R410A REFRIGERANT.
- PROVIDE GLASS FIBER DISPOSABLE MEDIA IN METAL FRAMES, SIZED PER MANUFACTURER WITH MINIMUM ARRESTANCE ACCORDING TO ASHRAE 52.1, AND A MINIMUM EFFICIENCY REPORTING VALUE (MERV) ACCORDING TO ASHRAE 52.2
- PROVIDE FIELD INSTALLED DISCONNECT SWITCH. SEE ELECTRICAL DRAWINGS.
- PROVIDE FAN STATUS AND PRESSURE DIFFERENTIAL SENSOR FILTER STATUS.
- AREAS WITH UNIT SUPPLYING MORE THAN 2,000 CFM SHALL BE EQUIPPED WITH TOTAL COVERAGE DETECTION SYSTEM, ABLE TO SHUT DOWN UNIT(S) WITHIN COVERAGE AREA AND SEND SIGNAL TO BUILDING FIRE ALARM PANEL PER 2016 CMC, SECTION 608. SEE FIRE ALARM DRAWINGS FOR COMPLETE WIRING AND UNIT SHUT DOWN SEQUENCE.
- PROVIDED WITH REFRIGERATION SERVICE PORTS, FITTED WITH LOCKING TYPE TAMPER RESISTANT CAP OR SHALL BE PROTECTED FROM UNAUTHORIZED ACCESS IN ACCORDANCE WITH 2016 CMC, SECTION 1105.11

AIR DISTRIBUTION DEVICE SCHEDULE

| SYMBOL | MFR & MODEL | NECK SIZE | CFM RANGE | NECK VELOCITY | MAX N.C. | S.P. DROP | TYPE | DAMPER | REMARKS |
|---------|---------------|-----------|-----------|---------------|----------|-----------|---|--------|--------------------------------|
| SA-1 | KRUEGER 5180 | 8"x8" | 0-170 | 400 | 30 | 0.03 | CURVED BLADE, ADJUSTABLE MULTI-DEFLECTIONAL ALUMINUM DIFFUSER | OBD | FRAME 22 FOR GYPBOARD CEILING. |
| | | 10"x10" | 171-270 | | | | | | |
| | | 12"x12" | 271-400 | | | | | | |
| | | 14"x14" | 401-550 | | | | | | |
| | | 16"x16" | 551-700 | | | | | | |
| 18"x18" | 701-1000 | | | | | | | | |
| RA-1 | KRUEGER EGC10 | 8"x8" | 0-170 | 400 | 30 | 0.04 | 1"x1"x1" GRID ALUMINUM CUBE CORE | OBD | FRAME 22 FOR GYPBOARD CEILING. |
| | | 10"x10" | 171-270 | | | | | | |
| | | 12"x12" | 271-400 | | | | | | |
| | | 14"x14" | 401-550 | | | | | | |
| | | 16"x16" | 551-700 | | | | | | |
| | | 18"x18" | 701-1000 | | | | | | |
| | | 20"x20" | 1001-1250 | | | | | | |
| 22"x22" | 1251-1500 | | | | | | | | |

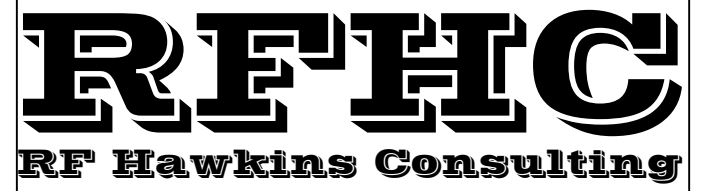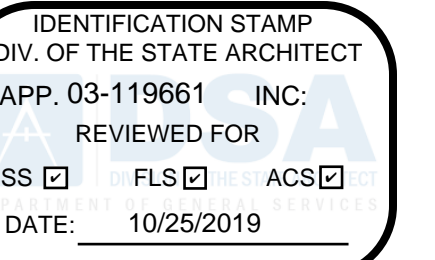

2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rfhawkinsconsulting.com

CONSULTANT

pais
consulting group
18 Pine Hill Lane
Ladera Ranch, CA 92694
phone: 949.610.9675



**HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221**

| | | | |
|----|------|----|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| △ | | | |
| NO | DATE | BY | DESCRIPTION |

REVISIONS

| | |
|------------------------|-----------------|
| DRAWN: IZ | CHECKED: IP |
| DATE: 8/31/2018 | SCALE: AS NOTED |
| PROJECT NUMBER: 17-302 | |

**MECHANICAL
SCHEDULES**

DRAWING NUMBER : **M0.2**

STATE OF CALIFORNIA
MECHANICAL SYSTEMS
 CEC-NRCC-MCH-01-E (Revised 01/16)

CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE
 NRCC-MCH-01-E
 Mechanical Systems
 (Page 3 of 4)

Project Name: **HVAC ADDITIONS TO CAFETERIA BUILDING 'Q'** Date Prepared: **01.16.2019**

C. MECHANICAL HVAC ACCEPTANCE FORMS (check box for required compliance documents)

Test Performed By:
 Designer:
 This compliance document is to be used by the designer and attached to the plans. Listed below are all the acceptance tests for HVAC systems. The designer is required to check the applicable boxes for all acceptance tests that apply and list all equipment that requires an acceptance test. All equipment of the same type that requires a test, list the equipment description and the number of systems.

Installing Contractor:
 The contractor who installed the equipment is responsible to either conduct the acceptance test themselves or have a qualified entity run the test for them. If more than one person has responsibility for the acceptance testing, each person shall sign and submit the Certificate of Acceptance applicable to the portion of the construction or installation for which they are responsible.

Enforcement Agency:
 Plancheck - The NRCC-MCH-01-E compliance document is not considered a completed document and is not to be accepted by the building department unless the correct boxes are checked.
 Inspector - Before occupancy permit is granted all newly installed process systems must be tested to ensure proper operations.

| Test Description | MCH-12-A | MCH-13-A | MCH-14-A | MCH-15-A | MCH-16-A | MCH-17-A | MCH-18-A |
|---|------------|--|--|--|--------------------------------------|---------------------------------------|--------------------------------|
| Equipment Requiring Testing or Verification | # of Units | Fault Detection & Diagnostics for DX Units | Automatic Fault Detection & Diagnostics for Air & Zone | Distributed Energy Storage DX AC Systems | Thermal Energy Storage (TES) Systems | Supply Air Temperature Reset Controls | Condenser Water Reset Controls |
| HP-K1 | 1 | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| HP-K2 | 1 | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| HP-K3 | 1 | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
MECHANICAL SYSTEMS
 CEC-NRCC-MCH-01-E (Revised 01/16)

CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE
 NRCC-MCH-01-E
 Mechanical Systems
 (Page 1 of 4)

Project Name: **HVAC ADDITIONS TO CAFETERIA BUILDING 'Q'** Date Prepared: **01.16.2019**

A. MECHANICAL COMPLIANCE DOCUMENTS & WORKSHEETS (check box if worksheet is included)

For detailed instructions on the use of this and all Energy Efficiency Standards compliance forms, refer to the 2016 Nonresidential Manual
 Note: The Enforcement Agency may require all forms to be incorporated into the building plans.

| YES | NO | Comp. Doc./Worksheet # | Title |
|-------------------------------------|-------------------------------------|-----------------------------|--|
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | NRCC-MCH-01-E (Part 1 of 3) | Certificate of Compliance, Declaration. Required on plans for all submittals. |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | NRCC-MCH-01-E (Part 2 of 3) | Certificate of Compliance, Required Acceptance Tests (MCH-02-A to 11-A). Required on plans for all submittals. |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | NRCC-MCH-01-E (Part 3 of 3) | Certificate of Compliance, Required Acceptance Tests (MCH-12-A to 18-A). Required on plans where applicable. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | NRCC-MCH-02-E (Part 1 of 2) | Mechanical Dry Equipment Summary is required for all submittals with Central Air Systems. It is optional on plans. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | NRCC-MCH-02-E (Part 2 of 2) | Mechanical Wet Equipment Summary is required for all submittals with chilled water, hot water or condenser water systems. It is optional on plans. |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | NRCC-MCH-03-E | Mechanical Ventilation and Reheat is required for all submittals with multiple zone heating and cooling systems. It is optional on plans. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | NRCC-MCH-07-E (Part 1 of 2) | Power Consumption of Fans. Required on plans where applicable |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | NRCC-MCH-07-E (Part 2 of 2) | Power Consumption of Fans, Declaration. Required on plans where applicable |

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
MECHANICAL SYSTEMS
 CEC-NRCC-MCH-01-E (Revised 01/16)

CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE
 NRCC-MCH-01-E
 Mechanical Systems
 (Page 4 of 4)

Project Name: **HVAC ADDITIONS TO CAFETERIA BUILDING 'Q'** Date Prepared: **01.16.2019**

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
 1. I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: **ILIE PAIS** Documentation Author Signature: *Ilie Pais*

Company: **RFHC** Signature Date: **01.16.2019**

Address: **2357 NAPLES AVENUE** CEAT/HERS Certification Identification (if applicable):

City/State/Zip: **MENTONE, CA 92359-9635** Phone: **(949) 610-9675**

RESPONSIBLE PERSON'S DECLARATION STATEMENT
 I certify the following under penalty of perjury, under the laws of the State of California:
 1. The information provided on this Certificate of Compliance is true and correct.
 2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
 3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
 4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
 5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: **ILIE PAIS** Responsible Designer Signature: *Ilie Pais*

Company: **RFHC** Date Signed: **01.16.2019**

Address: **2357 NAPLES AVENUE** License: **M-36549**

City/State/Zip: **MENTONE, CA 92359-9635** Phone: **(949) 610-9675**

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
MECHANICAL SYSTEMS
 CEC-NRCC-MCH-01-E (Revised 01/16)

CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE
 NRCC-MCH-01-E
 Mechanical Systems
 (Page 2 of 4)

Project Name: **HVAC ADDITIONS TO CAFETERIA BUILDING 'Q'** Date Prepared: **01.16.2019**

B. MECHANICAL HVAC ACCEPTANCE FORMS (check box for required compliance documents)

Test Performed By:
 Designer:
 This compliance document is to be used by the designer and attached to the plans. Listed below are all the acceptance tests for HVAC systems. The designer is required to check the applicable boxes for all acceptance tests that apply and list all equipment that requires an acceptance test. All equipment of the same type that requires a test, list the equipment description and the number of systems.

Installing Contractor:
 The contractor who installed the equipment is responsible to either conduct the acceptance test themselves or have a qualified entity run the test for them. If more than one person has responsibility for the acceptance testing, each person shall sign and submit the Certificate of Acceptance applicable to the portion of the construction or installation for which they are responsible.

Enforcement Agency:
 Plancheck - The NRCC-MCH-01-E compliance document is not considered a completed document and is not to be accepted by the building department unless the correct boxes are checked.
 Inspector - Before occupancy permit is granted all newly installed process systems must be tested to ensure proper operations.

| Test Description | MCH-02-A | MCH-03-A | MCH-04-A | MCH-05-A | MCH-06-A | MCH-07-A | MCH-08-A | MCH-09-A | MCH-10-A | MCH-11-A |
|---|------------|-------------------------------------|-------------------------------------|-------------------------------------|--------------------------|----------------------------------|--------------------------|--------------------------|--------------------------|---------------------------------------|
| Equipment Requiring Testing or Verification | # of Units | Outdoor Air | Single Zone Unitary | Air Distribution Ducts | Economizer Controls | Demand Control Ventilation (DCV) | Supply Fan VAV | Valve Leakage Test | Supply Water Temp. Reset | Hydronic System Variable Flow Control |
| HP-K1 | 1 | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| HP-K2 | 1 | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| HP-K3 | 1 | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
RF Hawkins Consulting
 2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT
 pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675



**HVAC ADDITIONS TO
 CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221**

| | | | |
|-----------------|-----------|----------|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| △ | | | |
| NO | DATE | BY | DESCRIPTION |
| REVISIONS | | | |
| DRAWN: | IZ | CHECKED: | IP |
| DATE: | 8/31/2018 | SCALE: | AS NOTED |
| PROJECT NUMBER: | 17-302 | | |

**BUILDING 'Q'
 TITLE-24
 COMPLIANCE**

DRAWING NUMBER : **M0.3**

STATE OF CALIFORNIA
HVAC SYSTEM REQUIREMENTS
 CEC-NRCC-MCH-02-E (Revised 08/14) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE
 HVAC Wet System Requirements
 Project Name: HVAC ADDITIONS TO CAFETERIA BUILDING 'Q' Date Prepared: 01.16.2019 (Page 3 of 3)

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
 1. I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: ILIE PAIS
 Signature Date: 01.16.2019
 Company: RFHC
 Address: 2357 NAPLES AVENUE
 City/State/Zip: MENTONE, CA 92359-9635
 Phone: (949) 610-9675

RESPONSIBLE PERSON'S DECLARATION STATEMENT
 I certify the following under penalty of perjury, under the laws of the State of California:
 1. The information provided on this Certificate of Compliance is true and correct.
 2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
 3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
 4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
 5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: ILIE PAIS
 Signature Date: 01.16.2019
 Company: RFHC
 Address: 2357 NAPLES AVENUE
 City/State/Zip: MENTONE, CA 92359-9635
 License: M-36549
 Phone: (949) 610-9675

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
HVAC DRY & WET SYSTEM REQUIREMENTS
 CEC-NRCC-MCH-02-E (Revised 01/18) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE
 HVAC Dry & Wet System Requirements
 Project Name: HVAC ADDITIONS TO CAFETERIA BUILDING 'Q' Date Prepared: 01.16.2019 (Page 1 of 3)

A. Equipment Tags and System Description¹ - Dry Systems

| | T-24 Sections | HP-K1 | HP-K2 | HP-K3 |
|--|--------------------------|-----------|-----------|-----------|
| MANDATORY MEASURES | | | | |
| Reference to the Requirements in the Contract Documents ² | | | | |
| Heating Equipment Efficiency ³ | 110.1 or 110.2(a) | M0.2 | M0.2 | M0.2 |
| Cooling Equipment Efficiency ³ | 110.1 or 110.2(a) | M0.2 | M0.2 | M0.2 |
| HVAC or Heat Pump Thermostats | 110.2(b), 110.2(c) | Heat Pump | Heat Pump | Heat Pump |
| Furnace Standby Loss Control | 110.2(d) | N/A | N/A | N/A |
| Low Leakage AHUs | 110.2(f) | N/A | N/A | N/A |
| Ventilation ⁴ | 120.1(b) | M0.2 | M0.2 | M0.2 |
| Demand Control Ventilation ⁵ | 120.1(c)(4) | N/A | N/A | N/A |
| Occupant Sensor Ventilation Control ⁶ | 120.1(c)(5), 120.2(e)(3) | N/A | N/A | N/A |
| Shutoff and Reset Controls ⁷ | 120.2(e) | N/A | N/A | N/A |
| Outdoor Air and Exhaust Damper Control | 120.2(f) | M1.1 | M1.1 | M1.1 |
| Isolation Zones | 120.2(g) | N/A | N/A | N/A |
| Automatic Demand Shed Controls | 120.2(h) | N/A | N/A | N/A |
| Economizer FDD | 120.2(i) | N/A | N/A | N/A |
| Duct Insulation | 120.4 | M0.1 | M0.1 | M0.1 |
| PRESCRIPTIVE MEASURES | | | | |
| Equipment is sized in conformance with 140.4(a & b) | 140.4(a & b) | Y/N | Y/N | Y/N |
| Supply Fan Pressure Control | 140.4(c) | N | N | N |
| Simultaneous Heat/Cool ⁸ | 140.4(d) | N | N | N |
| Economizer | 140.4(e) | N | N | N |
| Heat and Cool Air Supply Reset | 140.4(f) | N | N | N |
| Electric Resistance Heating ⁹ | 140.4(g) | N | N | N |
| Duct Leakage Sealing and Testing ¹⁰ | 140.4(i) | N | N | N |

Notes:
 1. Provide equipment tags (e.g. AHU 1 to 10) and system description (e.g. Single Duct VAV reheat) as appropriate. Multiple units with common requirements can be grouped together.
 2. Provide references to plans (i.e. Drawing Sheet Numbers) and/or specifications (including Section name/number and relevant paragraphs) where each requirement is specified. Enter "N/A" if the requirement is not applicable to this system.
 3. The referenced plans and specifications must include all of the following information: equipment tag, equipment nominal capacity, Title 24 minimum efficiency requirements, and actual rated equipment efficiencies. Where multiple efficiency requirements are applicable (e.g. full- and part-load) include all. Where appliance standards apply (110.1), identify where equipment is required to be listed per Title 20 1601 et seq.
 4. Identify where the ventilation requirements are documented for each central HVAC system. Include references to both central unit schedules and sequences of operation. If one or more spaces is naturally ventilated identify where this is documented in the plans and specifications. Multiple zone central air systems must also provide a MCH-03-E compliance document.
 5. If one or more spaces has demand controlled ventilation identify where it is specified including the sensor specifications and the sequence of operation.
 6. If one or more space has occupant sensor ventilation control identify where it is specified including the sensor specifications and the sequence of operation.
 7. If the system is DDC identify the sequences for the system start/stop, optimal start, setback (if required) and setup (if required). For all systems identify the specification for the thermostats and time clocks (if applicable).
 8. Identify where the heating, cooling and deadband airflows are scheduled for this system. Include a reference to the specification of the zone controls. Provide a MCH-03-E compliance document.
 9. Enter N/A if there is no electric heating. If the system has electric heating indicate which exception to 140.4(g) applies.
 10. If duct leakage sealing and testing is required, a MCH-04-A compliance document must be submitted.

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance January 2016

STATE OF CALIFORNIA
MECHANICAL VENTILATION AND REHEAT
 CEC-NRCC-MCH-03-E (Revised 05/16) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE
 Mechanical Ventilation & Reheat
 Project Name: HVAC ADDITIONS TO CAFETERIA BUILDING 'Q' Date Prepared: 01.16.2019 (Page 2 of 2)

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
 1. I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: ILIE PAIS
 Signature Date: 01.16.2019
 Company: RFHC
 Address: 2357 NAPLES AVENUE
 City/State/Zip: MENTONE, CA 92359-9635
 Phone: (949) 610-9675

RESPONSIBLE PERSON'S DECLARATION STATEMENT
 I certify the following under penalty of perjury, under the laws of the State of California:
 1. The information provided on this Certificate of Compliance is true and correct.
 2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
 3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
 4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
 5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: ILIE PAIS
 Signature Date: 01.16.2019
 Company: RFHC
 Address: 2357 NAPLES AVENUE
 City/State/Zip: MENTONE, CA 92359-9635
 License: M-36549
 Phone: (949) 610-9675

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance May 2016


STATE OF CALIFORNIA
MECHANICAL VENTILATION AND REHEAT
 CEC-NRCC-MCH-03-E (Revised 05/16) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE
 Mechanical Ventilation & Reheat
 Project Name: HVAC ADDITIONS TO CAFETERIA BUILDING 'Q' Date Prepared: 01.16.2019 (Page 1 of 2)

A. Mechanical Ventilation and Reheat

| ZONE / SYSTEM / VAV BOX TAG | ACTUAL DESIGN INFO (FROM EQUIPMENT SCHEDULES, ETC) | | | | | | | | | | OCCUPANCY BASIS | | | | MINIMUM | | | | VAV Reheat Primary Air CFM | | VAV Deadband Primary Air CFM | |
|-----------------------------|--|-------------------|-------------------|-------------------|-------------------|--------------------|---------------------|-----------------------|-------------------|-------------------|-----------------|----------------|------------------|------------------|----------------------|----------|-------------------------|----------------------|----------------------------|----------------------|------------------------------|----------------------|
| | ZONE / SYSTEM / VAV BOX TAG | DESIGN FLOW (CFM) | DESIGN FLOW (CFM) | DESIGN FLOW (CFM) | DESIGN FLOW (CFM) | ENTR. TYPE (DC/FC) | TRANSFER AREA (CFM) | CONDITIONED AREA (SF) | MIN. CMR PER AREA | MAX. CMR PER AREA | NO. OF PEOPLE | CMR PER PERSON | MIN. CMR BY ROOM | MAX. CMR BY ROOM | REQ. VENT AREA (CFM) | COMPRESS | PERCENTAGE REHEAT (CFM) | MAXIMUM REHEAT (CFM) | COMPRESS | MAXIMUM REHEAT (CFM) | COMPRESS | MAXIMUM REHEAT (CFM) |
| HP-K1 | 1,600 | N/A | 1,600 | N | N/A | 950 | 0.15 | 143 | 6 | 15 | 90 | 143 | 143 | Pass | N/A | N/A | Pass | Pass | N/A | N/A | Pass | Pass |
| HP-K1 | 1,600 | N/A | 1,600 | N | N/A | 950 | 0.15 | 143 | 10 | 15 | 150 | 143 | 150 | Pass | N/A | N/A | Pass | Pass | N/A | N/A | Pass | Pass |
| HP-K1 | 1,600 | N/A | 1,600 | N | N/A | 950 | 0.15 | 143 | 20 | 15 | 300 | 143 | 300 | Pass | N/A | N/A | Pass | Pass | N/A | N/A | Pass | Pass |

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance May 2016

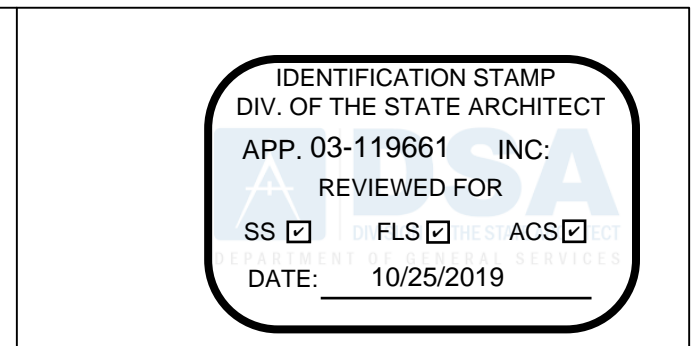

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rhwkinsconsulting.com

CONSULTANT
 pais consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675



HVAC ADDITIONS TO
 CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

| NO | DATE | BY | DESCRIPTION |
|----|------|----|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

REVISIONS
 DRAWN: IZ CHECKED: IP
 DATE: 8/31/2018 SCALE: AS NOTED
 PROJECT NUMBER: 17-302

**BUILDING 'Q'
 TITLE-24
 COMPLIANCE**

DRAWING NUMBER : **M0.4**


IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
 RF Hawkins Consulting


2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT

pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675

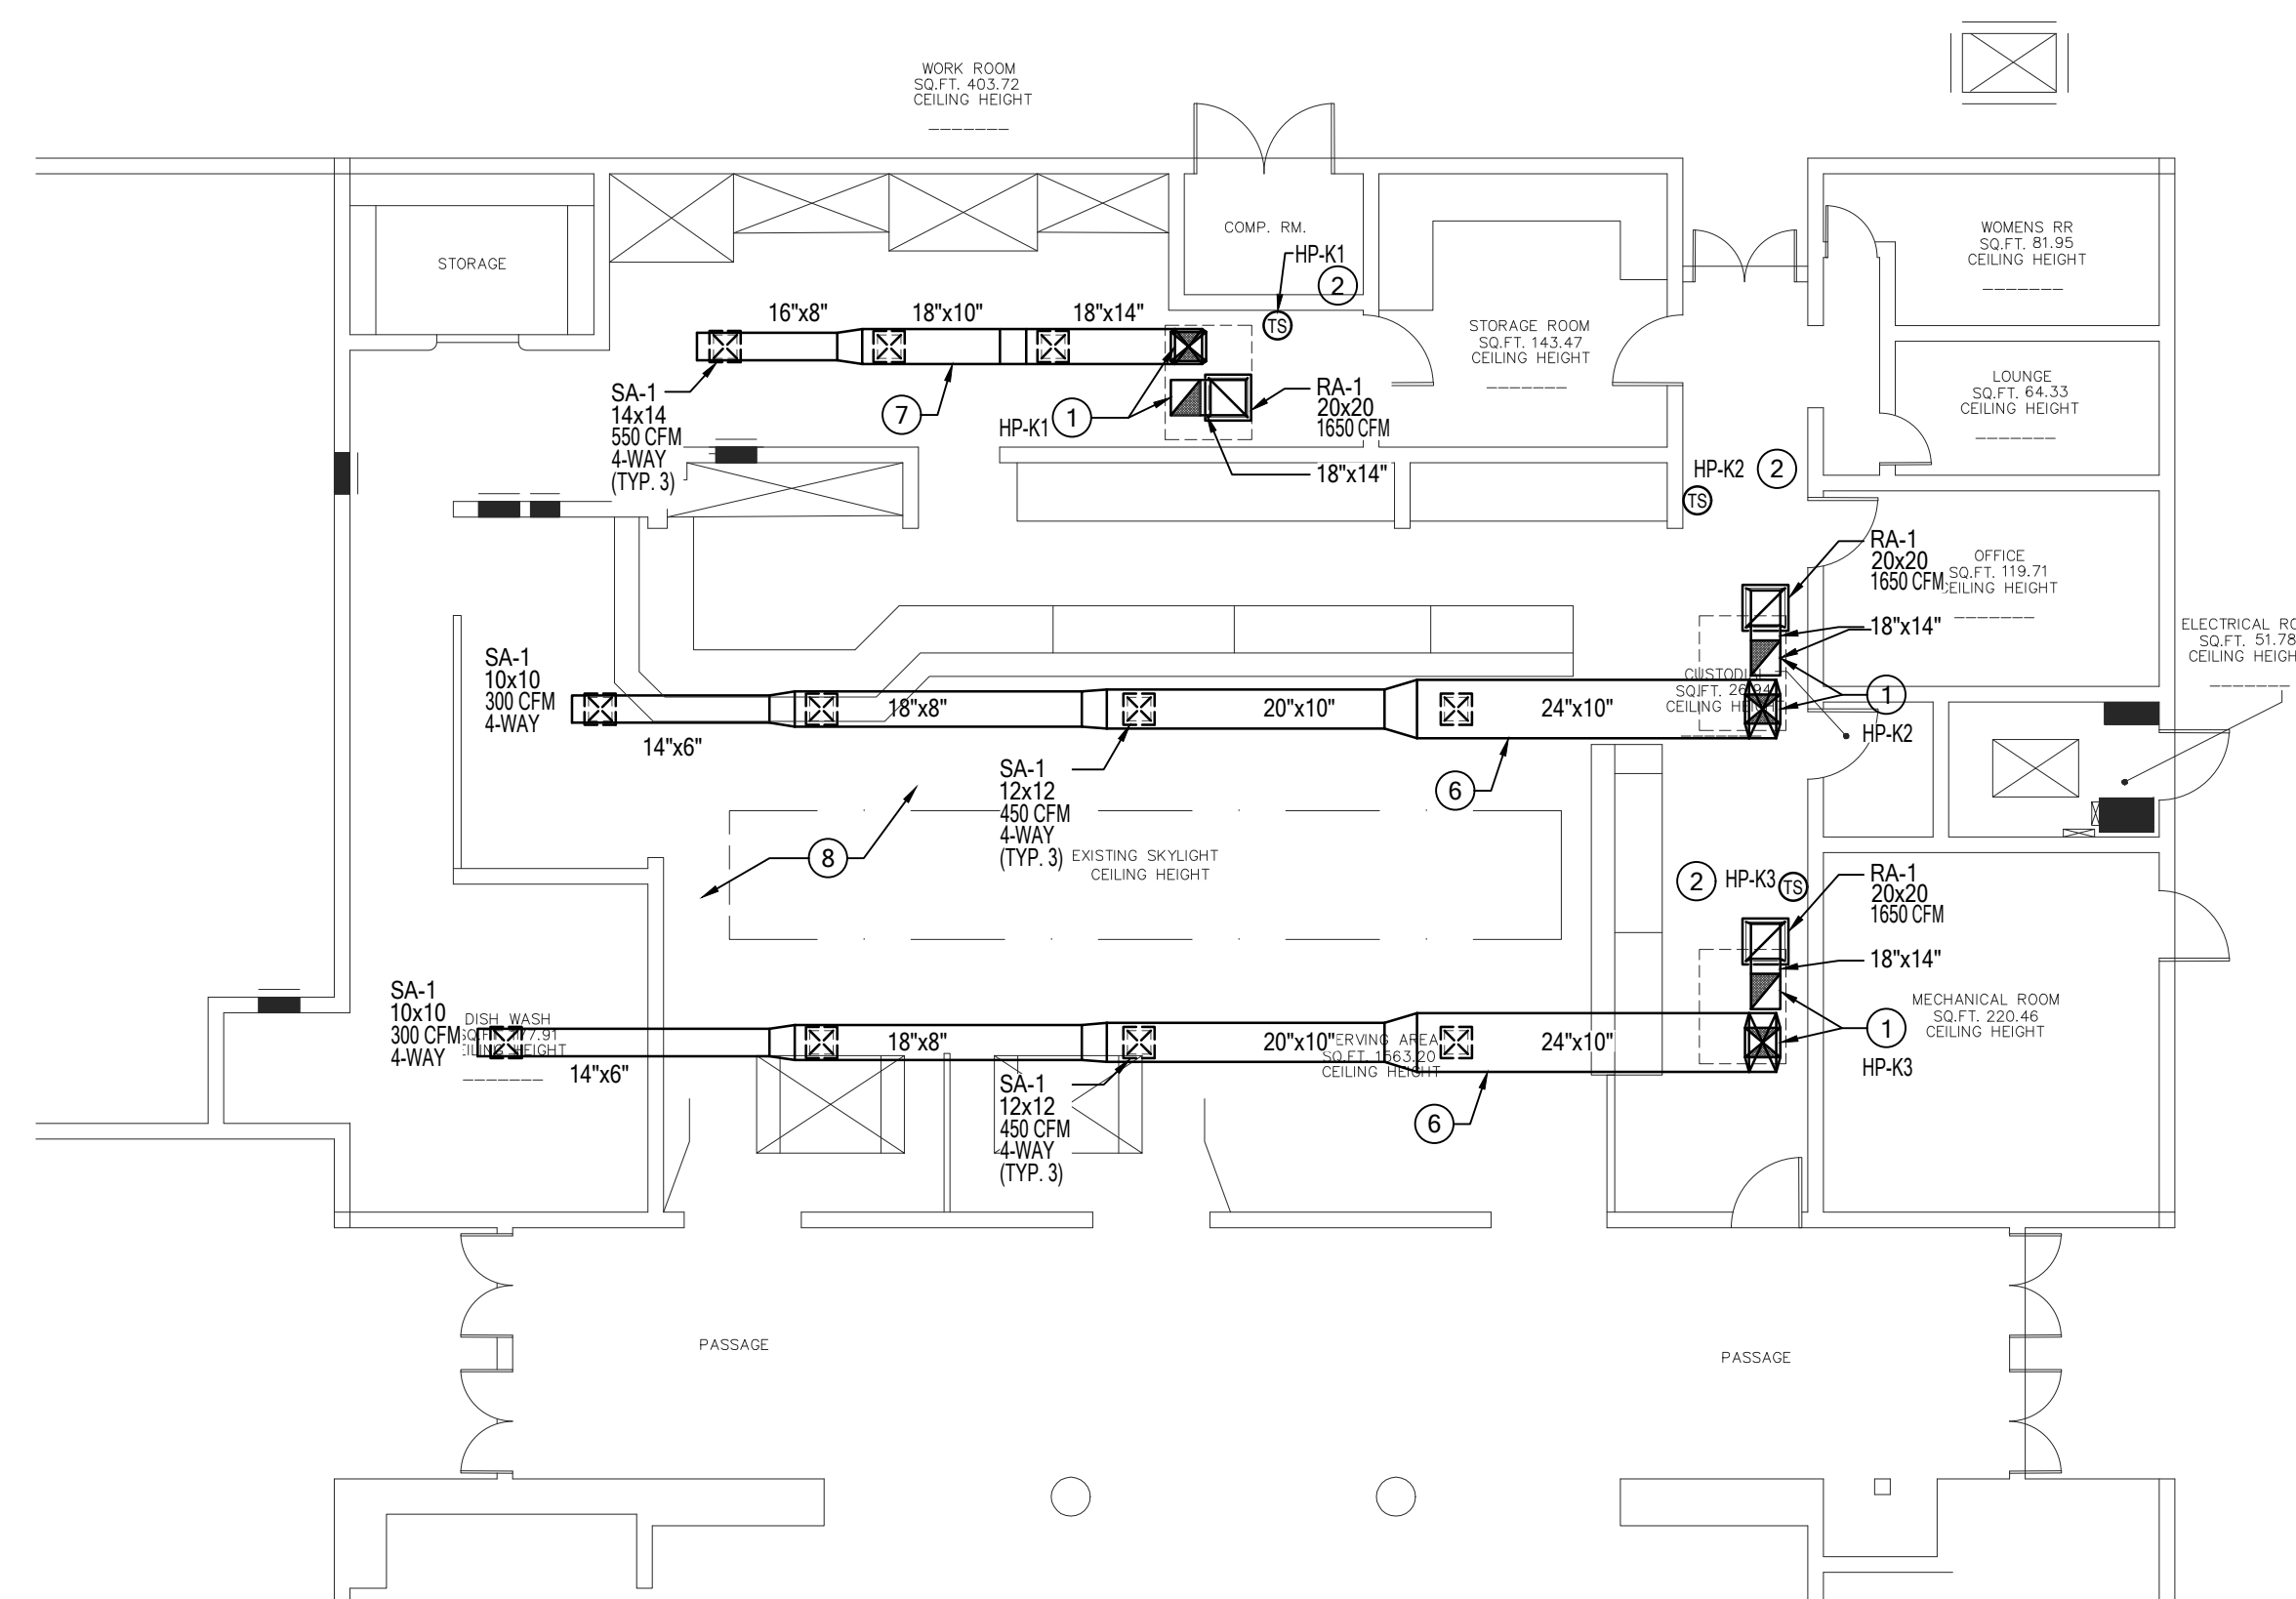

1 Mechanical Floor Plan
 SCALE: 1/8" = 1'-0"

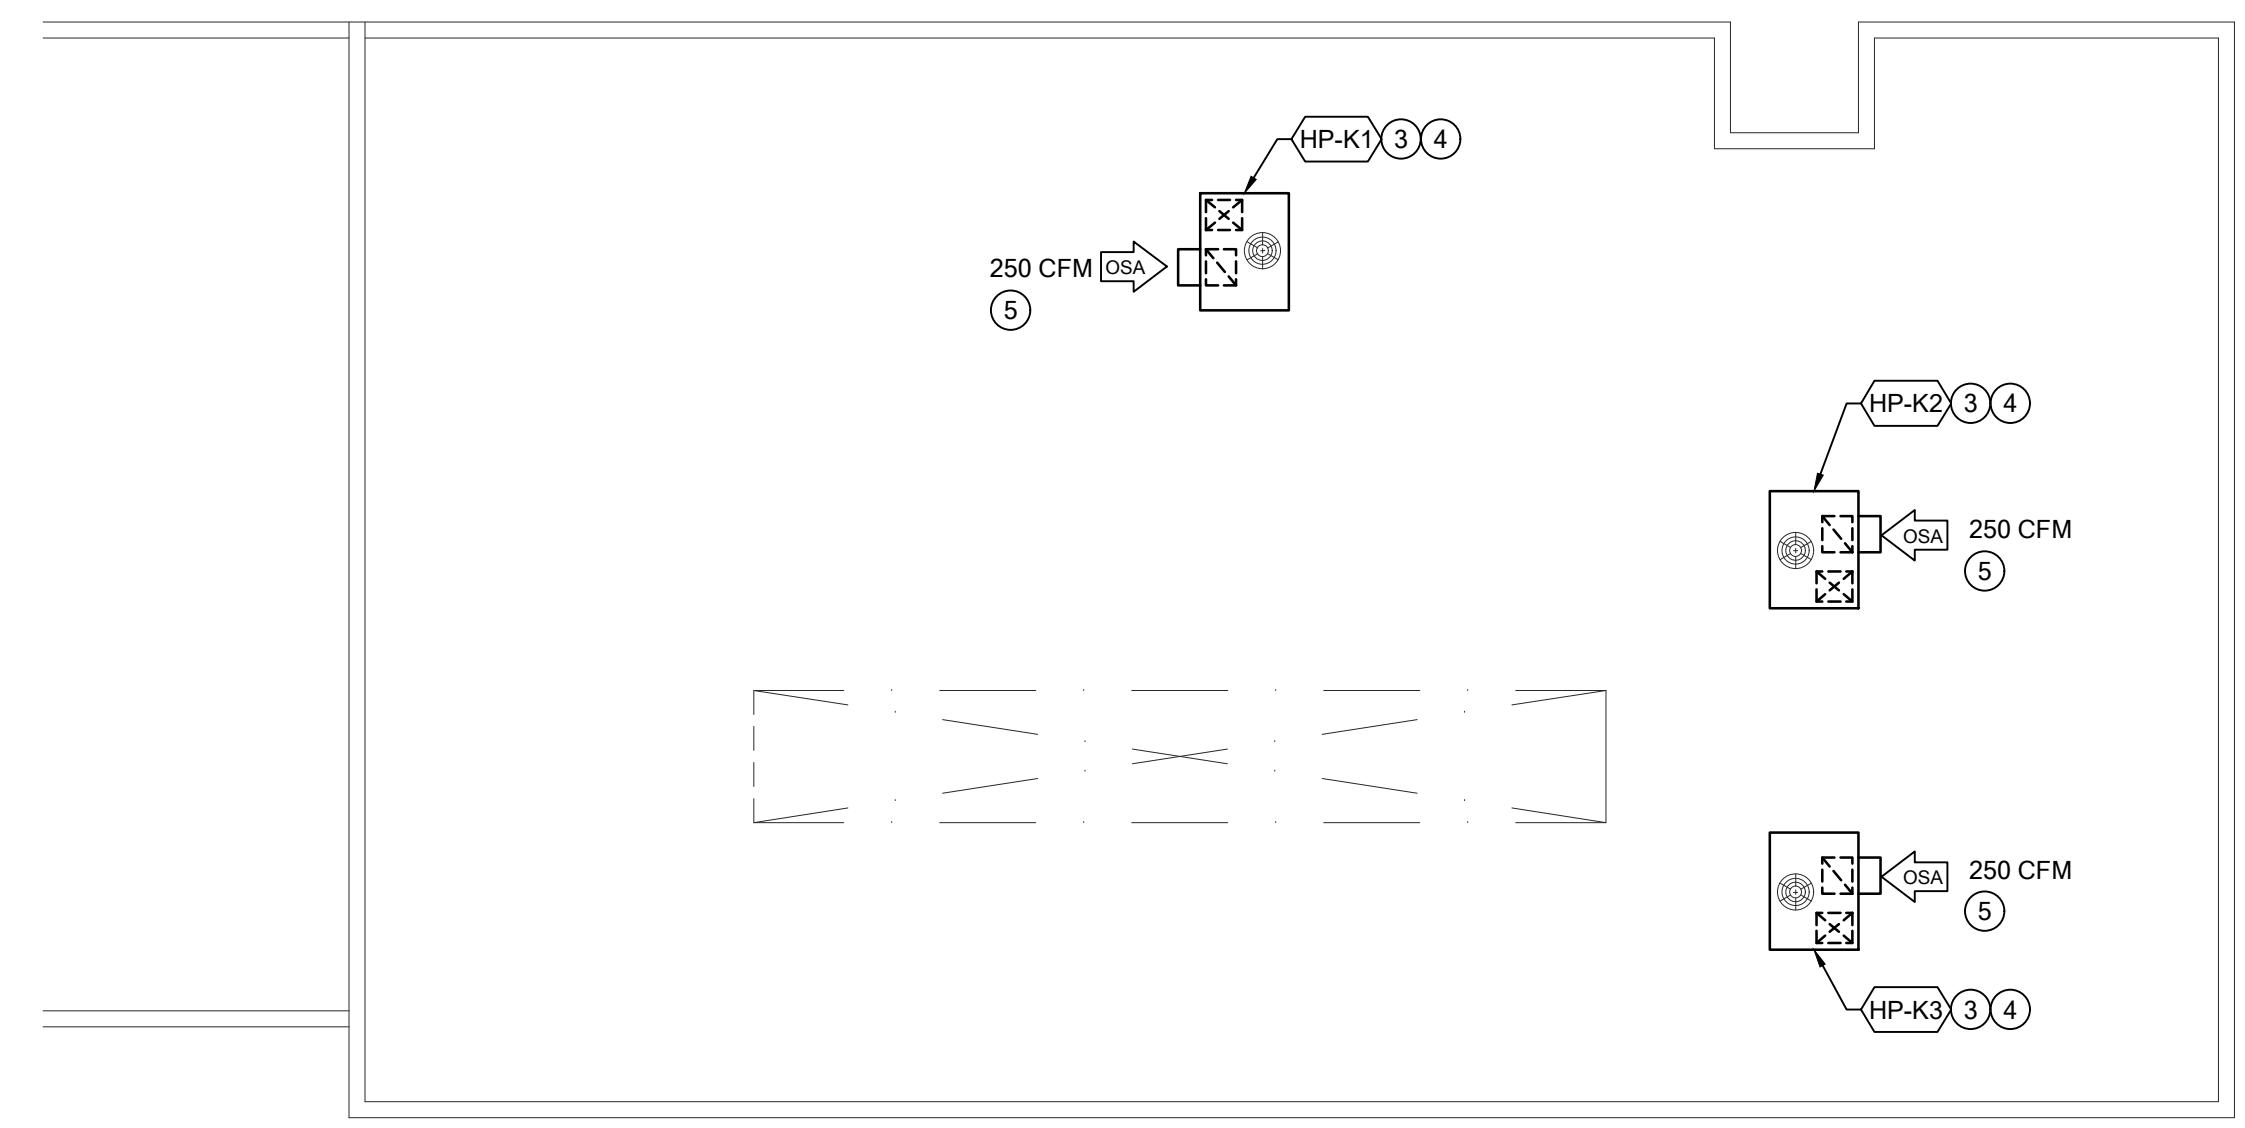

2 Mechanical Roof Plan
 SCALE: 1/8" = 1'-0"

PLAN NOTES:

- FRESH AIR INTAKES SHALL BE 10'-0" MIN. AWAY FROM ALL EXHAUST OUTLETS, PLUMBING VENTS, AND FLUES.
- CONTRACTOR SHALL COORDINATE EXACT EQUIPMENT, DUCTWORK AND PIPING SIZES AND LOCATIONS WITH OTHER TRADES PRIOR TO INSTALLATION.
- MAINTAIN MANUFACTURER MIN. CLEARANCES ON ALL ROOF-TOP MECHANICAL EQUIPMENT.
- THE MINIMUM VENTILATION RATES IN BREATHING ZONES SHALL BE IN CONFORMANCE WITH CALIFORNIA MECHANICAL CODE TABLE 4-1 AND/OR CALIFORNIA ENERGY CODE TABLE 121-A.
- DUCT SIZES SHOWN ON PLAN ARE INSIDE DIMENSIONS.
- CONTRACTOR SHALL PROVIDE SHOP DRAWINGS WITHIN 30 DAYS OF AWARD OF CONTRACT. IF SHOP DRAWINGS ARE NOT PROVIDED TO THE ENGINEER FOR APPROVAL, AND ANY CONFLICTS OCCUR BETWEEN TRADES, DURING CONSTRUCTION, & ETC. THEN, THE CONTRACTOR SHALL BE RESPONSIBLE AND BEAR ALL COST INCURRED FOR ANY REVISIONS, AT NO ADDITIONAL COST TO THE CLIENT. THE ARCHITECT AND ENGINEER SHALL BE NOTIFIED IMMEDIATELY PRIOR TO FABRICATION AND INSTALLATION OF ANY CONFLICTS BETWEEN TRADES, DURING CONSTRUCTION, & ETC.

PLAN KEY NOTES:

- FULL SIZE SUPPLY AND RETURN AIR DUCT UP THRU ROOF. TRANSITION TO 16"x16" DUCT IN VERTICAL DROP WITH ELL AND TURNING VANES AND TRANSITION HORIZONTALLY AS INDICATED WITH 1" ACOUSTICAL LINING. NO PLENUM TAPS.
- PROVIDE PROGRAMMABLE THERMOSTATS IN OFFICE WITH LOCKING COVERS, MOUNT AT +48" A.F.F.
- INSTALL LEVEL NEW EQUIPMENT WITH NEW ROOF CURBS. CONTRACTOR TO VERIFY IN FIELD EXACT LOCATION AND COORDINATE WITH ALL EXISTING MECHANICAL, PLUMBING AND ELECTRICAL ROOF EQUIPMENT AND COMPONENTS.
- CONTRACTOR TO RELOCATE ALL EXISTING MECHANICAL, PLUMBING AND ELECTRICAL SYSTEM COMPONENTS THAT ARE IN CONFLICT WITH NEW ROOFTOP UNIT AND ALL RELATED SYSTEMS.
- FRESH AIR INTAKES SHALL BE 10'-0" MIN. AWAY FROM ALL EXHAUST OUTLETS, PLUMBING VENTS, AND FLUES.
- INSTALL DUCTWORK AND AIR OUTLET DEVICE AS HIGH AS POSSIBLE, BELOW EXISTING CEILING. PAINT EXPOSED DUCT WORK AND ACCESSORIES TO MATCH EXISTING CEILING COLOR.
- INSTALL DUCTWORK ABOVE EXISTING CEILING. REMOVE AND REPLACE CEILING TO MATCH EXISTING AS REQUIRED.
- ALL NON-FUNCTIONAL EXISTING CEILING GRILLES/ DIFFUSERS SHALL BE REMOVED. CAP DUCTWORK AND REPLACE AND REPAIR CEILING TO MATCH EXISTING

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

| △ | | | |
|-----------------|------|-----------------|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| NO | DATE | BY | DESCRIPTION |
| REVISIONS | | | |
| DRAWN: IZ | | CHECKED: IP | |
| DATE: 8/31/2018 | | SCALE: AS NOTED | |
| PROJECT NUMBER: | | 17-302 | |

MECHANICAL PLANS

DRAWING NUMBER : **M1.1**


IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com


CONSULTANT

pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675

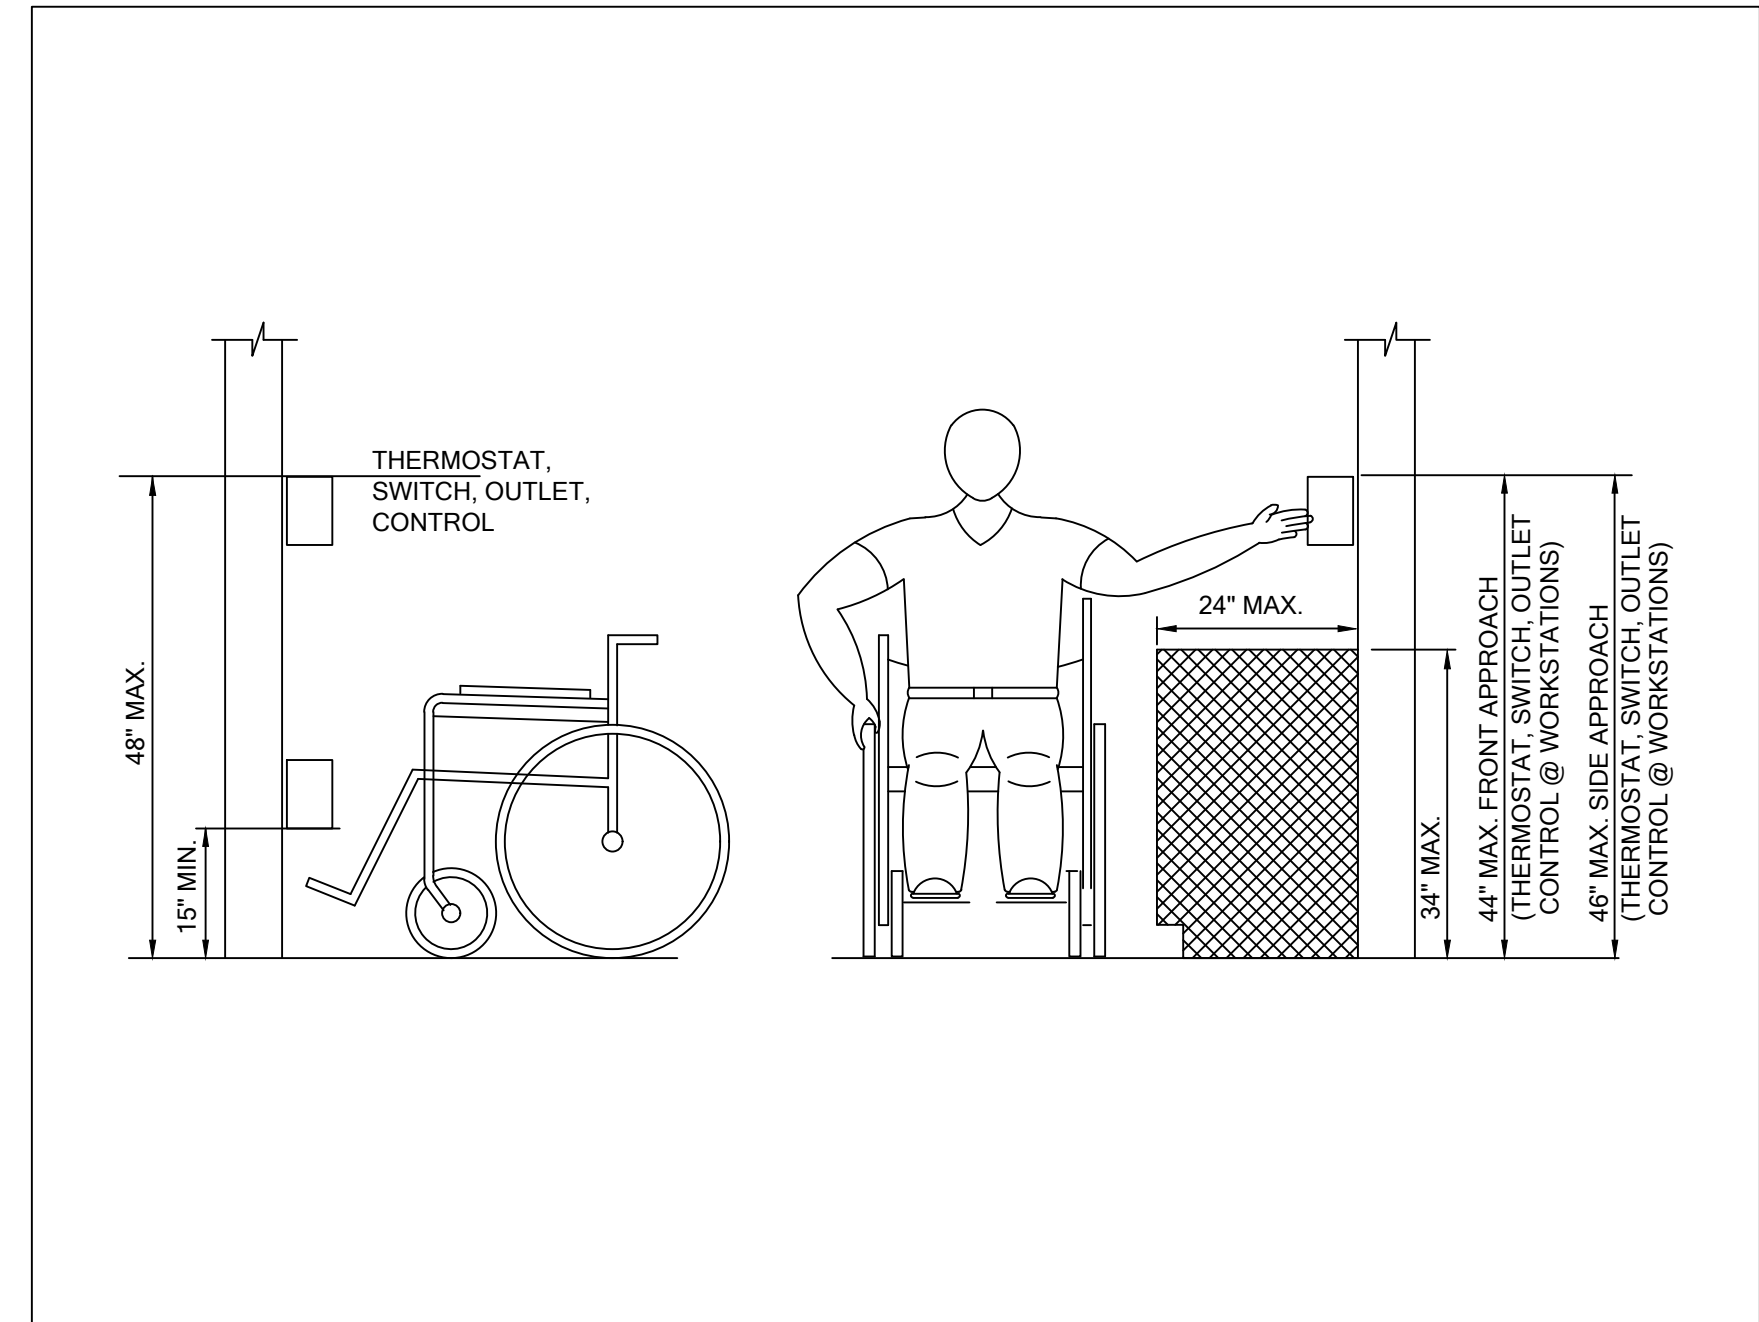

CONTROL DEVICE MOUNTING DETAIL

SCALE
 NONE 1

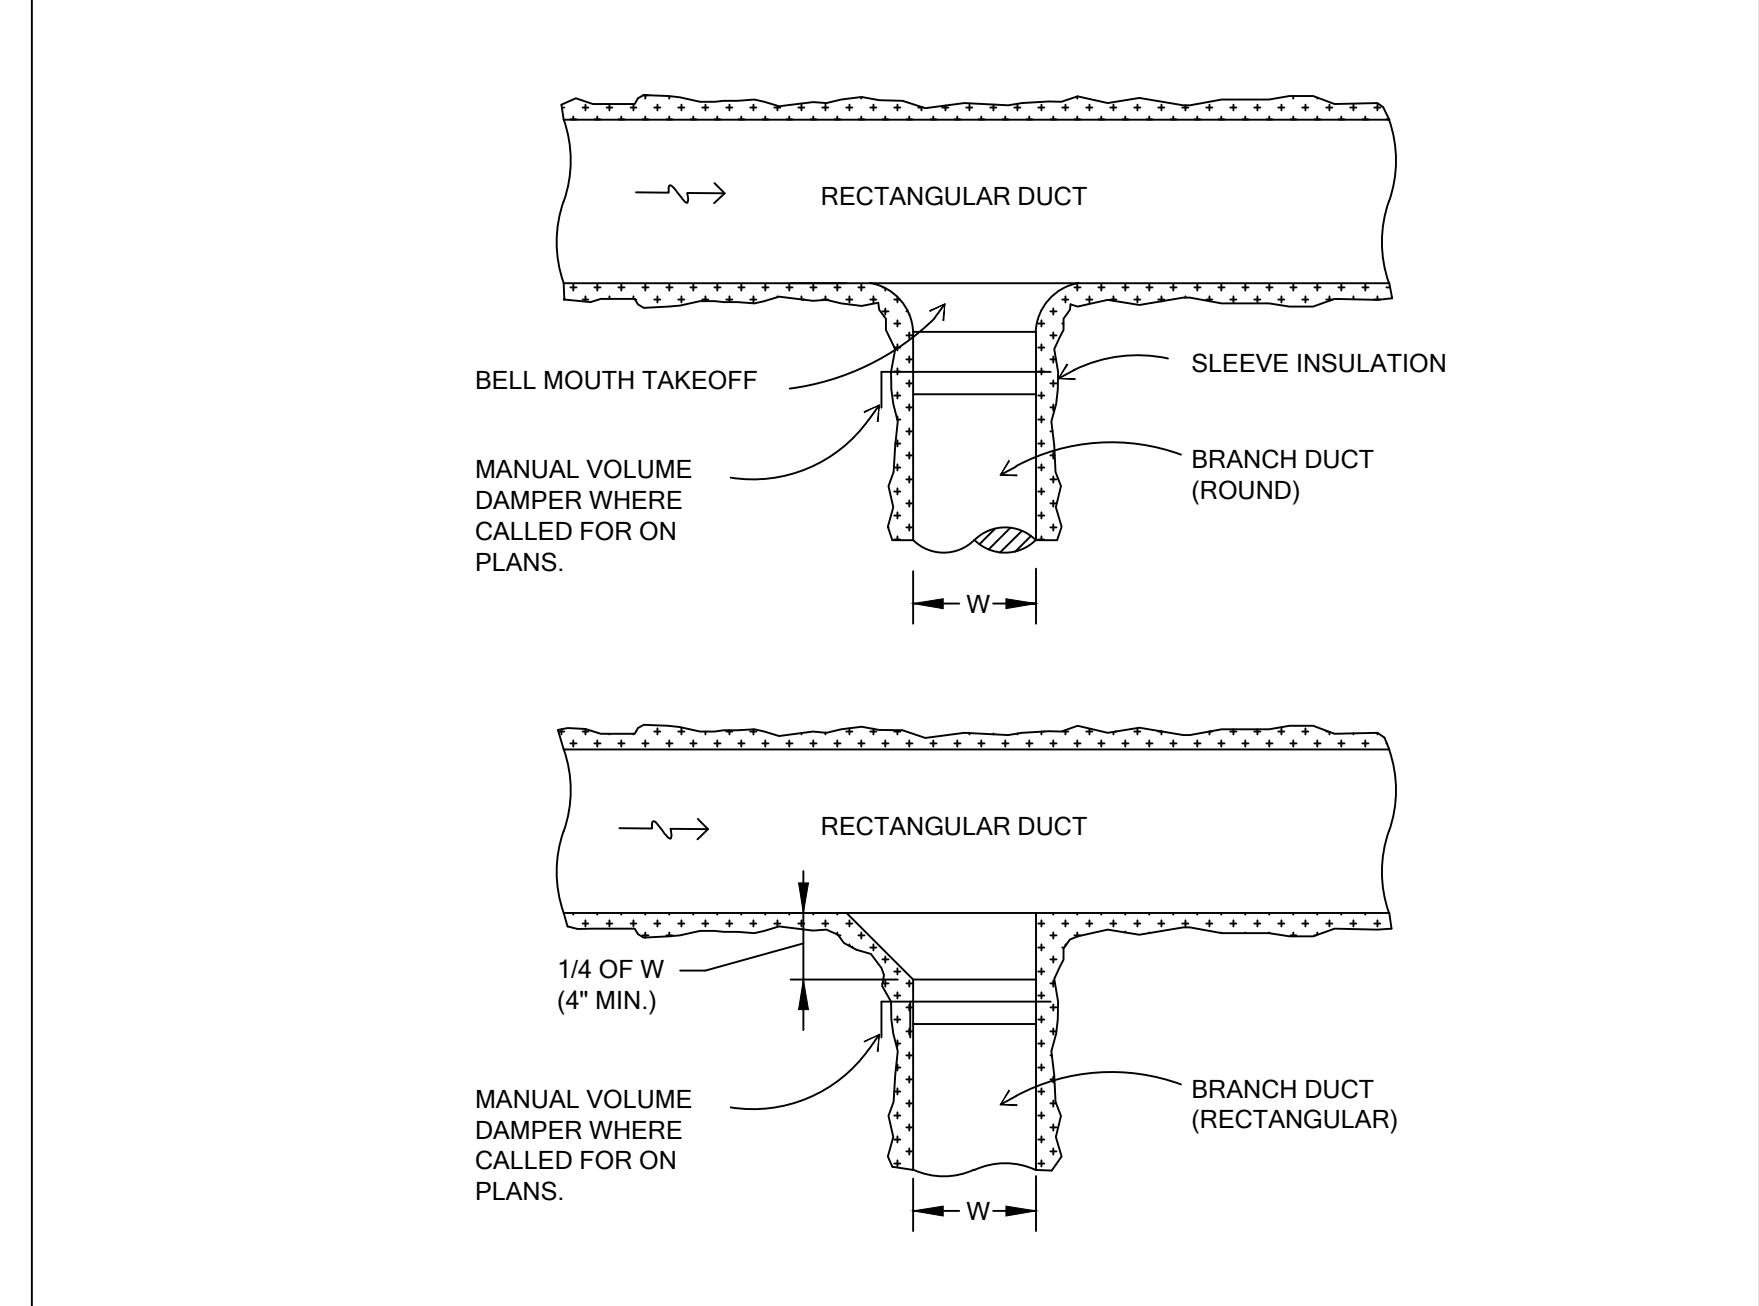

BRANCH TAKEOFF (REC)

SCALE
 NONE 2

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

| △ | | | |
|----|------|----|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| NO | DATE | BY | DESCRIPTION |

REVISIONS

| | | | |
|-----------------|-----------|----------|----------|
| DRAWN: | IZ | CHECKED: | IP |
| DATE: | 8/31/2018 | SCALE: | AS NOTED |
| PROJECT NUMBER: | 17-302 | | |

**MECHANICAL
 DETAILS**

DRAWING NUMBER : **M2.1**

SEISMIC ANCHORAGE NOTES

EQUIPMENT ANCHORAGE NOTE:

ALL MECHANICAL AND ELECTRICAL EQUIPMENT SHALL BE ANCHORED OR BRACED TO MEET THE HORIZONTAL AND VERTICAL FORCES PRESCRIBED IN THE 2010 CBC, SECTION 1614A.1.13 AND ASCE 7-05 SECTIONS 13.3, 13.4, 13.6, AND CHAPTER 6.

THE ATTACHMENTS OF THE FOLLOWING ITEMS SHALL BE DESIGNED TO RESIST THE FORCES PRESCRIBED ABOVE, BUT NEED NOT TO BE DETAILED ON THE PLANS, AND THE PROJECT INSPECTOR WILL VERIFY THAT THESE ITEMS (EQUIPMENT) HAVE BEEN ANCHORED.

- A. EQUIPMENT WEIGHING LESS THAN 400 POUNDS SUPPORTED DIRECTLY ON THE FLOOR OR ROOF.
- B. FURNITURE REQUIRED TO BE ATTACHED IN ACCORDANCE WITH ASCE 7-05, SECTION 13.5
- C. TEMPORARY OR MOVABLE EQUIPMENT WITH FLEXIBLE CONNECTION TO POWER OR UTILITIES.
- D. EQUIPMENT WEIGHING LESS THAN 20 POUNDS SUPPORTED BY VIBRATION ISOLATORS.
- E. EQUIPMENT WEIGHING LESS THAN 20 POUNDS SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

FOR THOSE ELEMENTS THAT DO NOT REQUIRE DETAILS ON THE APPROVED DRAWINGS, THE INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE MECHANICAL/ELECTRICAL ENGINEER. THESE ITEMS (EQUIPMENT) HAVE BEEN ANCHORED.

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE:

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM SHALL BE BRACED TO RESIST THE FORCES PRESCRIBED IN ASCE 7-05 SECTION 13.3 AS DEFINED IN ASCE 7-05 SECTION 13.6.8, 13.6.7, 13.6.5.5 ITEM 6.

THE BRACING ATTACHEMENTS TO THE STRUCTURE SHALL COMPLY WITH ONE OF THE OSHPD PRE- APPROVALS WITH AN OPA #, SUCH AS MASON INDUSTRIES (OPA 349), OR ISAT (OPA 485) AS MODIFIED TO SATISFY ANCHORAGE REQUIREMENTS OF ACI 318, APPENDIX D.

COPIES OF THE MANUAL SHALL BE AVAILABLE ON THE JOBSITE PRIOR TO START OF HANGING AND BRACING OF THE PIPE, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS.

THE STRUCTURAL ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.

LEGEND

| SYMBOL | ABBREVIATION | DESCRIPTION |
|--------|--------------|--|
| | S OR W | SOIL OR WASTE ABOVE FLOOR |
| | S OR W | SOIL OR WASTE BELOW FLOOR OR GRADE |
| | V | SANITARY VENT |
| | CW | COLD WATER |
| | HW | HOT WATER |
| | CD | CONDENSATE DRAIN |
| | OCD | OVERFLOW CONDENSATE DRAIN |
| | TP | TRAP PRIMER |
| | SOV | SHUT-OFF VALVE |
| | SOV/GC | SHUT-OFF VALVE OR GAS COCK IN YARD BOX |
| | FCO | FLOOR CLEANOUT |
| | WCO | WALL CLEANOUT |
| | | RISER UP |
| | | RISER DOWN |
| | ABV | ABOVE |
| | BEL | BELOW |
| | CLG | CEILING |
| | CONT | CONTINUATION |
| | DN | DOWN |
| | EXIST | EXISTING |
| | FLR | FLOOR |
| | FFE | FINISH FLOOR ELEVATION |
| | HDR | HEADER |
| | I.E. | INVERT ELEVATION |
| | POC | POINT OF CONNECTION |
| | PLCS | PLACES |
| | SLVE | SLEEVE |
| | VTR | VENT THRU ROOF |
| | YB | YARD BOX |

GENERAL NOTES

- BEFORE COMMENCEMENT OF WORK, THE CONTRACTOR SHALL VERIFY THE EXACT LOCATIONS, ELEVATIONS AND CHARACTERISTICS OF ALL UTILITIES AND PIPING, AND SHALL IMMEDIATELY NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- ALL VALVES, UNIONS, ETC. TO BE SAME SIZE AS PIPE UNLESS OTHERWISE INDICATED ON DRAWINGS.
- ALL PLUMBING FIXTURE VENTS TO TERMINATE A MINIMUM OF 12 INCHES FROM ANY VERTICAL SURFACE AND 10 FEET FROM ANY OUTSIDE AIR INTAKES.
- CONNECTION BETWEEN INCOMPATIBLE MATERIALS ABOVE GRADE AND INSIDE BUILDING SHALL BE MADE WITH TWO (2) DIELECTRIC UNIONS SEPARATED BY A TWELVE INCH (12") SECTION OF RED BRASS PIPE.
- ALL CLEANOUTS SHALL BE INSTALLED WHERE READILY ACCESSIBLE. THE CONTRACTOR SHALL COORDINATE ALL CLEANOUT LOCATIONS WITH EQUIPMENT, CABINETS, ETC., AND THE ARCHITECT PRIOR TO ANY INSTALLATION.
- ALL PLUMBING WORK SHALL BE INSTALLED SO AS TO AVOID INTERFERENCE WITH ELECTRICAL AND MECHANICAL EQUIPMENT AND STRUCTURAL FRAMING.
- ALL WORK AND MATERIAL SHALL BE PERFORMED AND INSTALLED IN COMPLIANCE WITH CALIFORNIA PLUMBING CODE 2013.
- ANY ALTERATIONS TO A STRUCTURAL MEMBER, SUCH AS CUTTING, BORING, BRAZING, DRILLING, WELDING, ETC. SHALL HAVE PRIOR WRITTEN APPROVAL OF ARCHITECT AND STRUCTURAL ENGINEER.
- INSULATION (SEE SPECIFICATION FOR TYPE REQUIRED) AND COVERING ON PIPE AND TUBING SHALL HAVE A FLAME SPREAD RATING NOT TO EXCEED 25 AND A SMOKE DENSITY NOT TO EXCEED 50 WHEN TESTED IN ACCORDANCE WITH 2013 U.B.C. STANDARD NO. 8-1.
- THE SEISMIC ANCHORAGE OF MECHANICAL AND ELECTRIC EQUIPMENT SHALL CONFORM TO ASCE 7-05 CHAPTER 13 TITLE 24 PART 5.

THE SEISMIC BRACING AND ANCHORAGE OF PIPING AND EQUIPMENT SHALL CONFORM TO SEISMIC HAZARD LEVEL "AA" TYPICAL AND BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE "GUIDELINES FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS AND PLUMBING SYSTEMS" PUBLISHED BY SMACNA WITH SUPPLEMENT 2000 AND APPROVED BY THE DSA.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 03-119661 INC:
REVIEWED FOR
SS FLS ACS
DATE: 10/25/2019

RFHC
RF Hawkins Consulting

2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rfhawkinsconsulting.com

CONSULTANT

pais
consulting group
18 Pine Hill Lane
Ladera Ranch, CA 92694
phone: 949.610.9675



HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221

| NO | DATE | BY | DESCRIPTION |
|----|------|----|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

REVISIONS

DRAWN: IZ CHECKED: IP
DATE: 8/31/2018 SCALE: AS NOTED
PROJECT NUMBER: 17-302

**PLUMBING GENERAL
NOTES, LEGEND &
DETAILS**

DRAWING NUMBER : **P0.1**

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
 RF Hawkins Consulting


2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com

CONSULTANT



pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675




HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

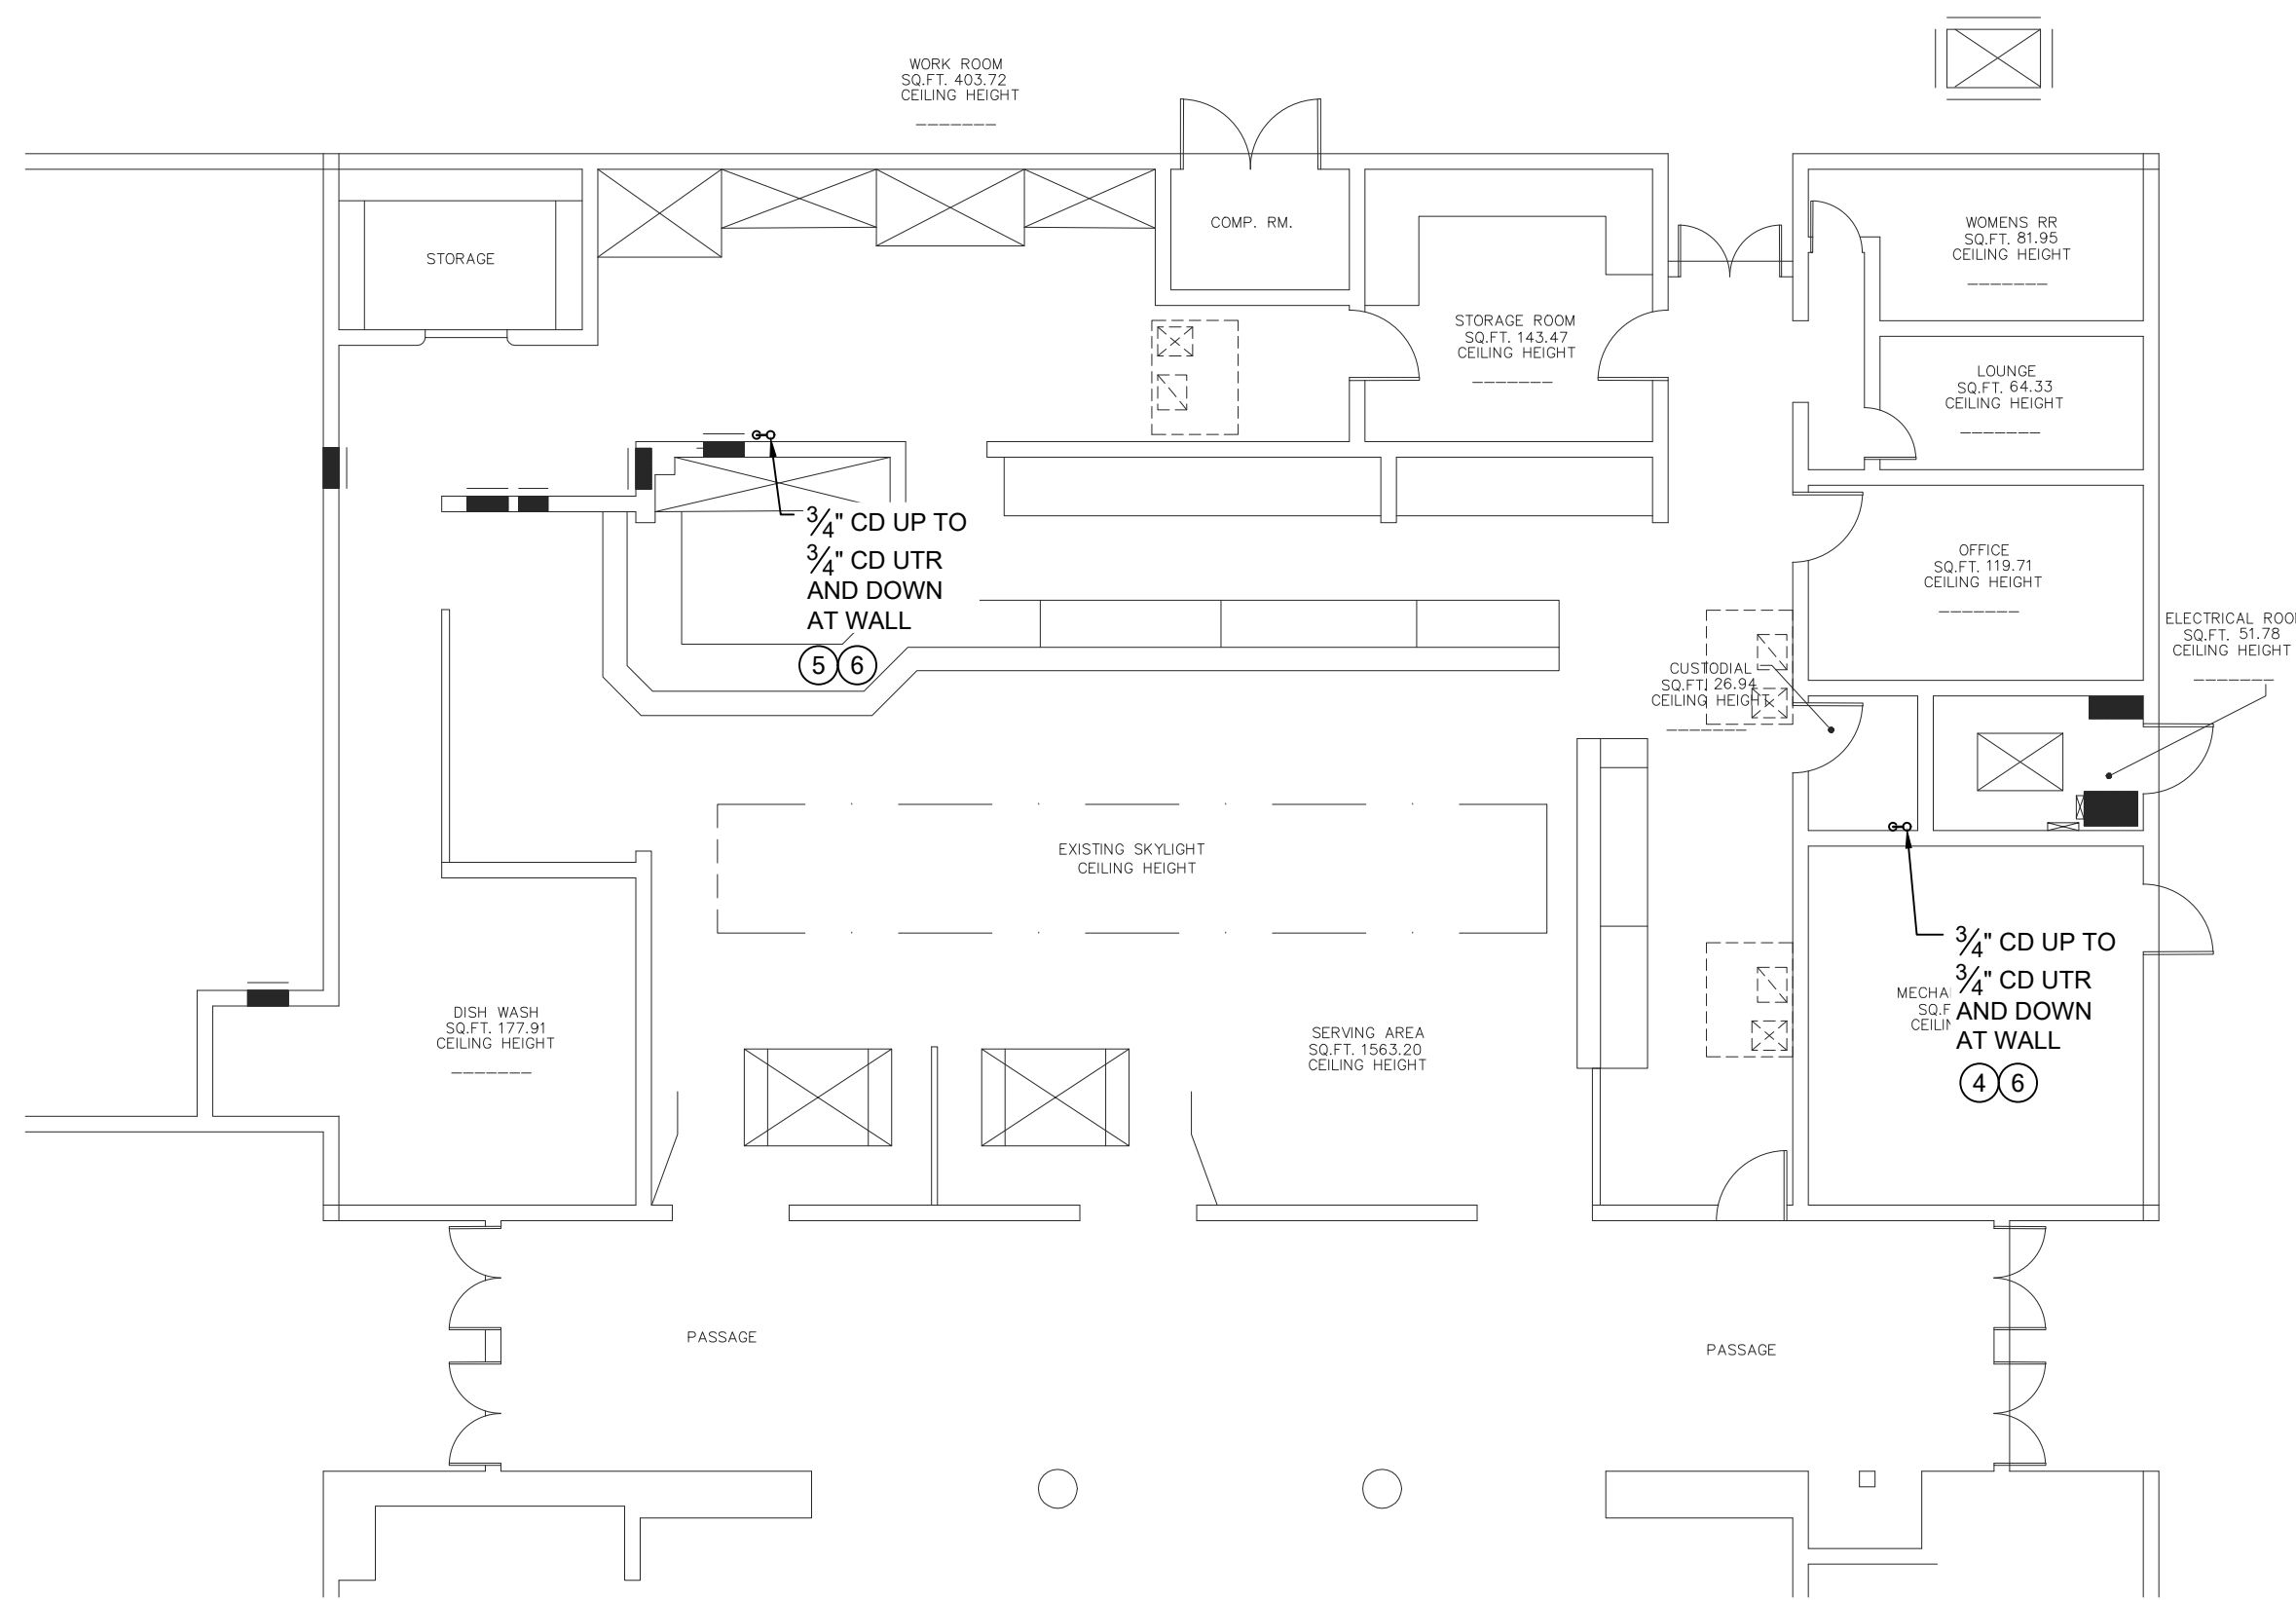

1 Plumbing Floor Plan
 SCALE: 1/8" = 1'-0"

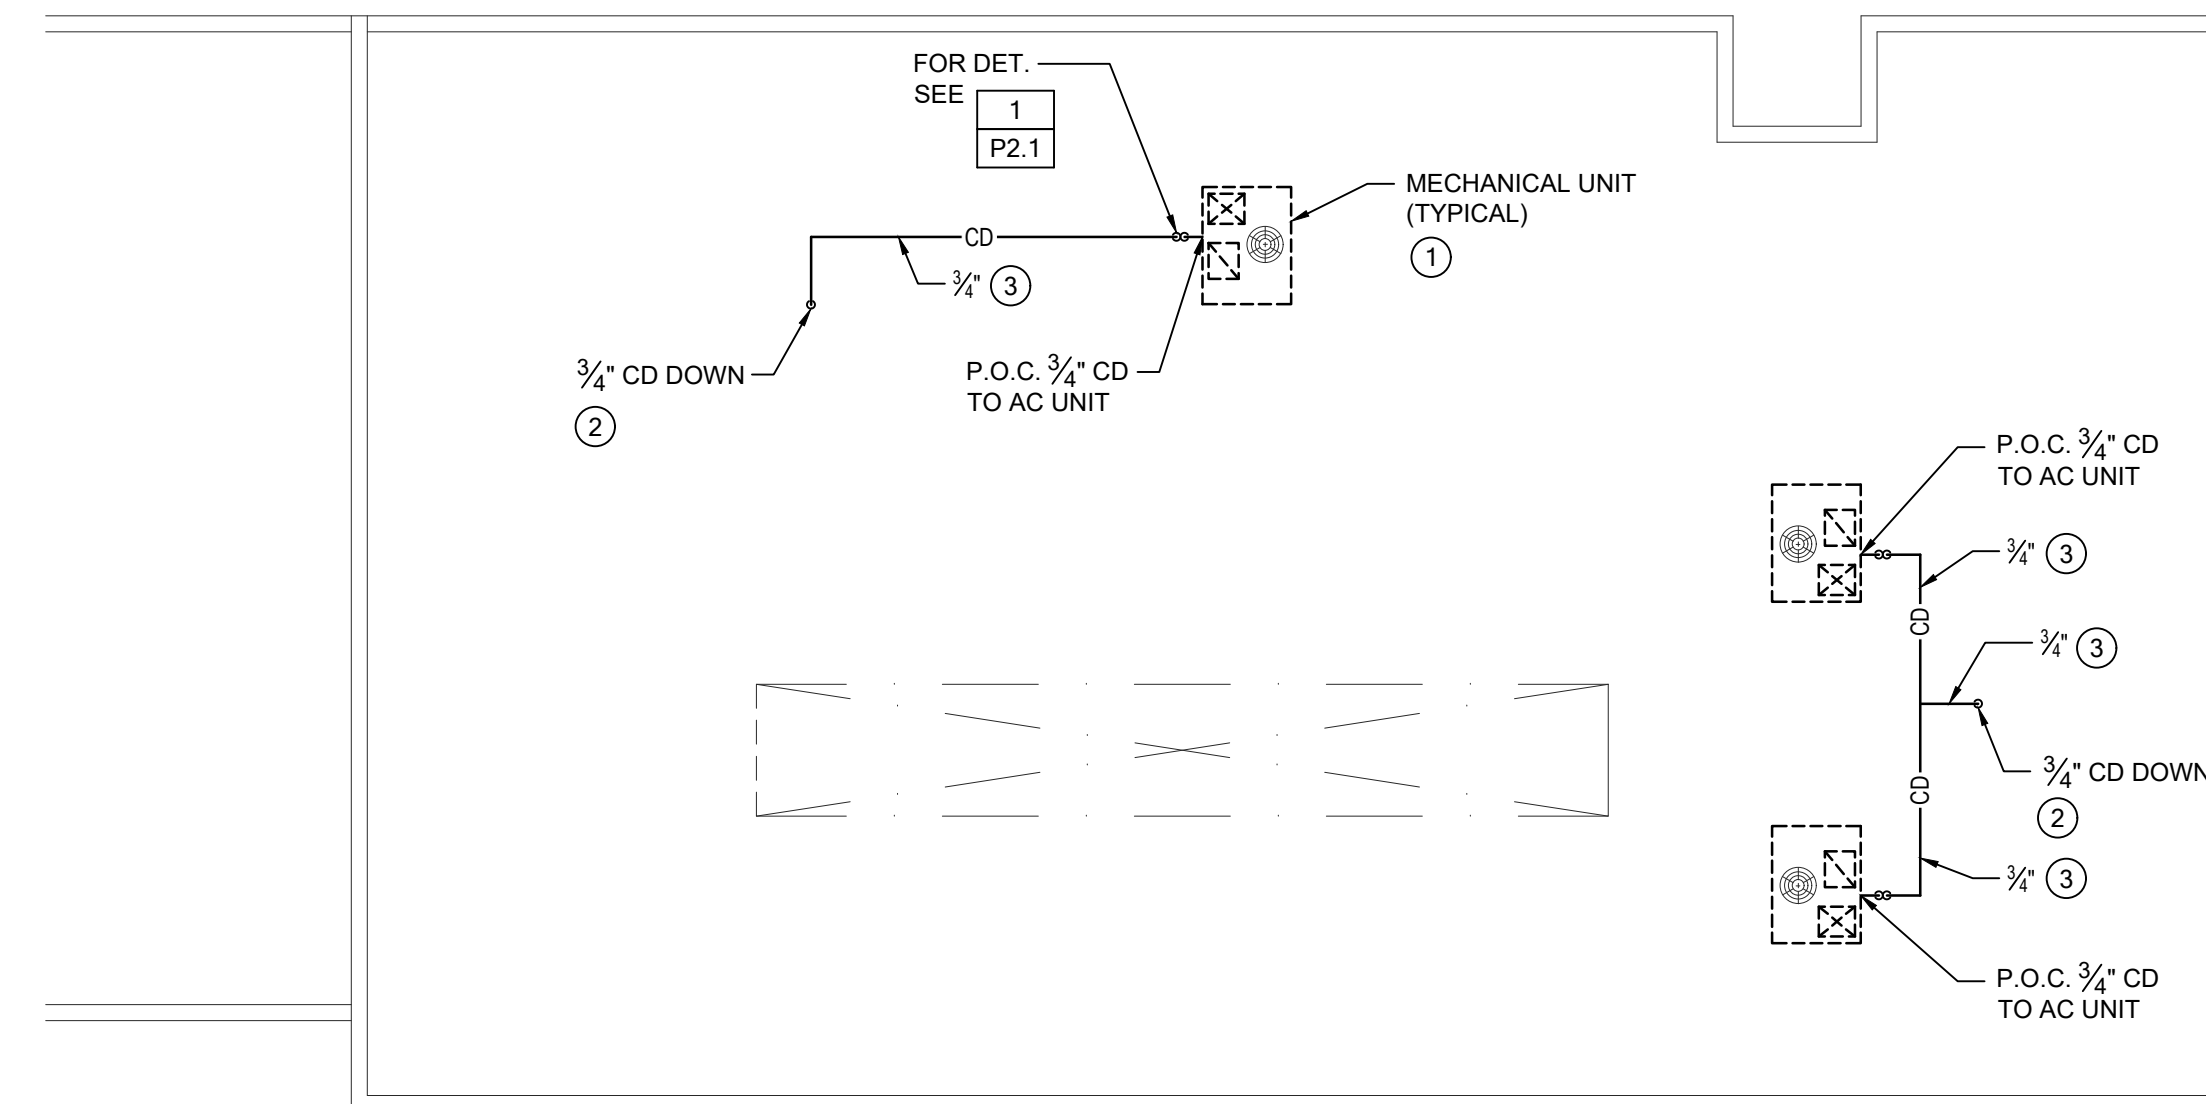

2 Plumbing Roof Plan
 SCALE: 1/8" = 1'-0"



PLAN NOTES:

- BEFORE COMMENCEMENT OF WORK, THE PLUMBING CONTRACTOR SHALL VERIFY THE EXACT LOCATIONS, ELEVATIONS AND CHARACTERISTICS OF ALL UTILITIES AND PIPING BY PHYSICAL EXCAVATION, AND SHALL IMMEDIATELY NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- CONTRACTOR SHALL FIELD VERIFY ALL EXISTING UTILITIES AND POINTS OF CONNECTION PRIOR TO BIDDING THE PROJECT.
- WHERE PLANS INDICATE NEW FIXTURES OR EQUIPMENT CONNECTING TO EXISTING SERVICES, THE PLUMBING CONTRACTOR SHALL MODIFY AND/OR EXTEND EXISTING PIPING OR ROUGH-INS AS REQUIRED TO ACCOMMODATE THE NEW FIXTURE.
- ALL SLEEVES THRU MASONRY WALLS AND FOOTINGS SHALL BE MINIMUM TWO PIPES SIZES LARGER THAN THE PIPE GOING THRU IT, PROVIDE ALL SLEEVES.
- ALL CONDENSATE DRAIN PIPING ABOVE CEILING SHALL SLOPE AT 1% UNLESS OTHERWISE NOTED.

KEY PLAN NOTES:

- NEW ROOF-TOP MECHANICAL UNIT. REFER TO MECHANICAL DRAWINGS FOR LOCATION.
- CONDENSATE DRAIN PIPING DOWN THRU ROOF. FLASH AND COUNTERFLASH ROOF PENETRATION WATER PROOF.
- PIPE ON ROOF. EXACT LOCATION MUST BE VERIFIED AND DETERMINED IN FIELD AND COORDINATED WITH EXISTING ROOF COMPONENTS. PROVIDE ROOF PIPE SUPPORT TO PROVIDE A CONTINUOUS, UNIFORM PIPE SLOPE OF MIN 1%.
- 3/4" CONDENSATE DRAIN PIPING UP AND DOWN SECURED AT WALL. TERMINATE DAYLIGHT WITH TURNDOWN ELBOW AT MOP SINK WITH 2" AIR GAP.
- 3/4" CONDENSATE DRAIN PIPING UP AND DOWN SECURED AT WALL. TERMINATE DAYLIGHT WITH TURNDOWN ELBOW AT FLOOR SINK WITH 2" AIR GAP.
- EXACT LOCATION MUST BE VERIFIED AND DETERMINED IN FIELD AND COORDINATED WITH EXISTING FLOOR/SERVICE SINK AND EXISTING WALL INSTALLED EQUIPMENT.

| | | | |
|----|------|----|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| △ | | | |
| NO | DATE | BY | DESCRIPTION |

| REVISIONS | | | |
|-----------------|-----------|----------|----------|
| DRAWN: | IZ | CHECKED: | IP |
| DATE: | 8/31/2018 | SCALE: | AS NOTED |
| PROJECT NUMBER: | 17-302 | | |

PLUMBING PLANS

DRAWING NUMBER : **P1.1**


IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
RF Hawkins Consulting

2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com


CONSULTANT

pais
 consulting group
 18 Pine Hill Lane
 Ladera Ranch, CA 92694
 phone: 949.610.9675

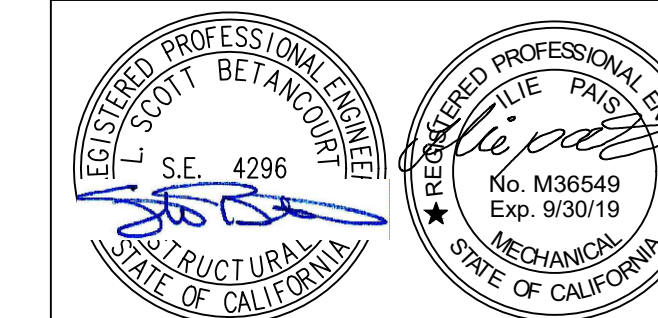

CONDENSATE TRAP DETAIL

| | |
|-------|---|
| SCALE | 1 |
| NONE | |

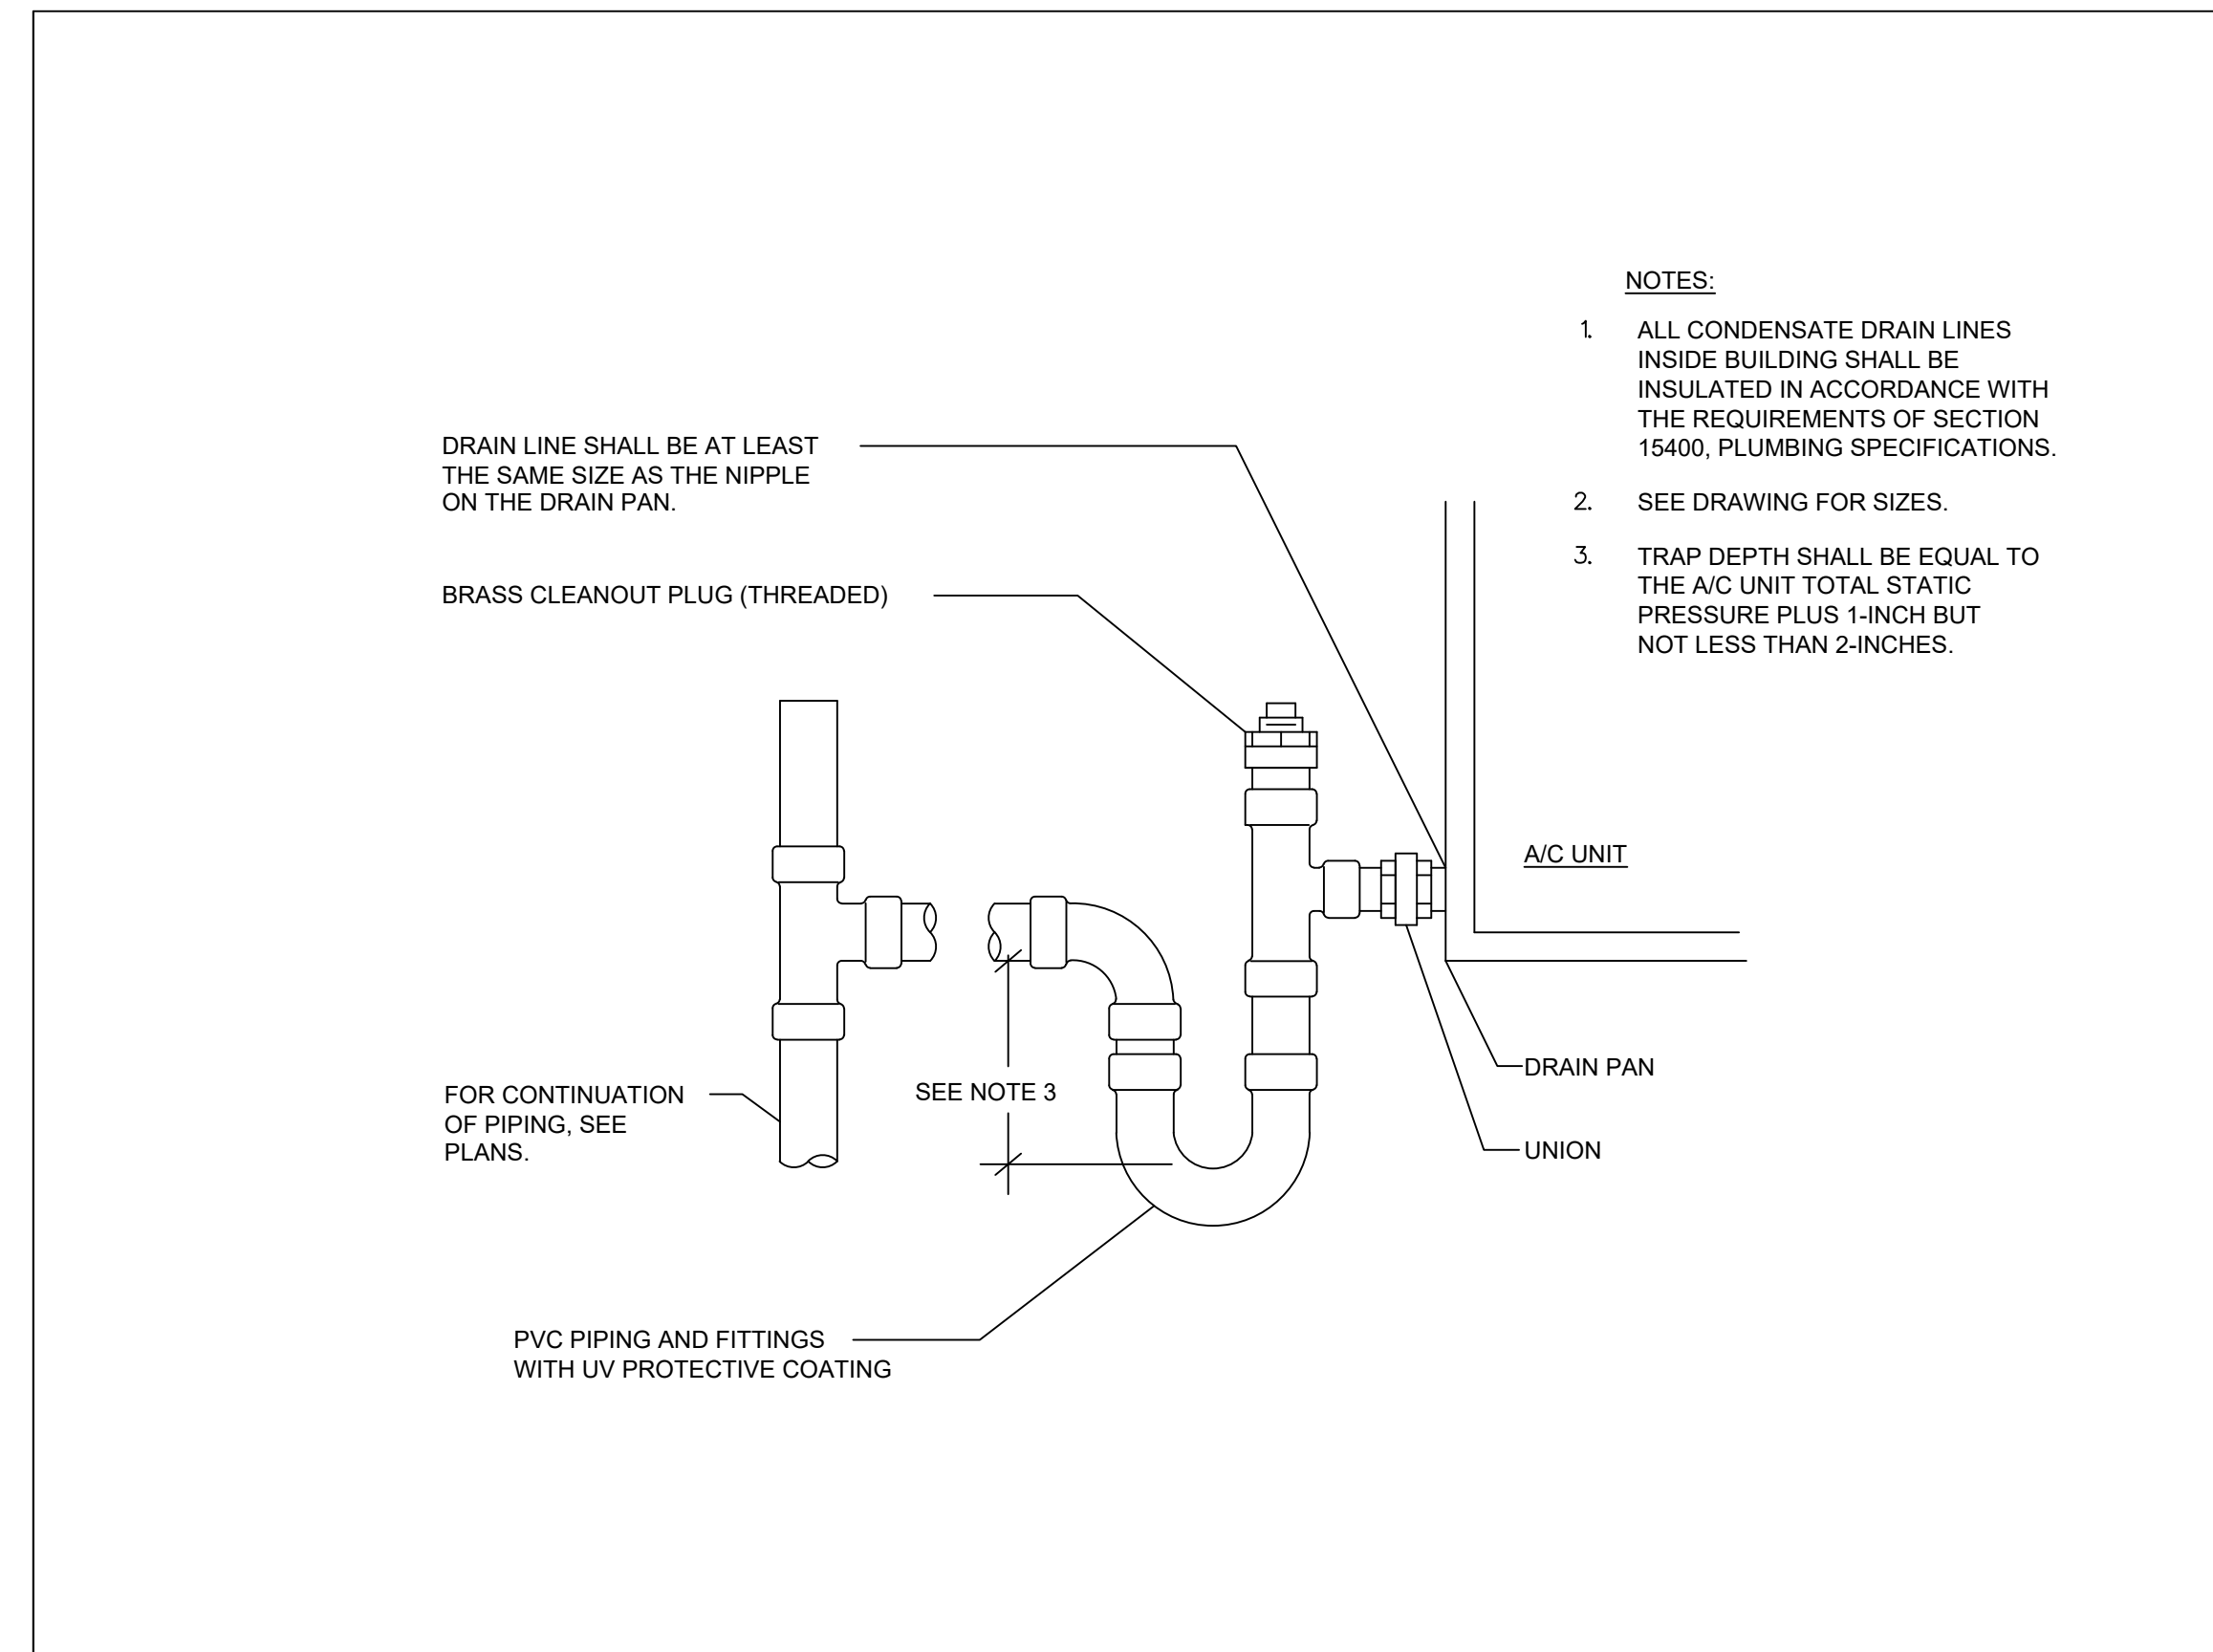

HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221

| △ | | | |
|----|------|----|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| NO | DATE | BY | DESCRIPTION |

REVISIONS

| | | | |
|-----------------|-----------|----------|----------|
| DRAWN: | IZ | CHECKED: | IP |
| DATE: | 8/31/2018 | SCALE: | AS NOTED |
| PROJECT NUMBER: | 17-302 | | |

**PLUMBING
 DETAILS**

DRAWING NUMBER : **P2.1**

GENERAL NOTES:

- DESIGN CRITERIA:
 - DESIGN CODE: 2016 CALIFORNIA BUILDING CODE (CBC)
 - S_s = 1.67 R = 6.5 OCCUPANCY CAT = 2
 - S_i = .611 C_s = .171 SITE CLASS = D
 - F_o = 1.00 RHO = 1.3 S.F.R.S. = I1 FRAMED WALLS WITH PLYWOOD
 - F_v = 1.50 V = .159xw ANALYSIS PROCEDURE = E.L.F.A.
 - SDS = 1.11 SDC = D WIND SPEED = 85 M.P.H. (A.S.D.)
 - SD1 = .611 I = 1.5 WIND EXPOSURE = B
- ALL MATERIALS AND WORK PERFORMED SHALL CONFORM WITH THE REQUIREMENTS OF THE 2016 CBC AND GOVERNING BUILDING ORDINANCES.
- NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER THESE GENERAL NOTES.
- WHERE A SECTION OR TYPICAL DETAIL IS SHOWN FOR ONE CONDITION, IT SHALL APPLY FOR ALL LIKE OR SIMILAR CONDITIONS UNLESS OTHERWISE NOTED.
- NO CHANGES ARE TO BE MADE TO THESE PLANS WITHOUT THE KNOWLEDGE AND WRITTEN CONSENT OF THIS ENGINEER. UNAUTHORIZED CHANGES RENDER THESE DRAWINGS VOID.
- ANY REFERENCE TO THE WORDS APPROVED, OR APPROVAL IN THESE DOCUMENTS SHALL BE HERE DEFINED TO MEAN GENERAL ACCEPTANCE OR REVIEW AND SHALL NOT RELIEVE THE CONTRACTOR AND/OR HIS SUB-CONTRACTORS OF ANY LIABILITY IN FURNISHING THE REQUIRED MATERIALS OR LABOR SPECIFIED.
- THE CONTRACT DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE AND DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK AND SHALL BE SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES INCLUDING BUT, NOT LIMITED TO BRACING & SHORING. OBSERVATION VISITS TO THE SITE BY FIELD REPRESENTATIVES OF THE ARCHITECT OR ENGINEER SHALL NOT INCLUDE INSPECTIONS OF THE PROTECTIVE MEASURES OR THE CONSTRUCTION PROCEDURES.
- GENERAL CONTRACTOR SHALL VISIT THE JOB SITE AND VERIFY ALL GRADES, DIMENSIONS, AND CONDITIONS PRIOR TO BIDDING AND COMMENCING CONSTRUCTION. ALL DIMENSIONS CONTROLLED BY EXISTING CONDITIONS SHALL BE VERIFIED BY THE CONTRACTOR AT THE SITE.
- IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO LOCATE ALL EXISTING UTILITIES WHETHER SHOWN HEREON OR NOT, AND TO PROTECT THEM FROM DAMAGE. THE CONTRACTOR SHALL BEAR ALL EXPENSE OF REPAIR OR REPLACEMENT IN CONJUNCTION WITH THE EXECUTION OF THIS WORK.
- GENERAL CONTRACTOR SHALL NOTIFY THE ENGINEER AND ARCHITECT IMMEDIATELY OF ANY DISCREPANCIES FOUND WITHIN THE CONTRACT DOCUMENTS, PRIOR TO STARTING WORK.


FRAMING LUMBER:

- ALL VISUALLY GRADED FRAMING LUMBER SHALL CONFORM TO THE GRADING RULES SET FORTH BY THE WEST COAST LUMBER INSPECTION BUREAU (WCLIB) OR THE WESTERN WOOD PRODUCTS ASSOCIATION (WWPA). EACH PIECE SHALL BEAR THE GRADE STAMP OF AN APPROVED GRADING AGENCY, EXCEPT EXPOSED LUMBER SHALL BEAR NO MARKINGS WHICH WILL BE VISIBLE AFTER INSTALLATION.
- FRAMING LUMBER SHALL BE DOUGLAS FIR-LARCH, UNLESS OTHERWISE NOTED. 2x AND 4x SAWN LUMBER SHALL HAVE A MOISTURE CONTENT NOT MORE THAN 19% AT TIME OF FABRICATION. THE FOLLOWING GRADES SHALL BE THE MINIMUM ACCEPTABLE GRADES, UNLESS OTHERWISE NOTED.

| ITEM | MINIMUM GRADE |
|--|---------------|
| STUDS: | |
| 2" THICK, 4" WIDE (STUD HT = 8'-1" MAX)..... | NO. 2 |
| 2" THICK, 4" TO 6" WIDE..... | NO. 2 |
| STRUCTURAL JOISTS AND LIGHT FRAMING: | |
| 2" TO 4" THICK, 4" AND WIDER..... | NO. 1 |
| BEAMS AND STRINGERS: | |
| 5" AND THICKER, 6" AND WIDER..... | NO. 1 |
| POST AND TIMBERS: | |
| 5" x 5" AND LARGER..... | NO. 1 |
- STRUCTURAL PLYWOOD SHALL CONFORM TO U.S. PRODUCT STANDARD PS 1-07. STRUCTURAL USE PANELS SHALL CONFORM TO PS 2-04 (APA PRP-108). APA GRADE STAMP SHALL BE PROVIDED ON ALL SHEATHING. SHEATHING SHALL BE EXPOSURE 1 (EXTERIOR GLUE). INSTALL WITH FACE GRAIN ACROSS SUPPORTS EXCEPT WHERE NOTED ON PLANS OR DETAILS. PROVIDE GAPS AT ALL EDGES AS RECOMMENDED BY APA. ROOF AND FLOOR SHEATHING AND SHEAR WALL PANELS SHALL BE IN PLACE AND INSPECTED BY THE BUILDING OFFICIAL PRIOR TO COVERING.
- FRAMING HARDWARE SHALL BE SIMPSON "STRONG TIE" OR EQUAL, UNLESS OTHERWISE NOTED. SUBSTITUTIONS SHALL BEAR ICC APPROVAL.
- NAILING NOTES:
 - ALL NAILS SHALL BE COMMON NAILS IN CONFORMANCE WITH FEDERAL SPECIFICATION N-105B, UNLESS OTHERWISE SPECIFIED ON DRAWINGS. SINKERS SHALL NOT BE SUBSTITUTED UNLESS SPECIFICALLY APPROVED BY THIS ENGINEER.
 - ALL NAILS EXPOSED TO THE WEATHER SHALL BE GALVANIZED.
 - TOE NAILS SHALL BE DRIVEN AT AN ANGLE OF 30 DEGREES TO THE PIECE SURFACE AND BE STARTED AT 1/3 THE LENGTH FROM THE EDGE OF THE PIECE.
- WOOD SCREWS SHALL BE IN CONFORMANCE WITH A.N.S.I. B18.6.1.
- BOLTS AND LAG SCREWS SHALL CONFORM TO A.N.S.I. B18.2.1. ALL BOLTS THRU WALL SHALL HAVE STANDARD CUT WASHERS EXCEPT WHERE METAL SIDE PLATES ARE SPECIFIED. BOLT HOLES SHALL BE BORED 1/32" TO 1/16" LARGER THAN THE BOLT DIAMETER, UNLESS OTHERWISE NOTED. THE CONTRACTOR SHALL INSTALL A SIMPSON BP-5/8-S WITH (4) SDS 1/4 x 1 1/2 SCREWS AT ALL HOLES LARGER THAN 1/16" OVERSIZED AT NO ADDITIONAL COST. ALL BOLTS SHALL BE RETIGHTENED PRIOR TO APPLICATION OF PLASTER, PLYWOOD, ETC.
- ALL WOOD BEARING ON CONCRETE OR MASONRY IF LESS THAN 4'-0" ABOVE GRADE SHALL BE PRESSURE TREATED DOUGLAS FIR.
- STRUCTURAL MEMBERS SHALL NOT BE CUT FOR PIPES, ETC. UNLESS SPECIFICALLY NOTED OR DETAILED.

ABBREVIATIONS:


- | | | | |
|-------|--------------------------|-------|------------------------|
| AB | ANCHOR BOLT | ID | INSIDE DIAMETER |
| AFF | ABOVE FINISH FLOOR | MB | MACHINE BOLT |
| BLK | BLOCK | MFR | MANUFACTURER |
| BN | BOUNDARY NAILING | MIN | MINIMUM |
| BTM | BOTTOM | (N) | NEW |
| CJ | CEILING JOIST | NS | NEAR SIDE |
| CLR | CLEAR | NTS | NOT TO SCALE |
| CONC | CONCRETE | o.c. | ON CENTER |
| CONT | CONTINUOUS | OD | OUTSIDE DIAMETER |
| DIM | DIMENSION | OH | OPPOSITE HAND |
| DBL | DOUBLE | PLCS | PLACES |
| DF | DOUGLAS FIR | PLY | PLYWOOD |
| DIA | DIAMETER | PT | PRESSURE TREATED |
| (E) | EXISTING | REINF | REINFORCEMENT |
| EA. | EACH | REQ'D | REQUIRED |
| EN | EDGE NAILING | RR | ROOF RAFTER |
| EQ | EQUAL | SHT'G | SHEATHING |
| EQUIP | EQUIPMENT | SIM | SIMILAR |
| FDN | FOUNDATION | SO | SQUARE |
| FRP | FIBER REINFORCED PLASTIC | STD | STANDARD |
| FS | FAR SIDE | STIFF | STIFFENER |
| FTG | FOOTING | THK | THICK |
| GLB | GLU-LAM BEAM | T.O. | TOP OF |
| HD | HOLD DOWN | TS | TUBE STEEL |
| HORIZ | HORIZONTAL | TYP | TYPICAL |
| | | UON | UNLESS OTHERWISE NOTED |
| | | VERT | VERTICAL |

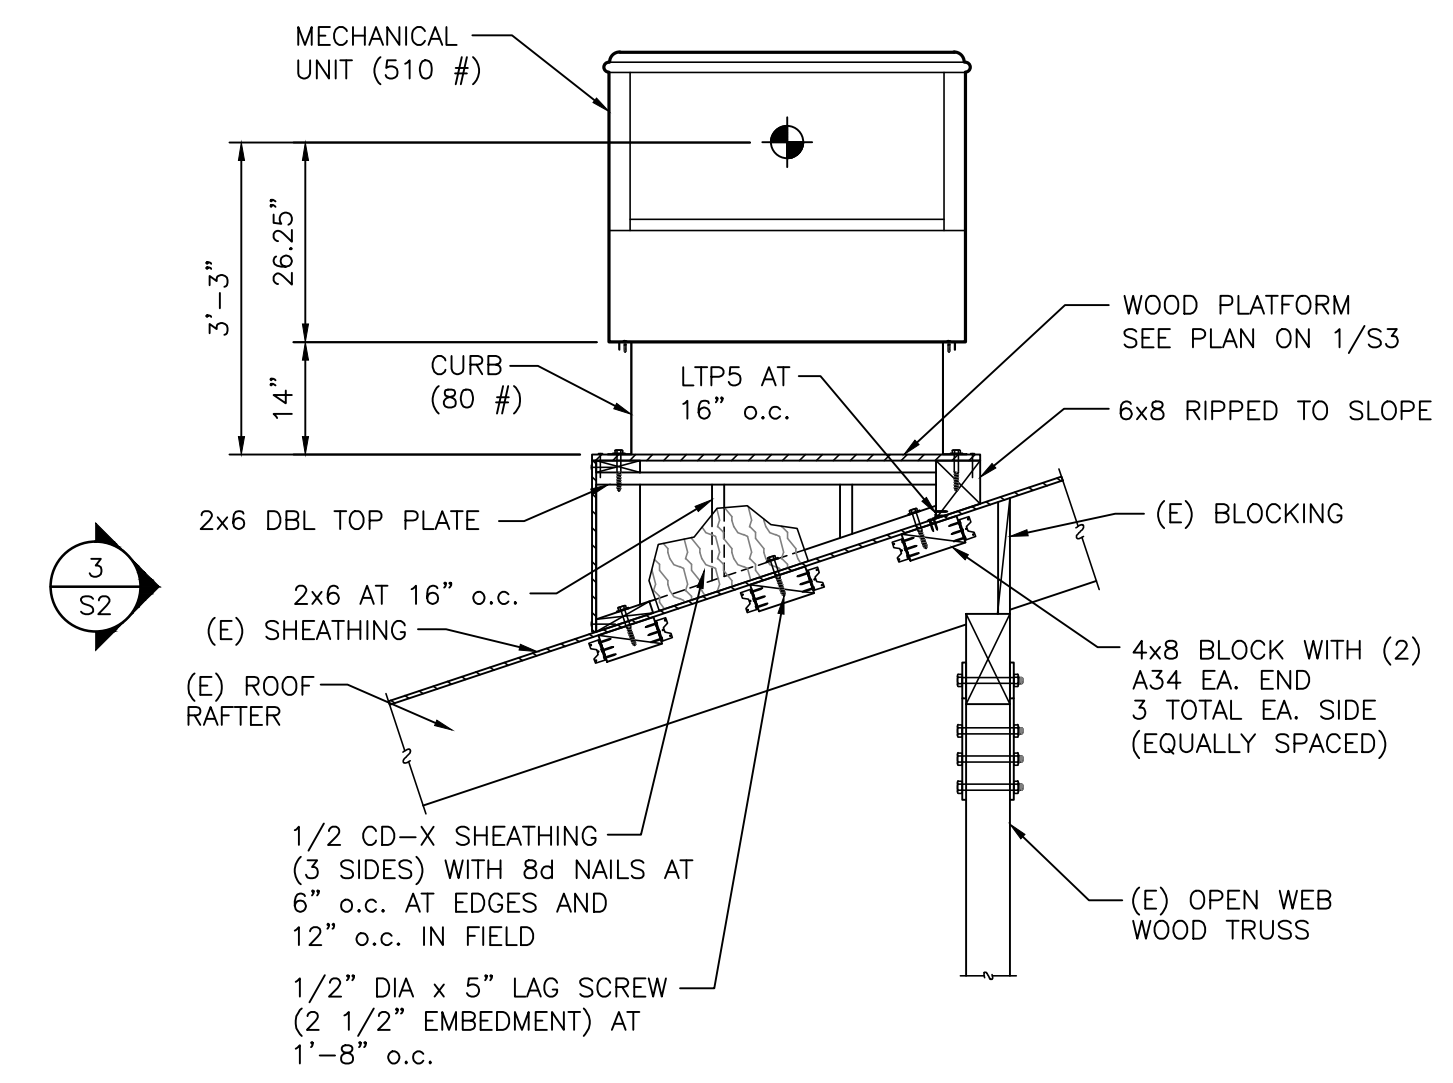

- NOTES:**
- SEE 2/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN TOP FLANGE OF PREFABRICATED CURB.
 - SEE 3/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN BTM FLANGE OF PREFABRICATED CURB.

PLATFORM FRAMING ELEVATION


1

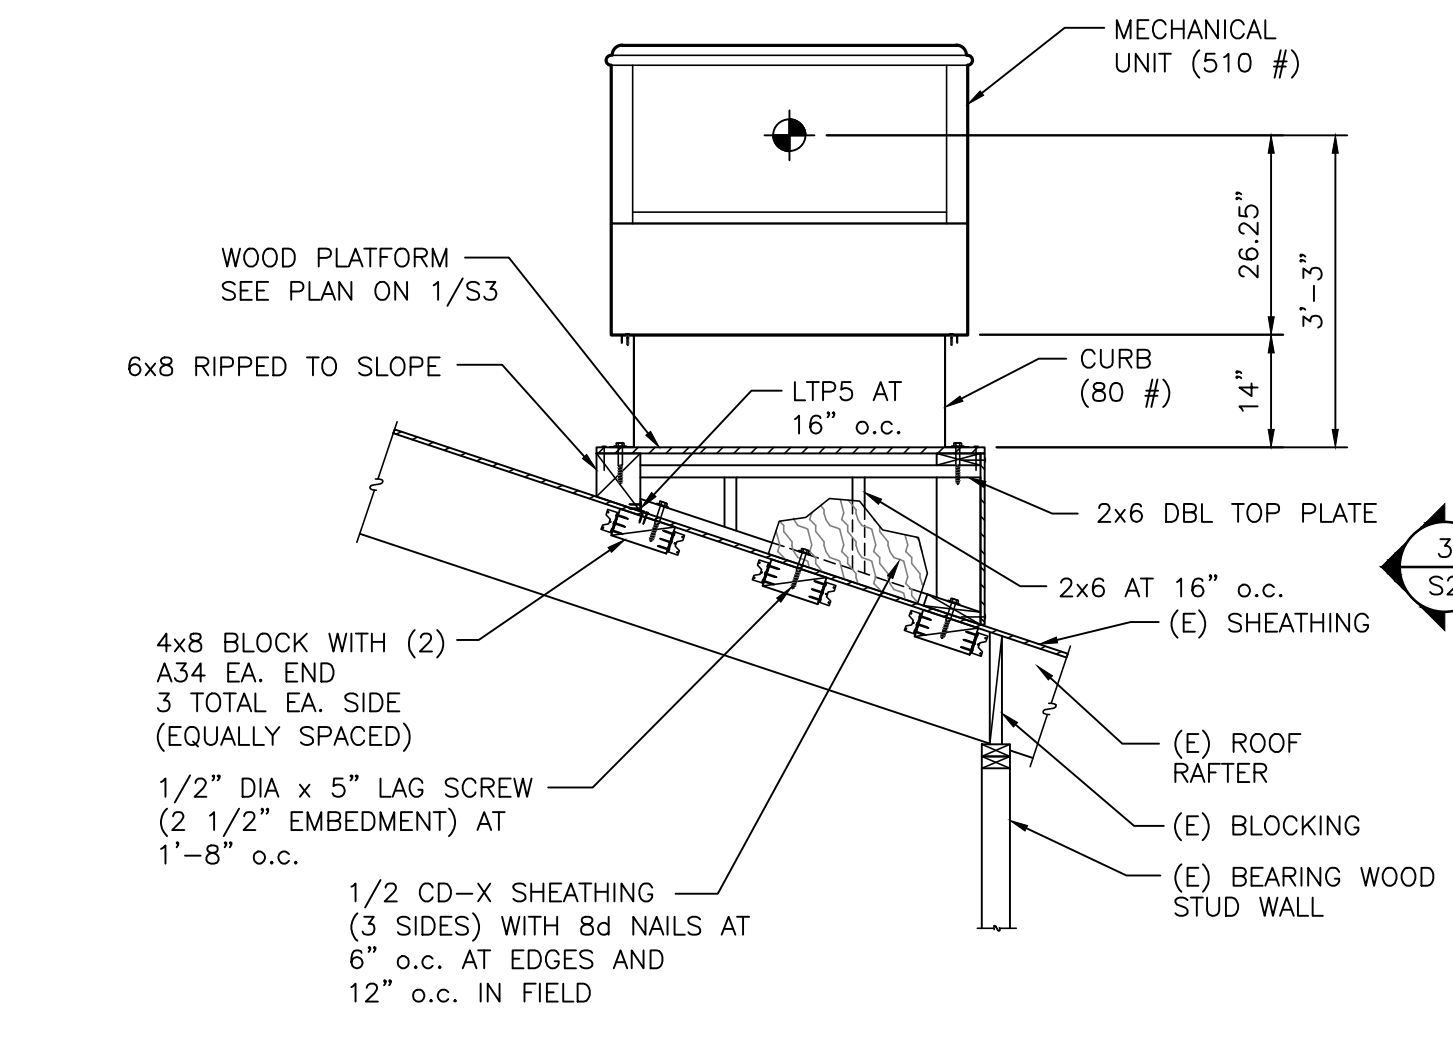

- NOTES:**
- SEE 2/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN TOP FLANGE OF PREFABRICATED CURB.
 - SEE 3/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN BTM FLANGE OF PREFABRICATED CURB.

PLATFORM FRAMING ELEVATION

2

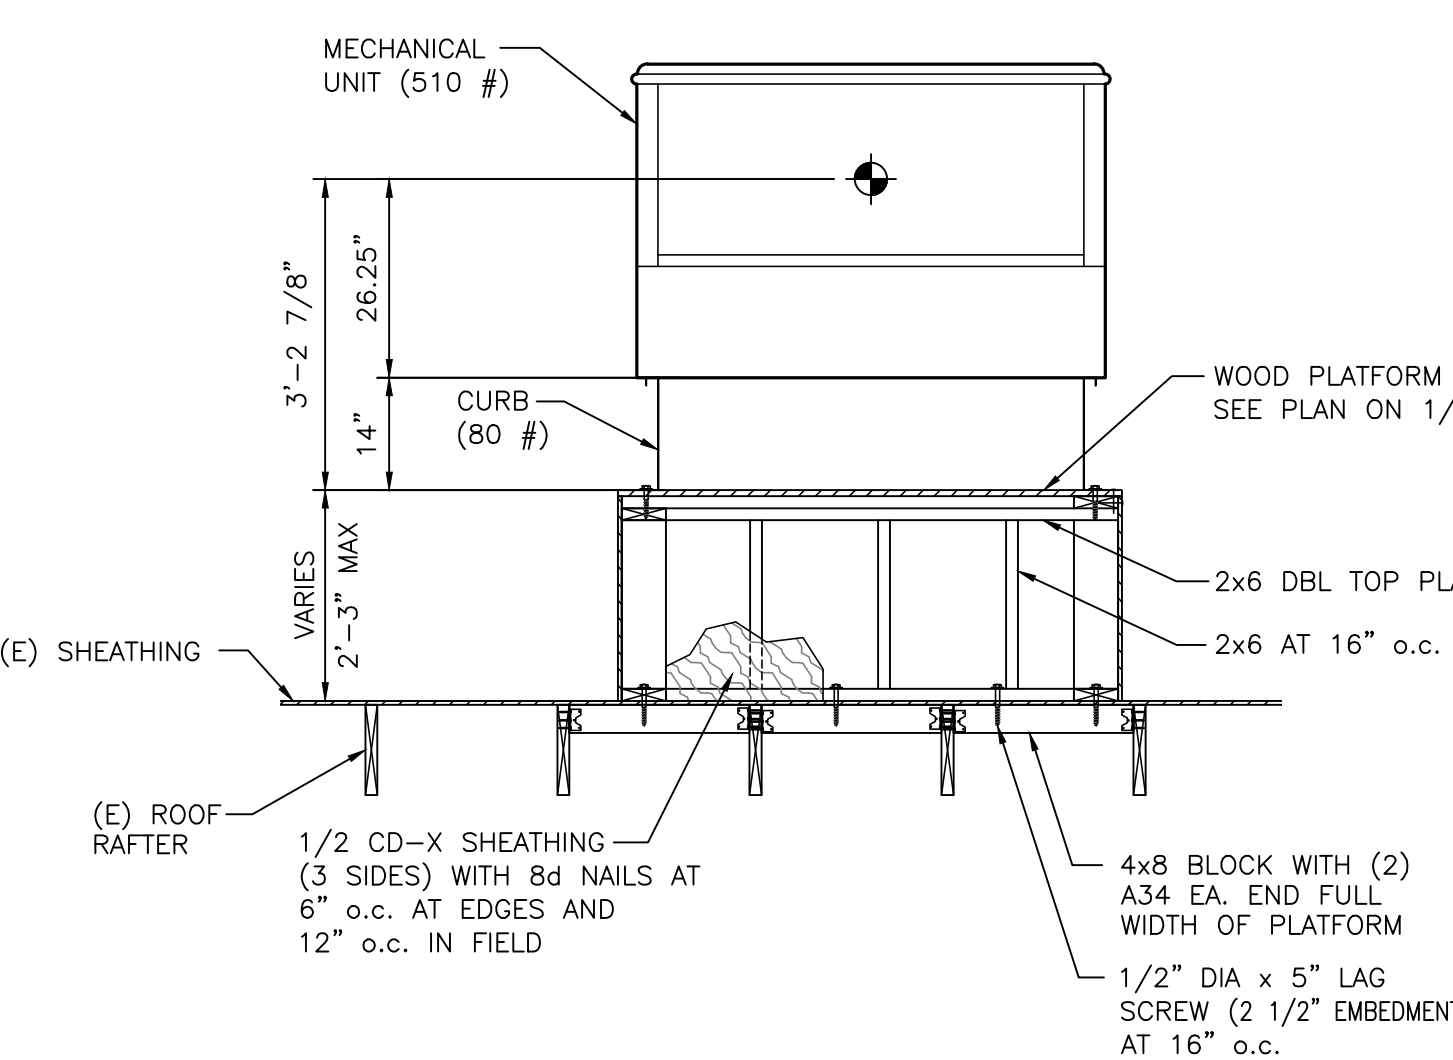

- NOTES:**
- SEE 2/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN TOP FLANGE OF PREFABRICATED CURB.
 - SEE 3/S3 FOR ANCHOR TYPE, SIZE, AND LOCATION IN BTM FLANGE OF PREFABRICATED CURB.

CONSTRUCTION NOTES

PLATFORM FRAMING ELEVATION


3

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 03-119661 INC.
REVIEWED FOR
SS FLS ACS
DATE: 10/25/2019



2357 Naples Avenue
Mentone, CA 92359-9635
Tel: (909) 522-4518
design@rfhawkinsconsulting.com

CONSULTANT
next step DESIGN, INC
26170 ENTERPRISE WAY SUITE 400
LAKE FOREST, CA 92630
PHONE: (949) 218-3339
FAX: (949) 457-9375
NSD JOB # 16-208

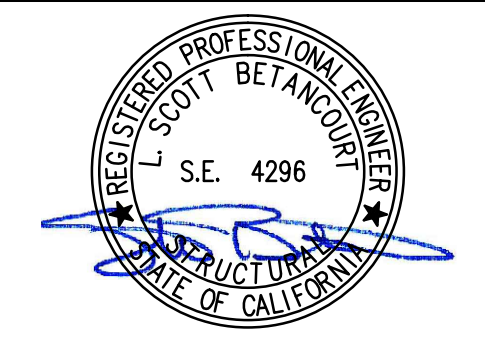

**HVAC ADDITIONS TO
CAFETERIA BLDG.
COMPTON COMMUNITY
COLLEGE DISTRICT
COMPTON COLLEGE
1111 E. ARTESIA BLVD.
COMPTON, CA. 90221**


| △ | 02/25/19 | SB | 100% CD |
|----|----------|----|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| NO | DATE | BY | DESCRIPTION |

REVISIONS


| | |
|------------------------|-----------------|
| DRAWN: GMB | CHECKED: SB |
| DATE: 02/25/19 | SCALE: AS NOTED |
| PROJECT NUMBER: 17-301 | |

**CONSTRUCTION
DETAILS**


DRAWING NUMBER : **S-2**

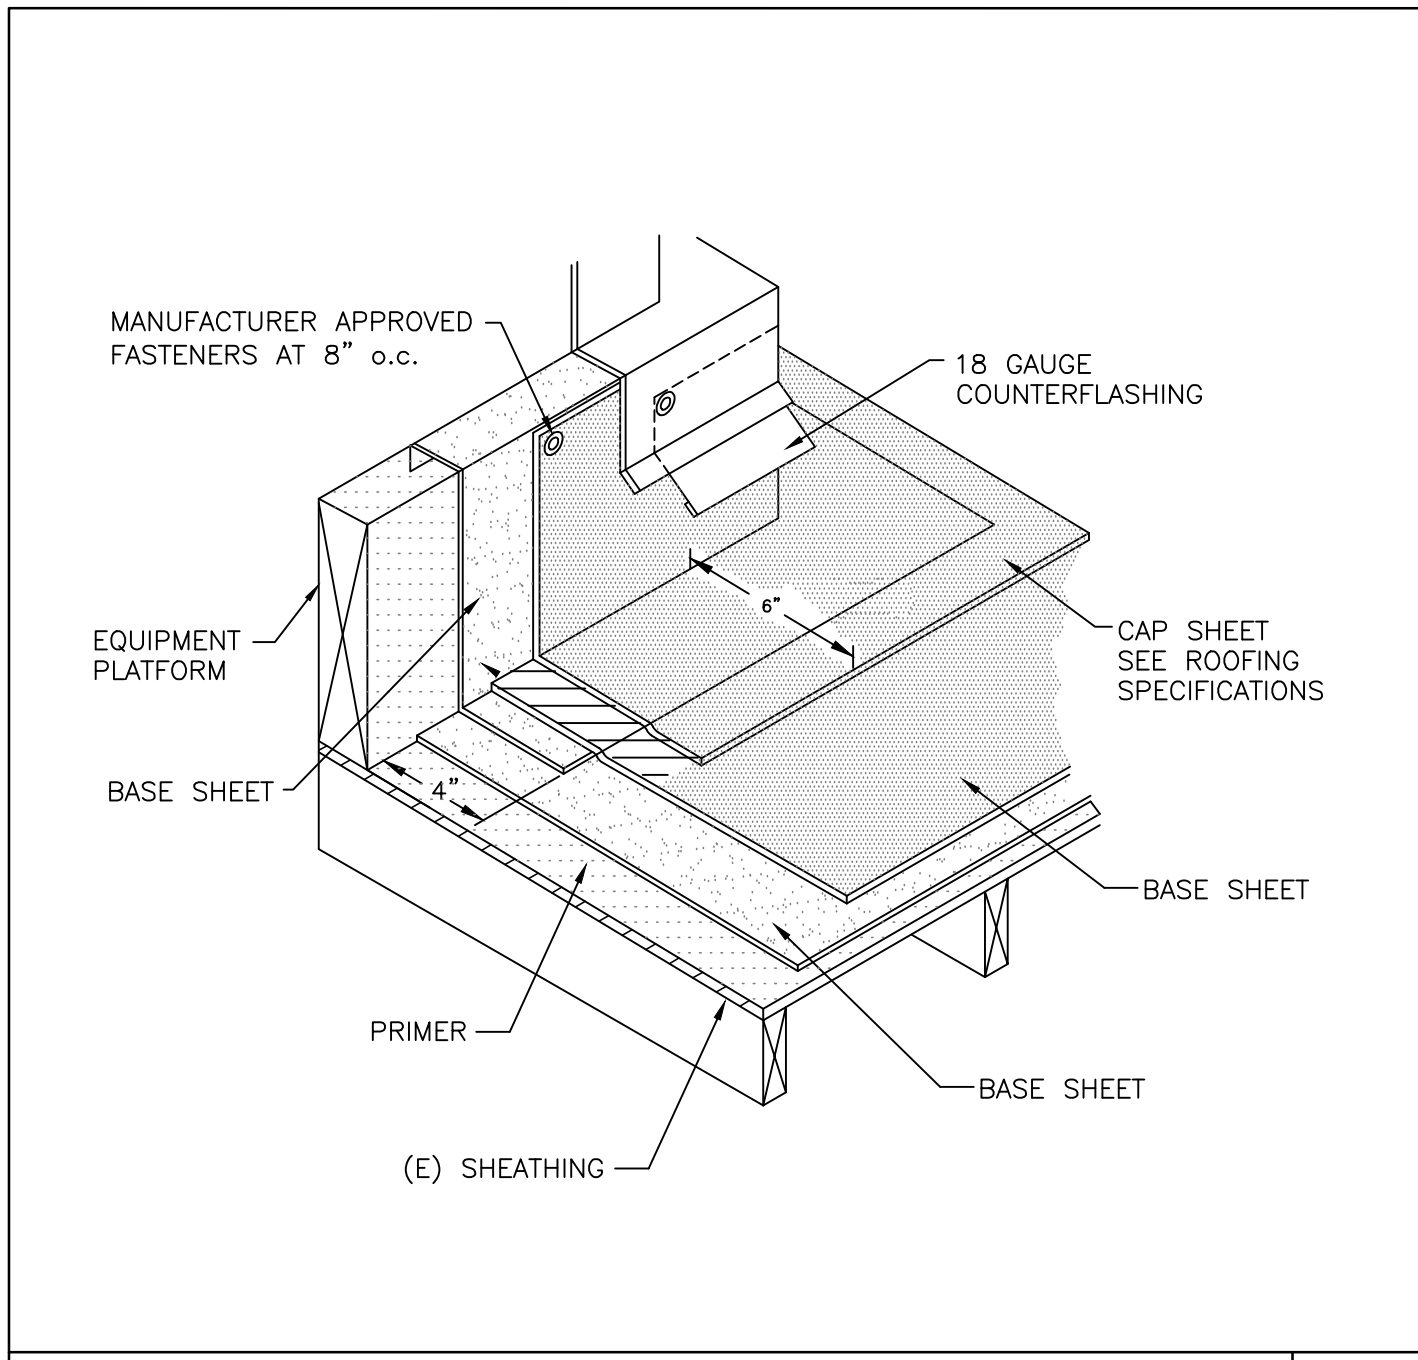

BUILT-UP ROOF AT PLATFORM

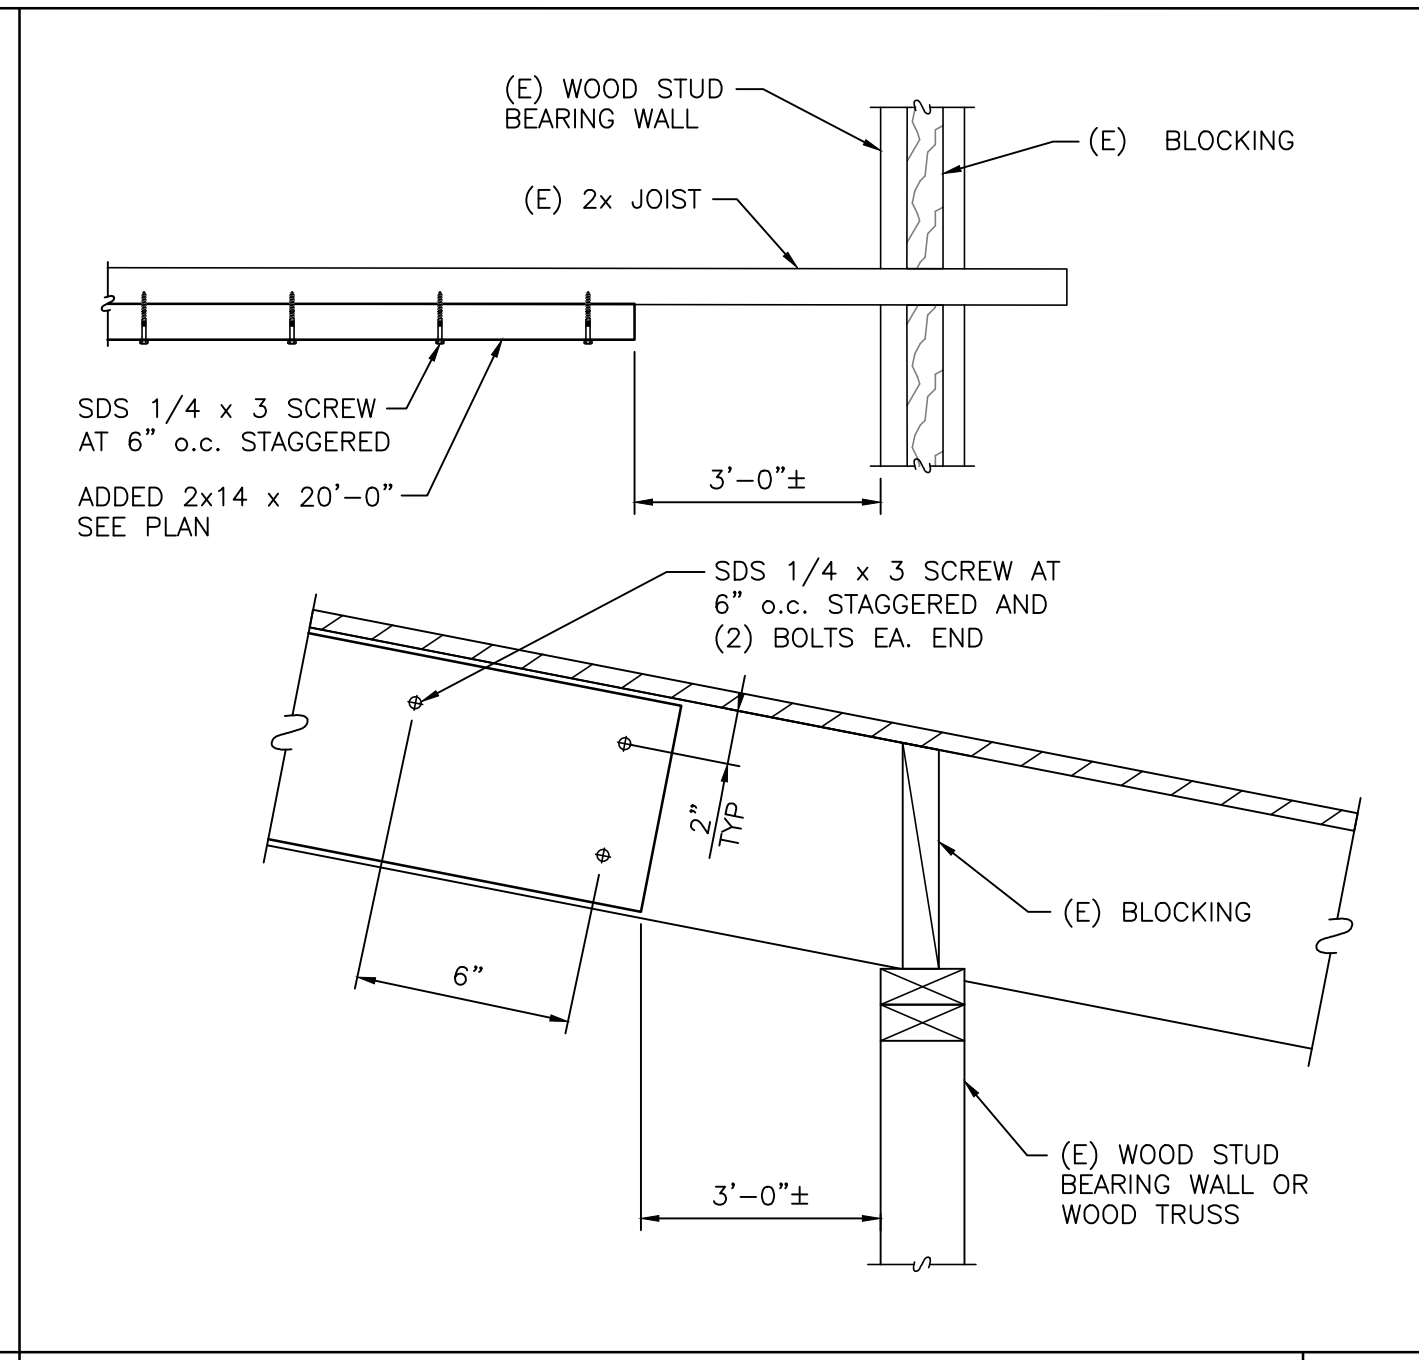

WOOD JOIST RETROFIT

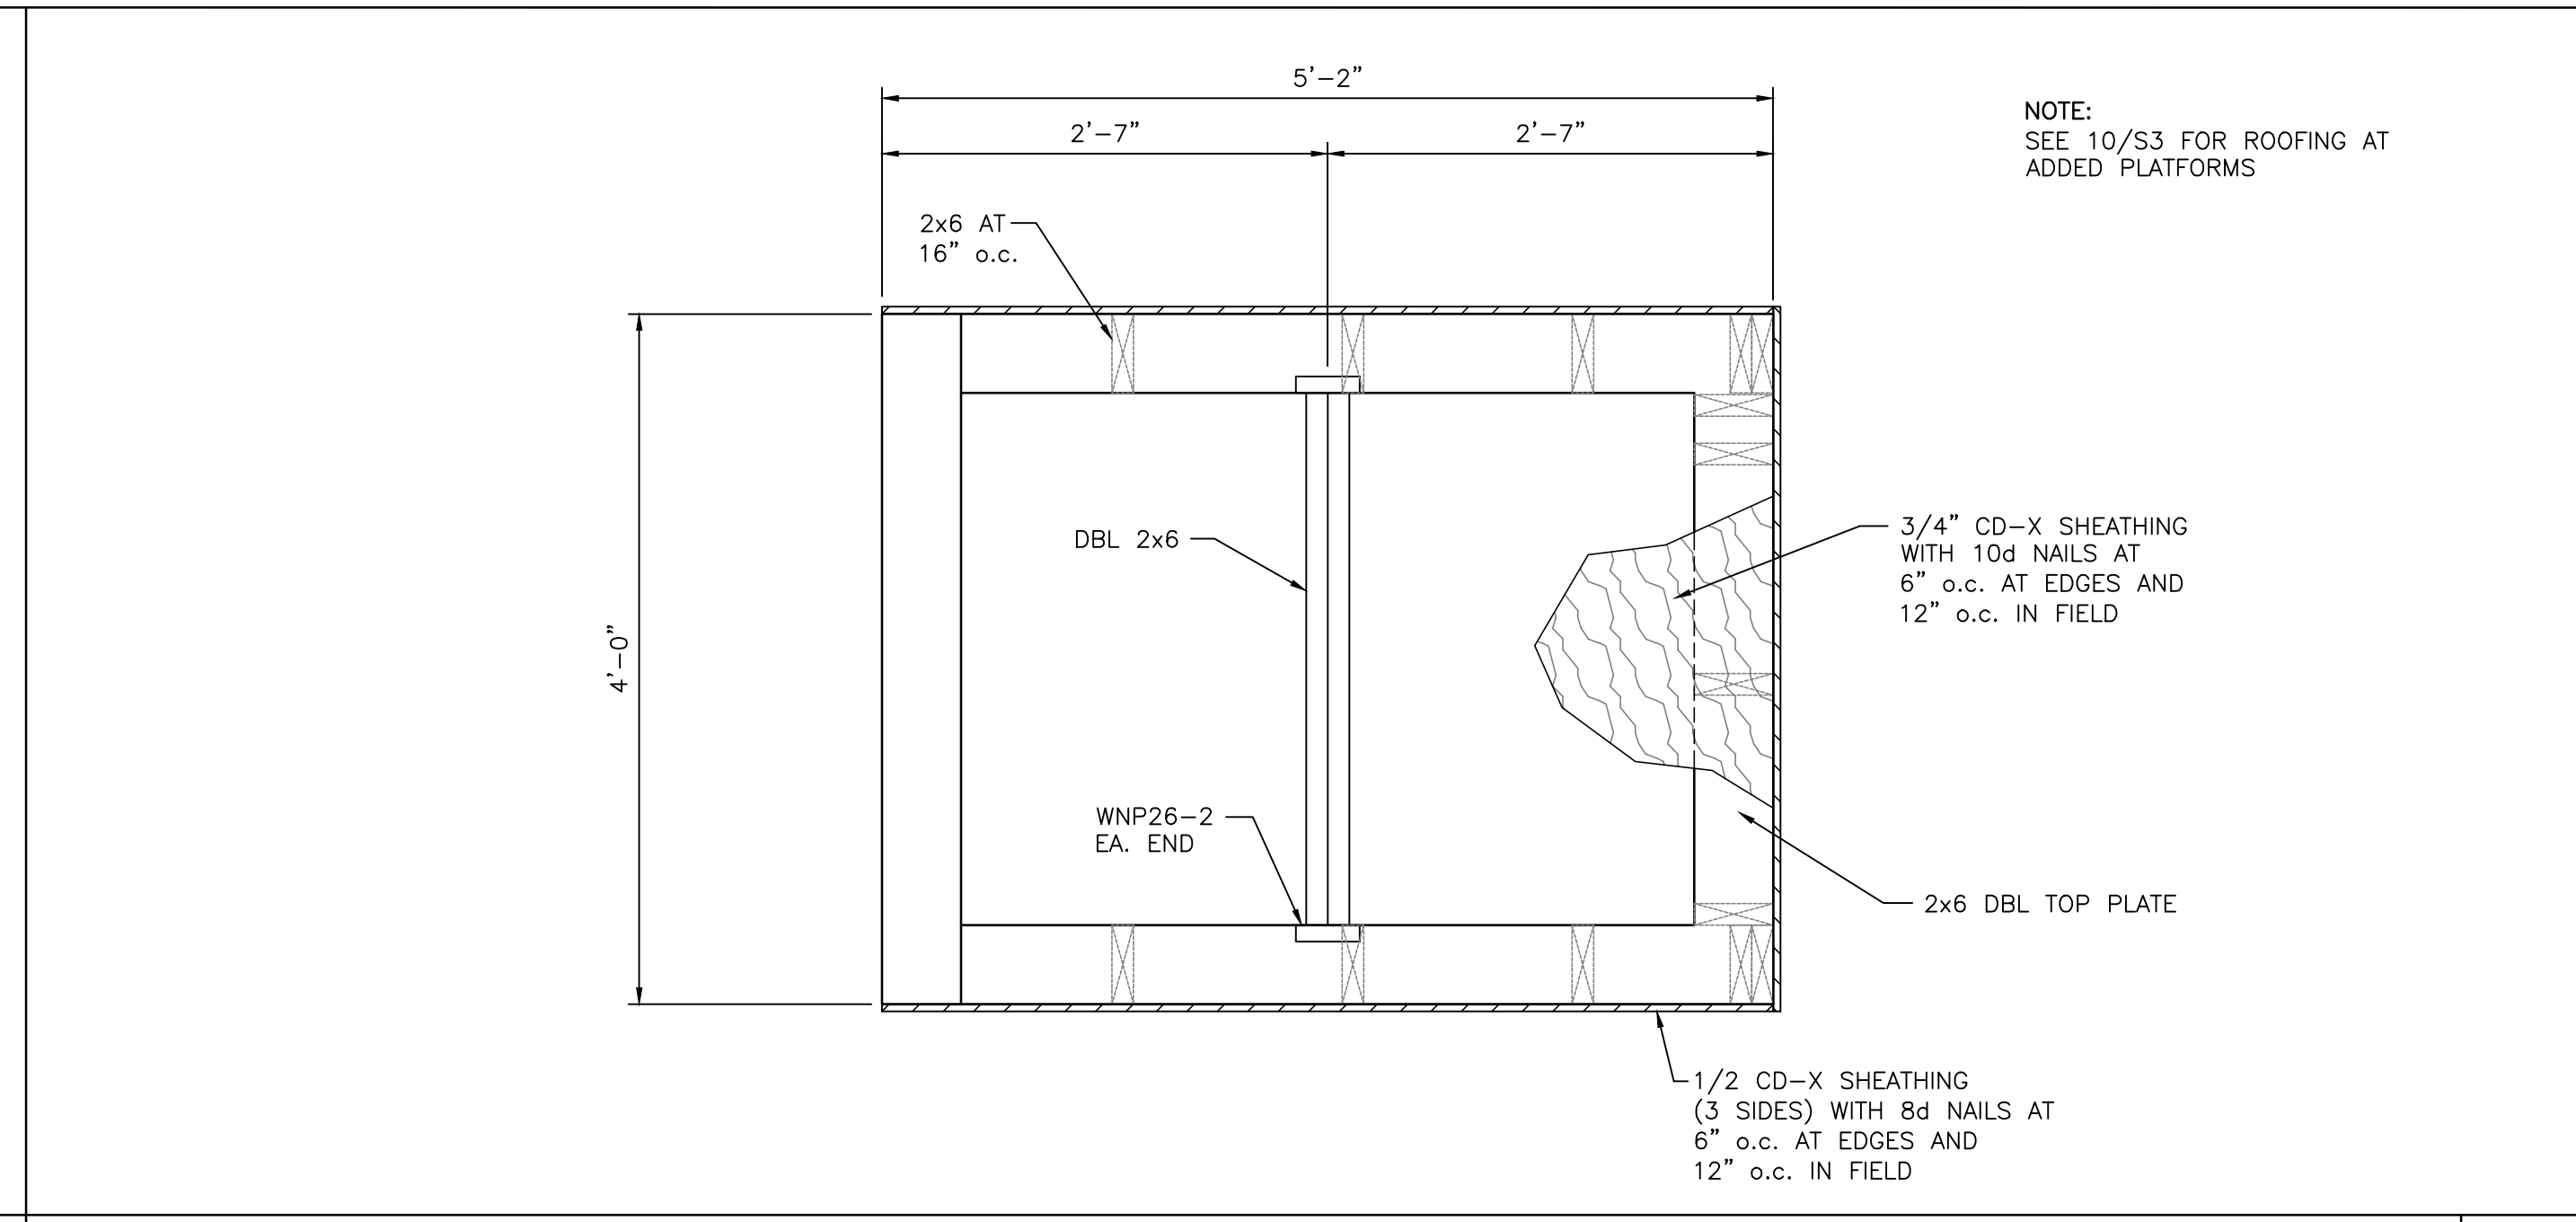

PLATFORM FRAMING PLAN


IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP. 03-119661 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 10/25/2019

RFHC
RF Hawkins Consulting
 2357 Naples Avenue
 Mentone, CA 92359-9635
 Tel: (909) 522-4518
 design@rfhawkinsconsulting.com


CONSULTANT
next step
DESIGN, INC
 26170 ENTERPRISE WAY SUITE 400
 LAKE FOREST, CA 92630
 PHONE: (949) 215-3339
 FAX: (949) 457-9375
 NSD JOB # 06-209



WOOD JOIST RETROFIT

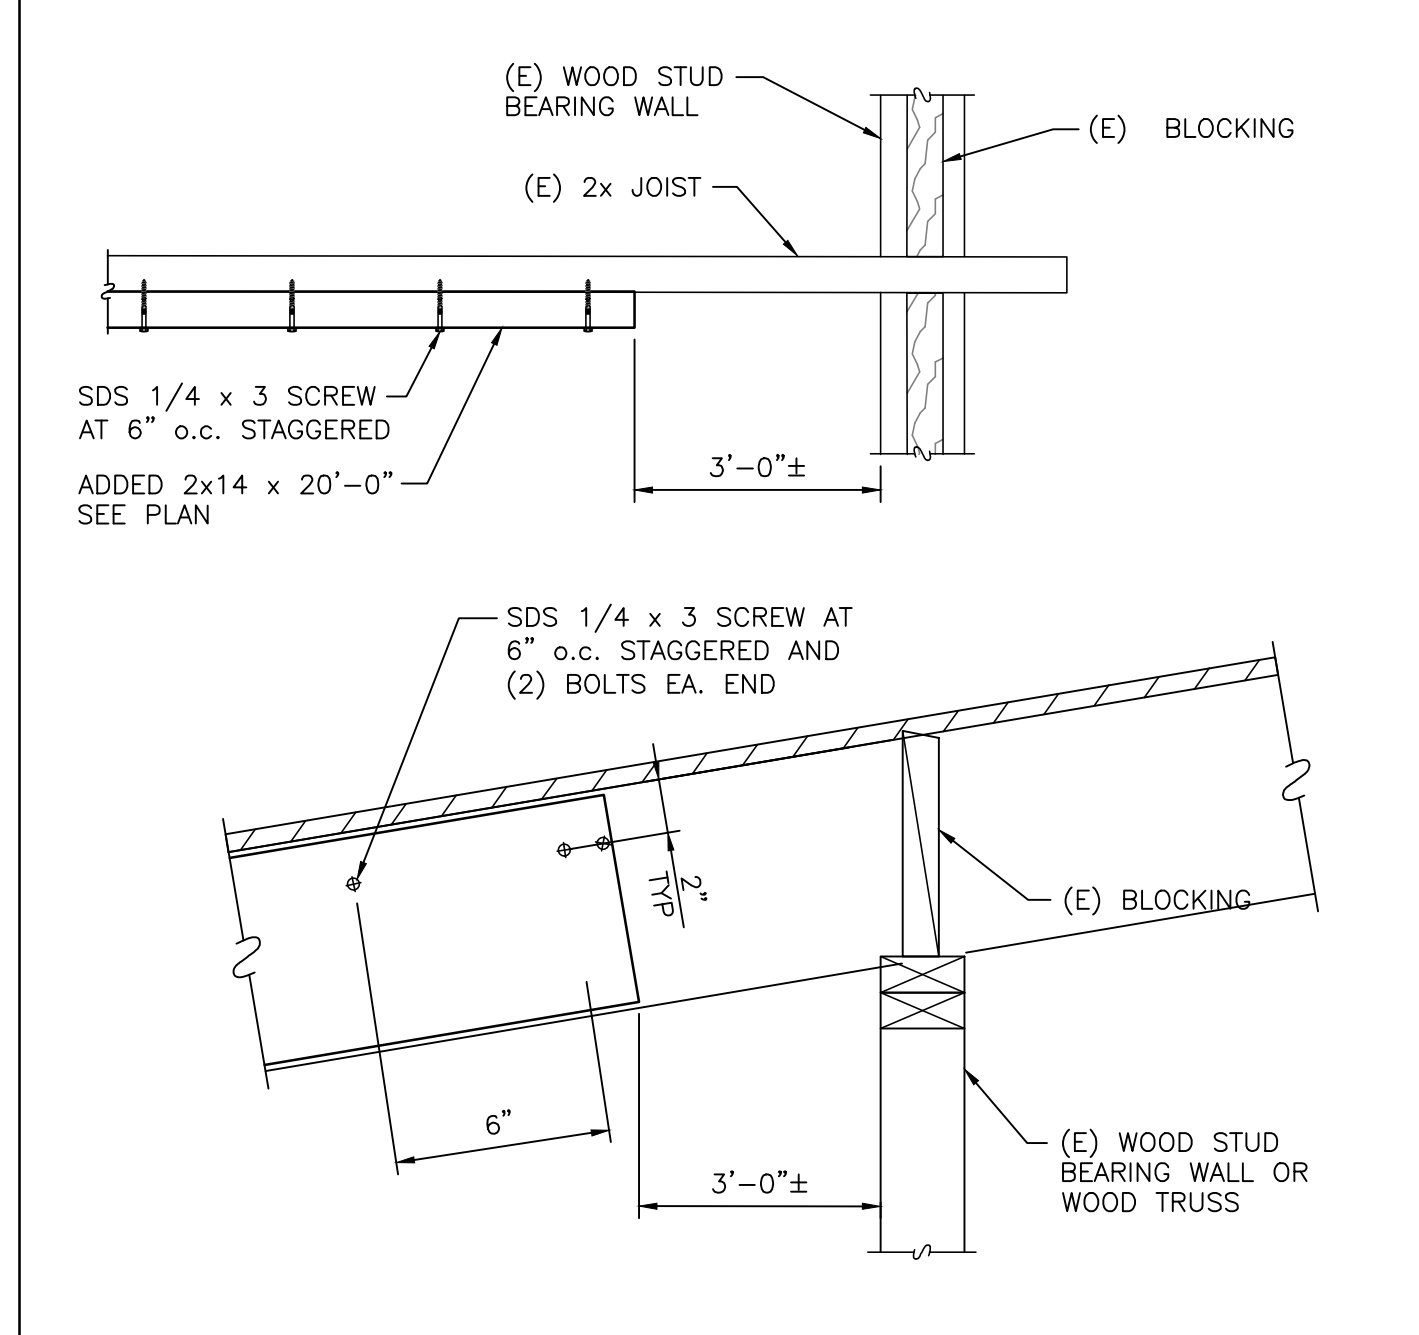


WOOD JOIST RETROFIT

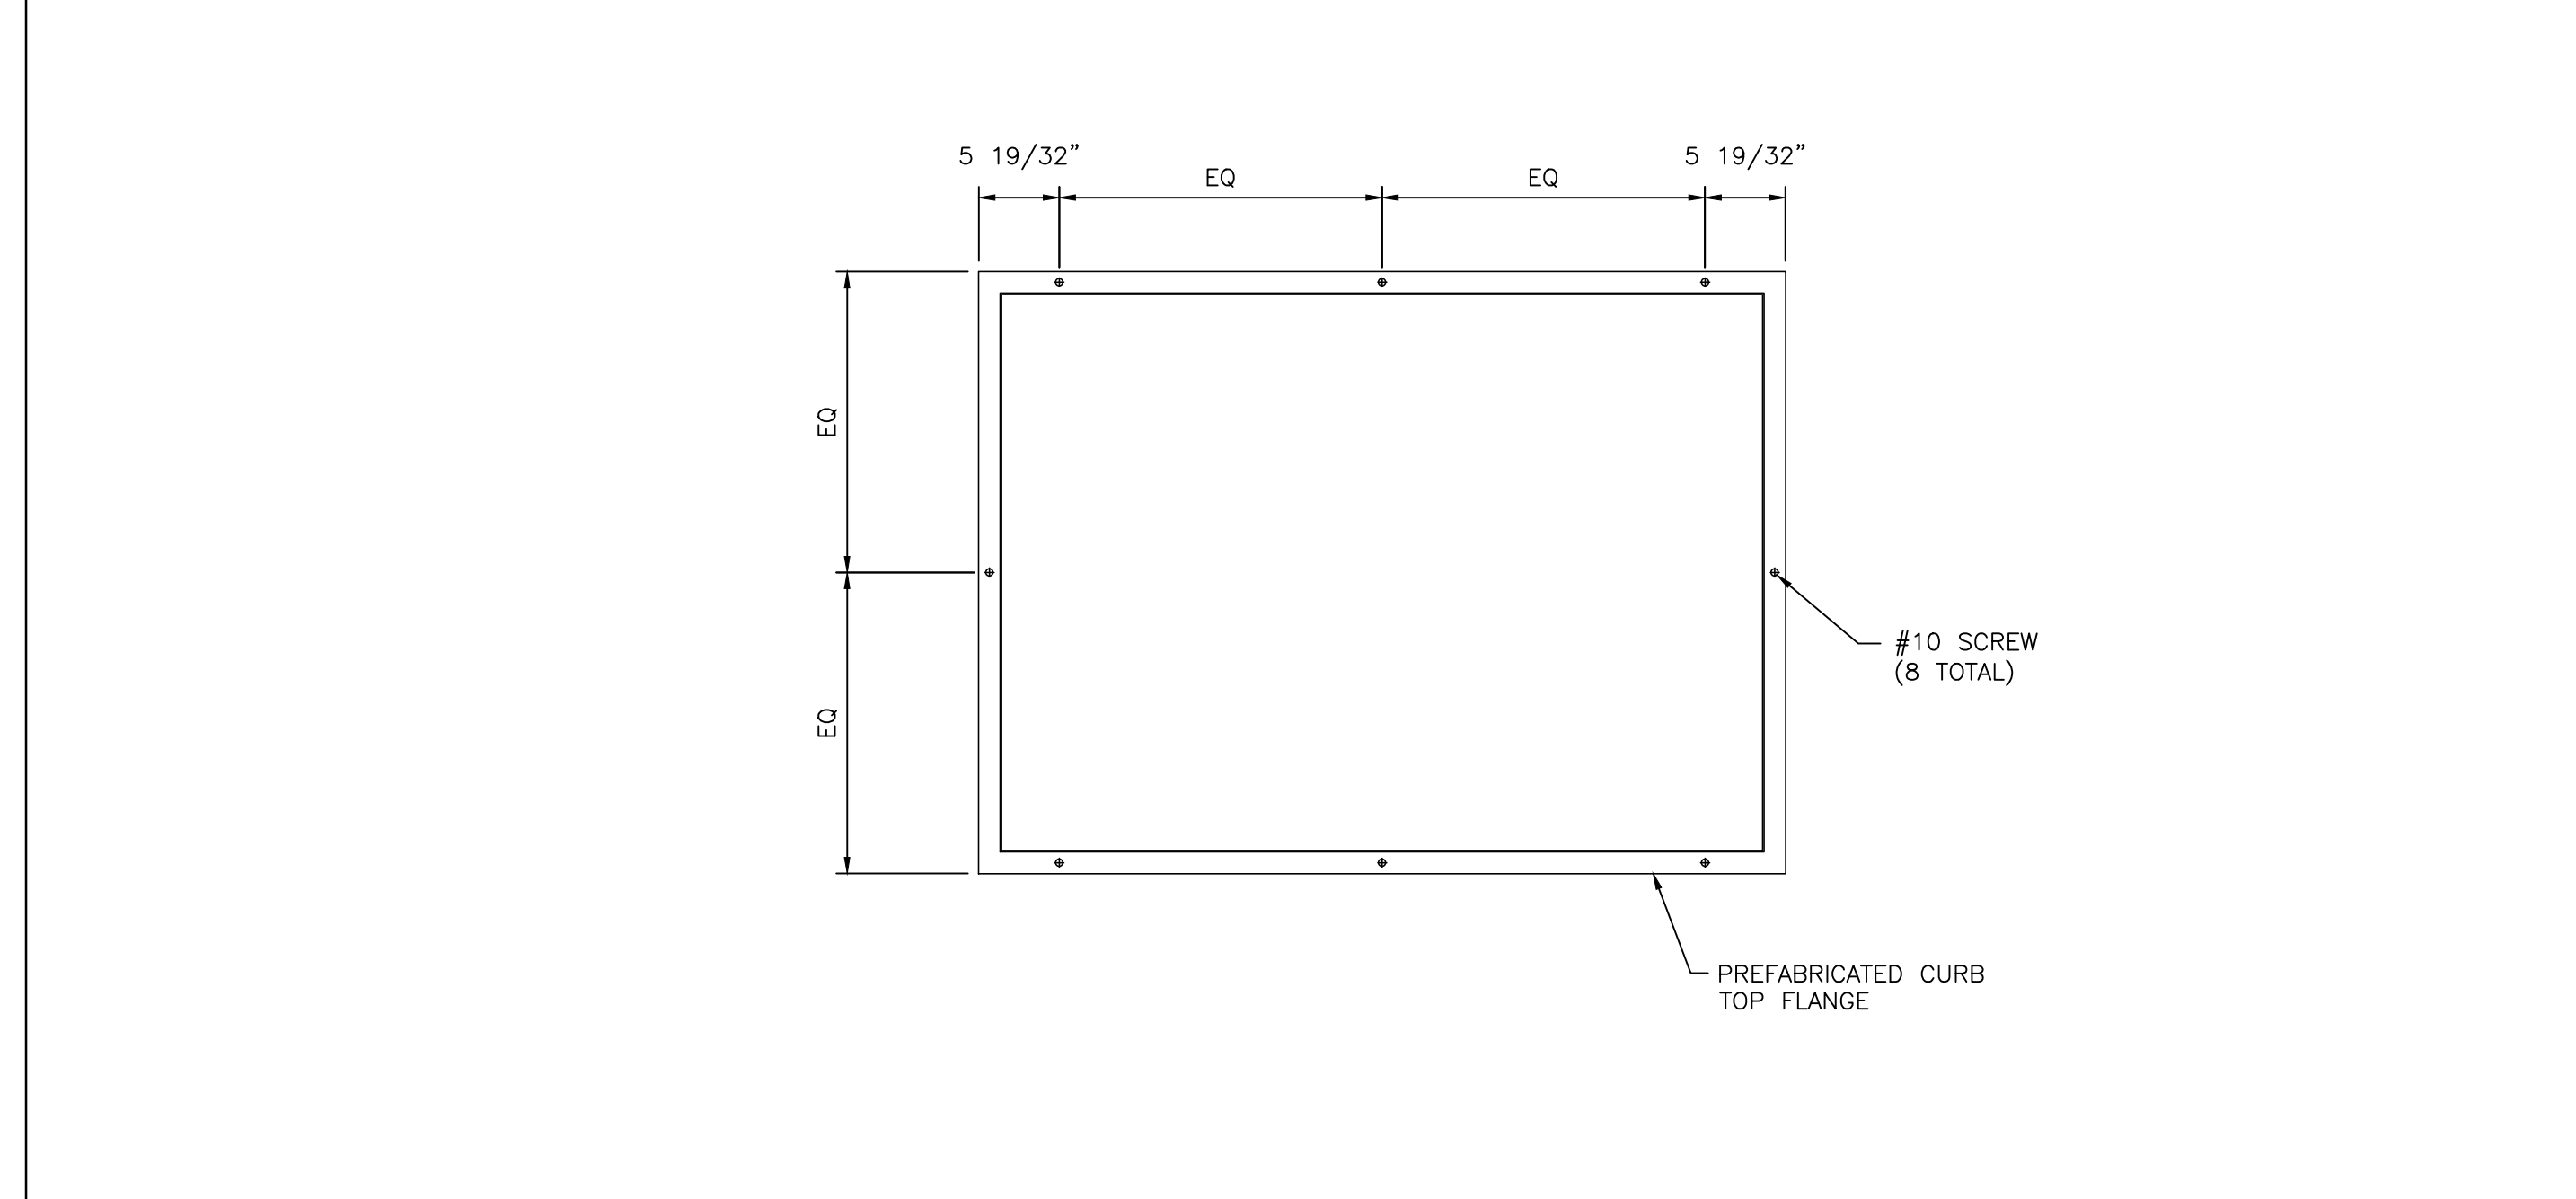


CURB TOP ANCHOR LAYOUT


HVAC ADDITIONS TO
CAFETERIA BLDG.
 COMPTON COMMUNITY
 COLLEGE DISTRICT
 COMPTON COLLEGE
 1111 E. ARTESIA BLVD.
 COMPTON, CA. 90221



MICROLLAM CONNECTION

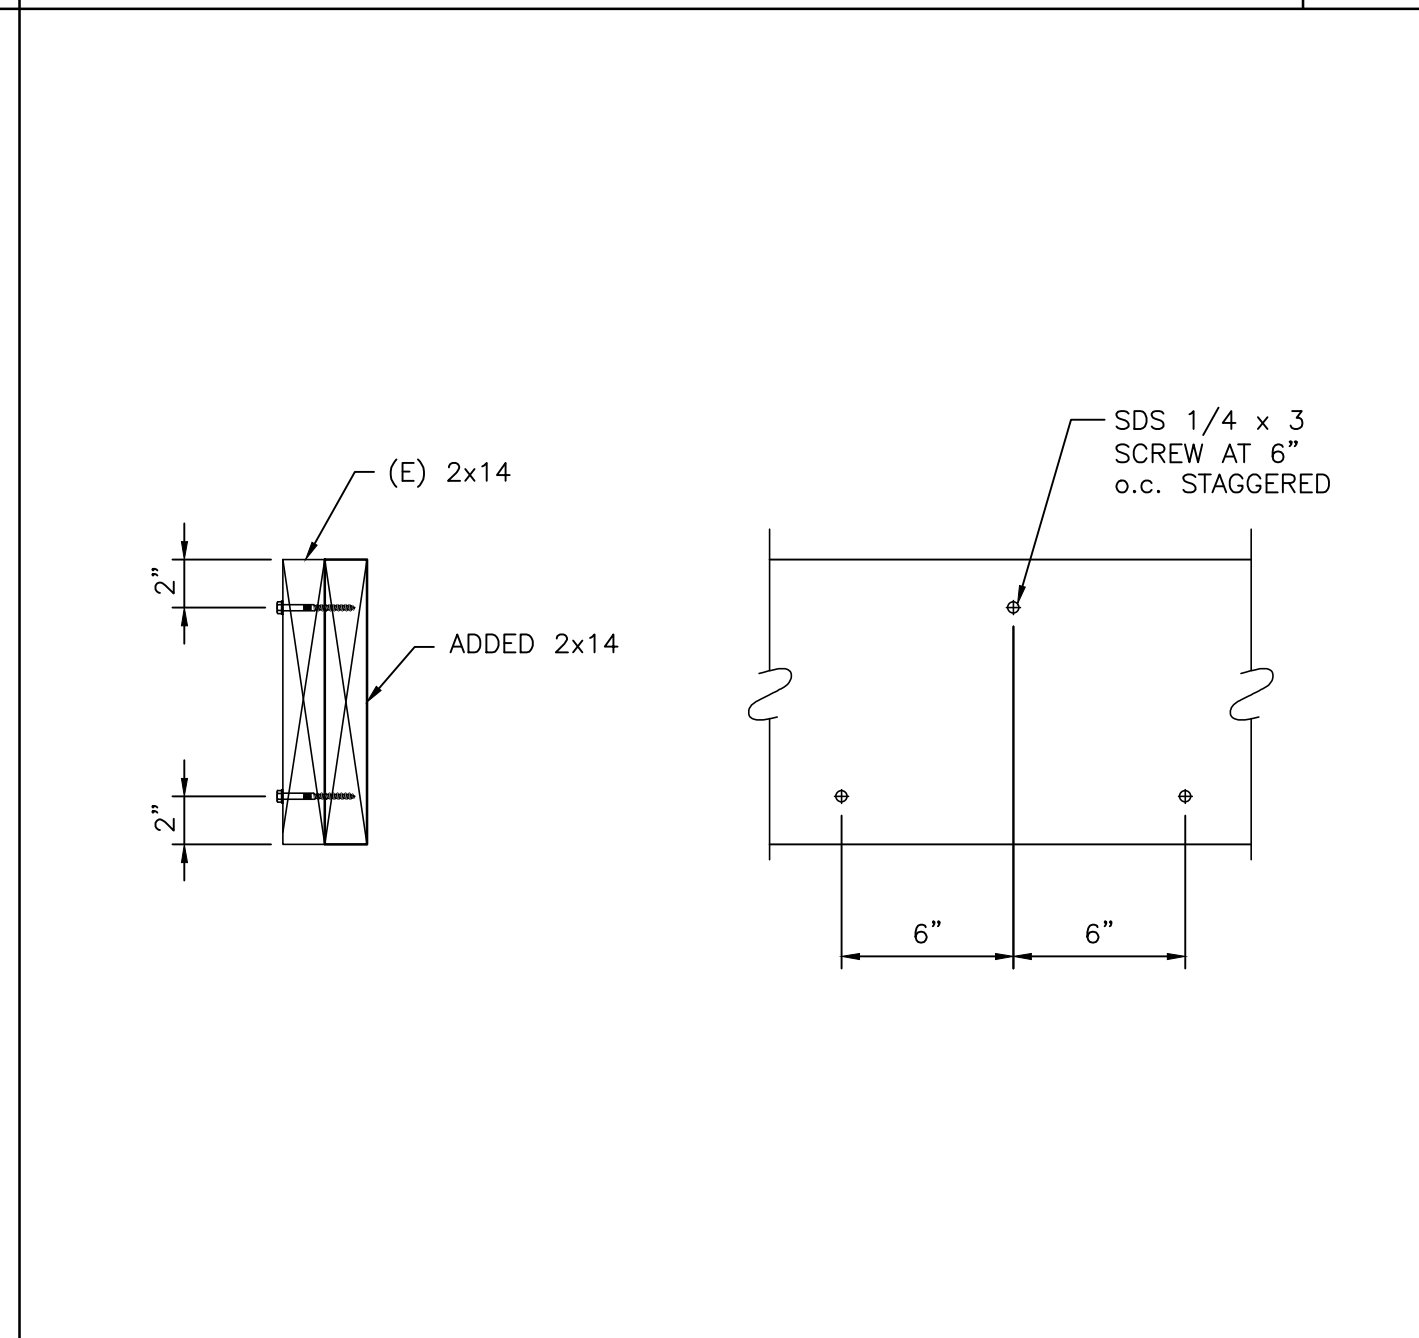

CURB BOTTOM ANCHOR LAYOUT

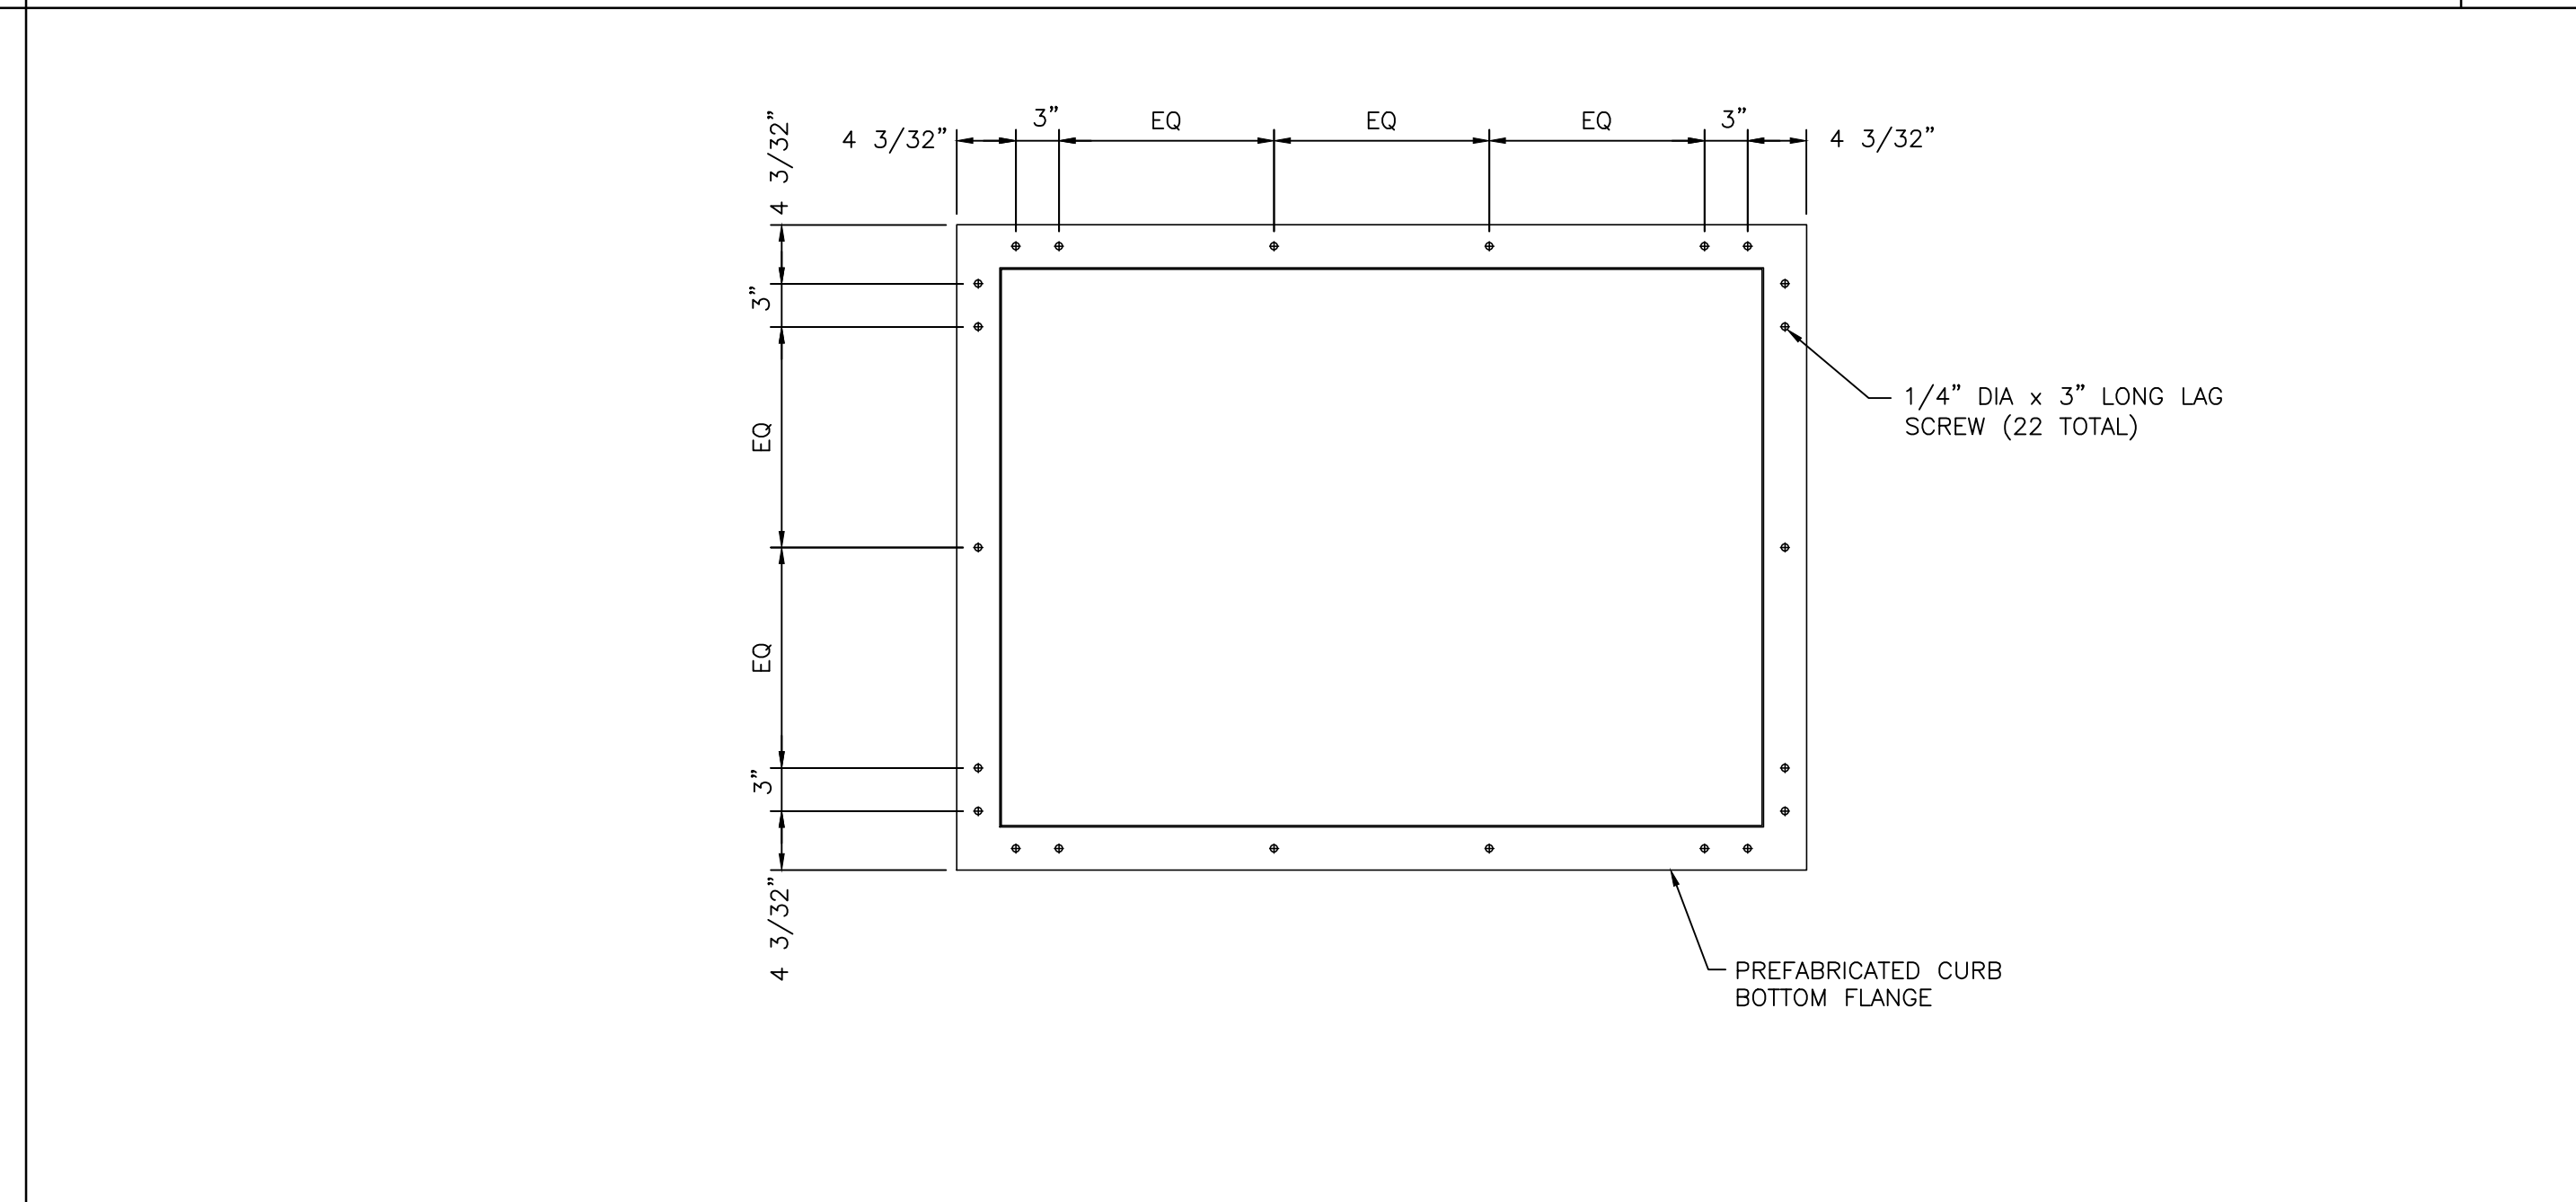

CURB BOTTOM ANCHOR LAYOUT

| △ | 02/25/19 | SB | 100% CD |
|----|----------|----|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| NO | DATE | BY | DESCRIPTION |

REVISIONS

| | |
|------------------------|-----------------|
| DRAWN: GMB | CHECKED: SB |
| DATE: 02/25/19 | SCALE: AS NOTED |
| PROJECT NUMBER: 17-301 | |

CONSTRUCTION DETAILS

DRAWING NUMBER : **S-3**